

Zoning Data


Village Of Dobbs Ferry

Zone: OF-2

Use: Single Family Residence

	Required By Code	Existing	Provided
Lot Area	20,000 sf	68,854.21 sf	68,854.21 sf
Set Backs			
Front	30'	148.3'	135.94'
Side	20'	38.4'	33'
Total of Both	50'	124.3'	123.94'
Rear	25'	68.5'	58.75'
Building Hgt	2 1/2 Sty or 35'	2 Sty or 21.83'	2 Sty or 21.83'
Building Coverage	18 %	4.3 %	5.1 %
Impervious Surface	40 %	19.54 %	21.1 %

CLINTON AVENUE

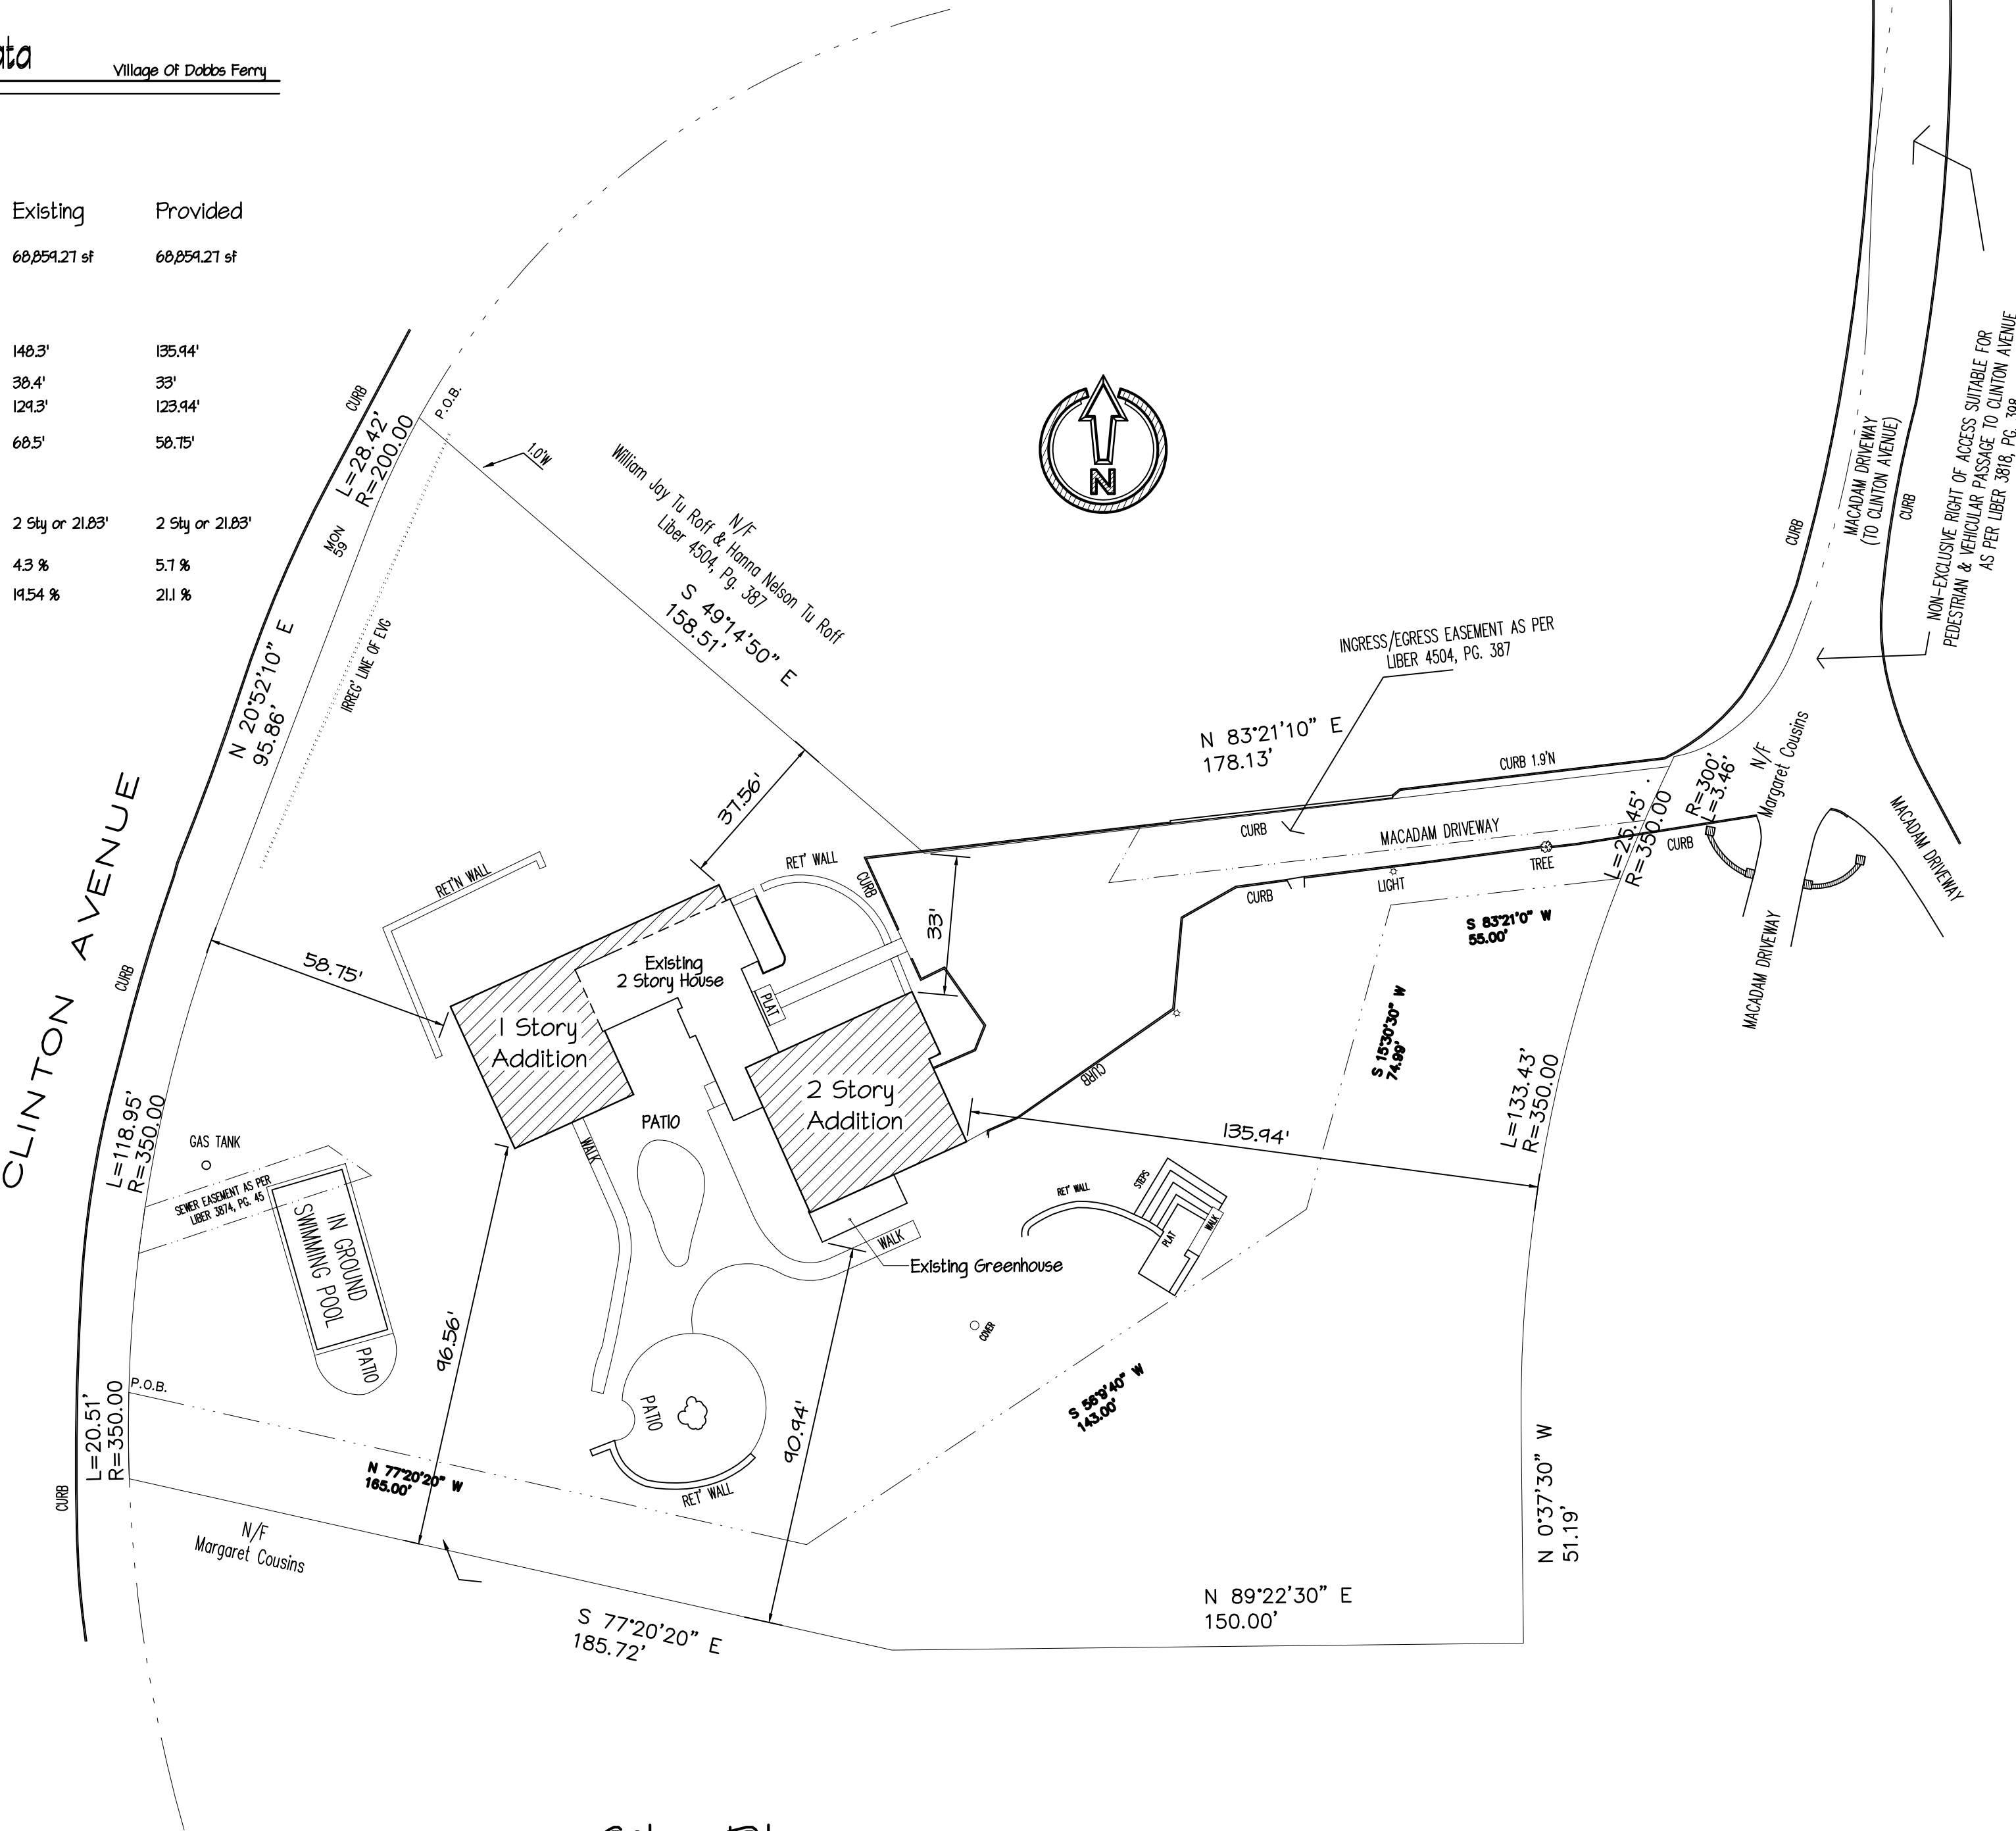

Site Plan  
Scale: 1" = 30'-0"

Notes:

Stormwater Will Discharge To Existing System  
No Changes To Existing Landscaping

Site Plan For

231 Clinton Avenue  
Dobbs Ferry, NY

Revision Date

Date Nov. 18, 2022

Job No 222-118

Drawing

SP OF



DeMasi Architects P.C.

105 SMITH AVENUE, MOUNT KISCO, NEW YORK 10549

EMAIL: Lou@DemasiArchitects.com

PHONE: (914) 666-3858

2020 Residential Code Of New York State

Climatic & Geographic Design Criteria Table R301.2(1)										
Ground Snow Load	Wind Design Speed (mph)	Topographic Effects	Special Wind Region	Wind-Borne Debris Zone	Seismic Design Category	Subject To Damage From Hail	Freeze Protection	Winter Design Temp.	Ice Shield Required	Flood Hazards
30 lbf/sf	115 - 120 mph	No	Yes	Zone I	B	Severe	42"	Moderate Heavy	7° F	Yes
										No
										1500 or Less
										52.2 F

Manual J Design Criteria							
Elevation	Latitude	Winter Heating	Summer Cooling	Altitude Correction Factor	Indoor Design Temperature	Design Temperature Cooling	Heating Temperature Difference
436	41	7	81	1	68	75	61
Cooling Temperature Difference	Wind Velocity Heating	Wind Velocity Cooling	Coincident Wet Bulb	Daily Range	Winter Humidity	Summer Humidity	
12	20.4	15	7.5	M	30	55	

Insulation And Fenestration Requirements By Component Table R402.1.2									
Climate Zone	Fenestration U-Factor	Skylight U-Factor	Glazed Fenestration SHGC	Ceiling R-Value	Wood Frame Wall R-Value	Mass Wall R-Value	Floor R-Value	Basement Wall R-Value	Slab R-Value And Depth
4	0.21	0.50	0.4	49	21 Int. Or 20+5 Or 15+10	15/20	30	15/14	10, 4 Ft
									Crawl Space Wall R-Value
									15/14

Construction Type Note:

As Per Title 19 NYCRR Part 1265

Provide Label As Shown Below



V = Construction Type As Per Section 602 of BCNYS

FR = Floor And Roof Framing As Per Designation For Structural Components That Are Of Truss/Engineered Type Construction

Size:

6" Diameter Circle

Color:

Circle To Be 1/2" Stroke - Reflective Red Pantone #187  
Inner Circle - Reflective White  
Text - Reflective Red Pantone #187

Sign Location:

The Sign Or Symbol Required Shall Be Affixed To The Electric Box Attached To The Exterior Of The Residential Structure.  
See Section 1265.5 For Further Notes On Sign Location.

See Title 19 NYCRR Part 1265 For Other Specs

Insulation Note:

Prescriptive Insulation Method To Be Used No Recheck Required  
No Recheck Required  
See Table R402.1.2 Of The NYStretch Energy Code 2020

Sprinkler Note:

Sprinkler Plan By Other

Lighting Note:

All Exterior Lighting To Comply With Section 300-41

Square Footage

First Floor	2,741 SF
Second Floor	2,433 SF
Total	5,174 SF
Garage	561 SF
Green House	166 SF

Typical Roof Construction  
(Refer To Wall Section For All Other Information)

"Simpson" H4 Seismic & Hurricane Tie Or Equal

2 x 4 Cont. Plate (Set On Top Of Joist)

Typical Wall Construction  
(Refer To Wall Section For All Other Information)

Note:  
Plywood Must To Extend Under 2 x 4 Plate, If Plywood Is Not Installed Provide 2 x 4 Tie-Backs @ 16" o/c


Rafter / Tailout Detail @ Garage

Scale: 1" = 1'-0"

Schedule For Proposed Building Material and Color Scheme

Name:	Type:	Color:
Siding:	Hardi-plank	Bevel
Windows:	Pella	Double Hung
Trim:	Hardi-plank	Composite
Front Door:		Wood
Roofing:		Asphalt Shingle Roof
Garage Door		Composite
		Jogging Path

All Materials Shall Be As Specified Or Similar

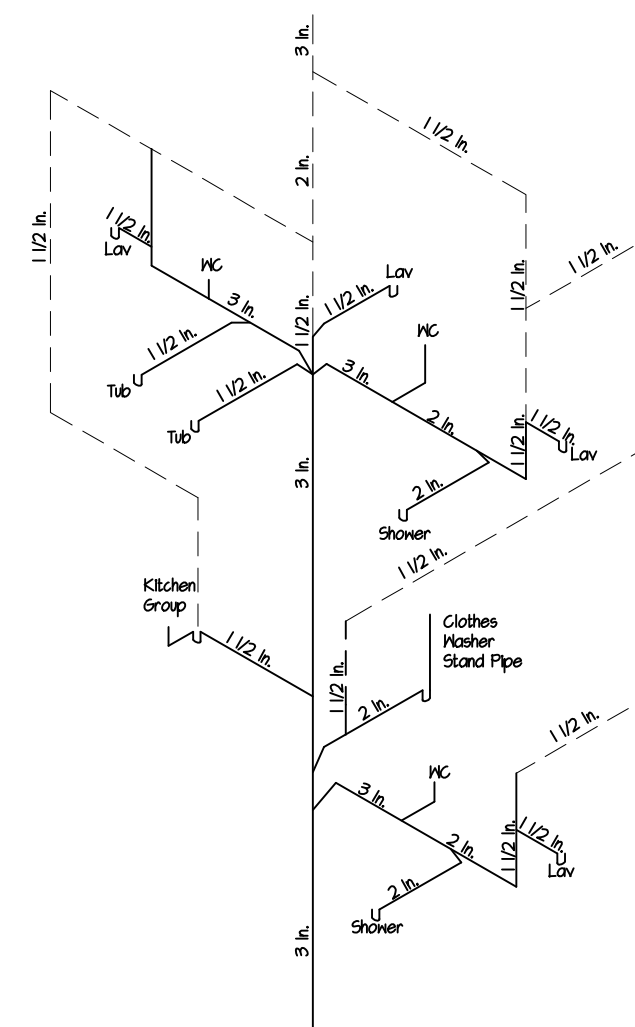


Typical Plumbing Riser Diagram

Scale: None

Riser diagram taken from "2020 Residential Code Of New York State" Figure N5, Refer to diagram for all other information

Note:  
Plumbing riser diagram shown is generic, and should be used only for informational purposes. Plumbing contractor to install plumbing system as per state & local building codes.

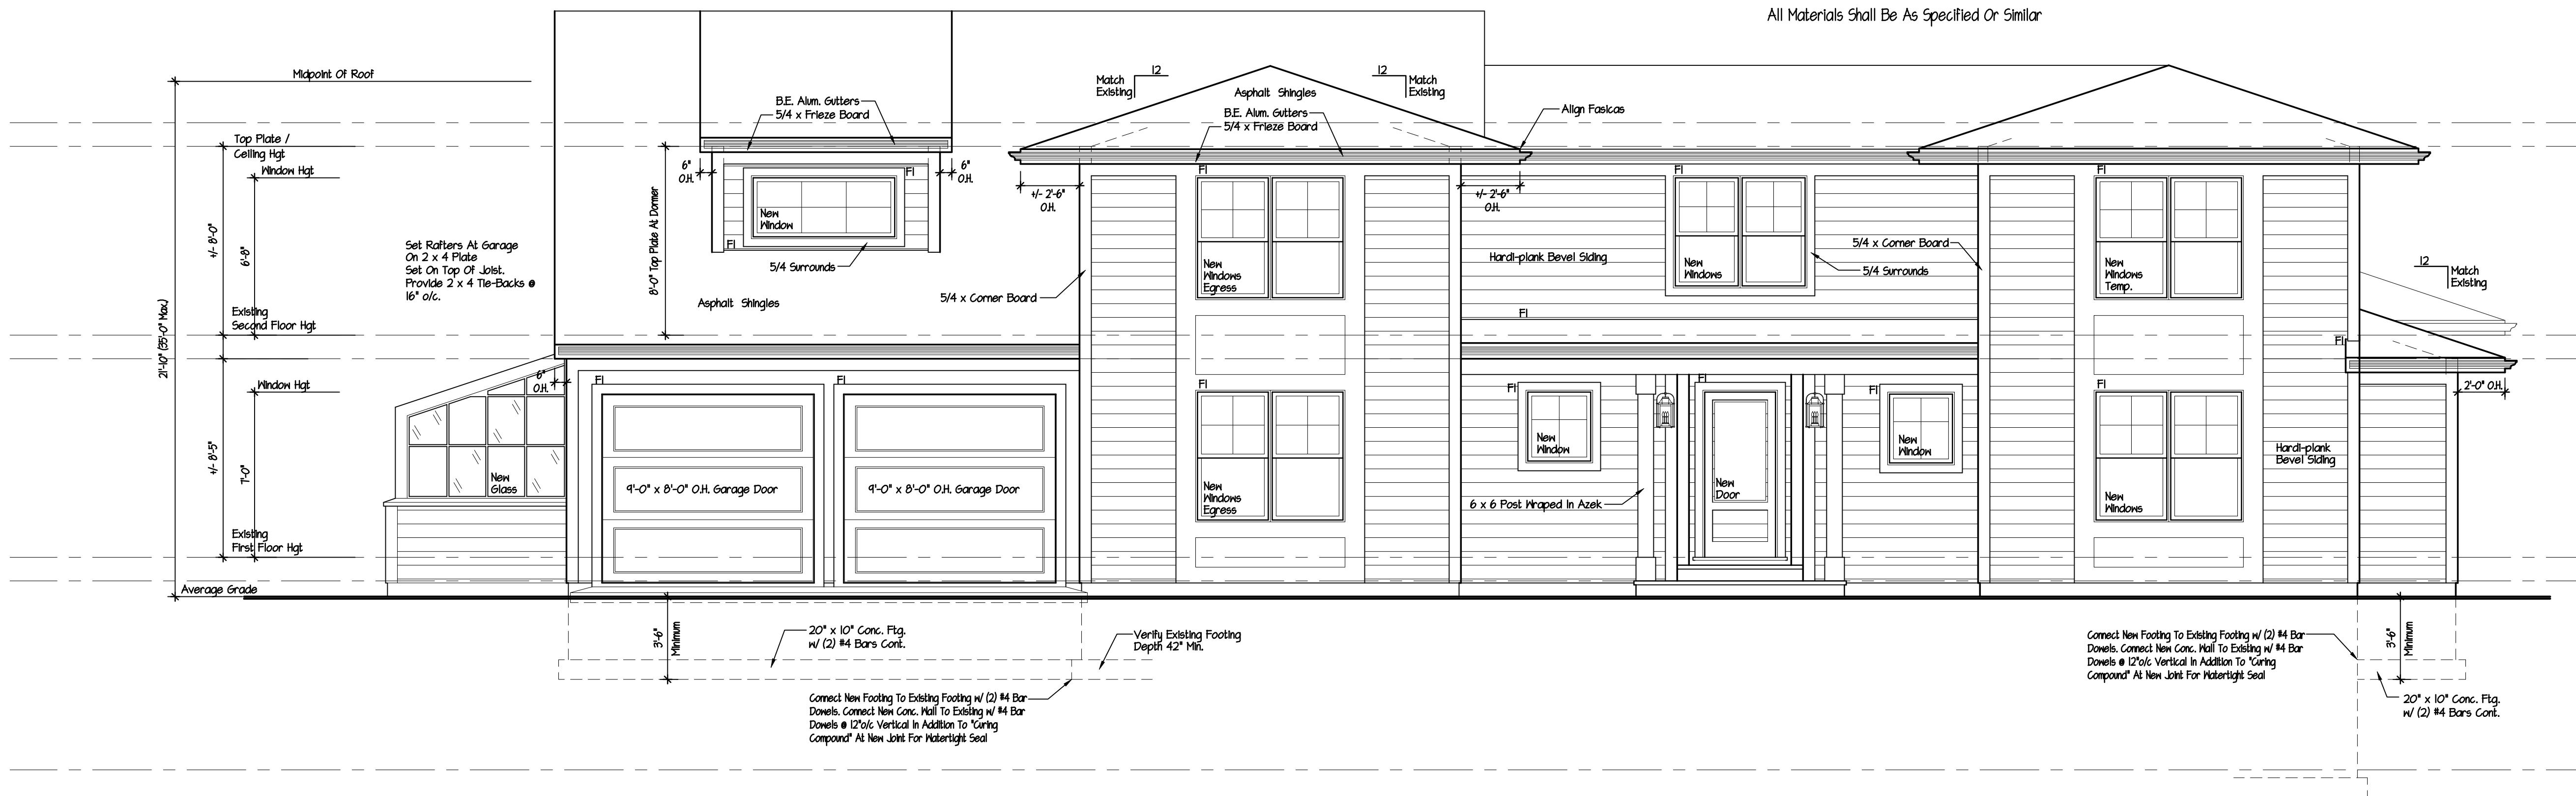

Proposed Front Elevation

Scale: 1/4" = 1'-0"

DeMasi Architects P.C.

105 SMITH AVENUE, MOUNT KISCO, NEW YORK 10549

EMAIL: Lou@DemasiArchitects.com

PHONE: (914) 666-3850

Do Not Scale Prints



These plans are the property of the Architect. Any use or reproduction in whole or part without the written authorization of the Architect is prohibited. Any person or corporation who reproduces these plans without the written authorization of the Architect shall be liable to the Architect for the cost of the reproduction of these plans. These plans are not valid for a building permit unless the person whose name appears on the plans, the Architect, is the person who has been licensed by the State of New York to practice as an Architect.

Addition For

231 Clinton Avenue  
Dobbs Ferry, NY

Revision

Date


Date Nov. 24, 2022

Job No 222-118

Drawing

1 OF 2



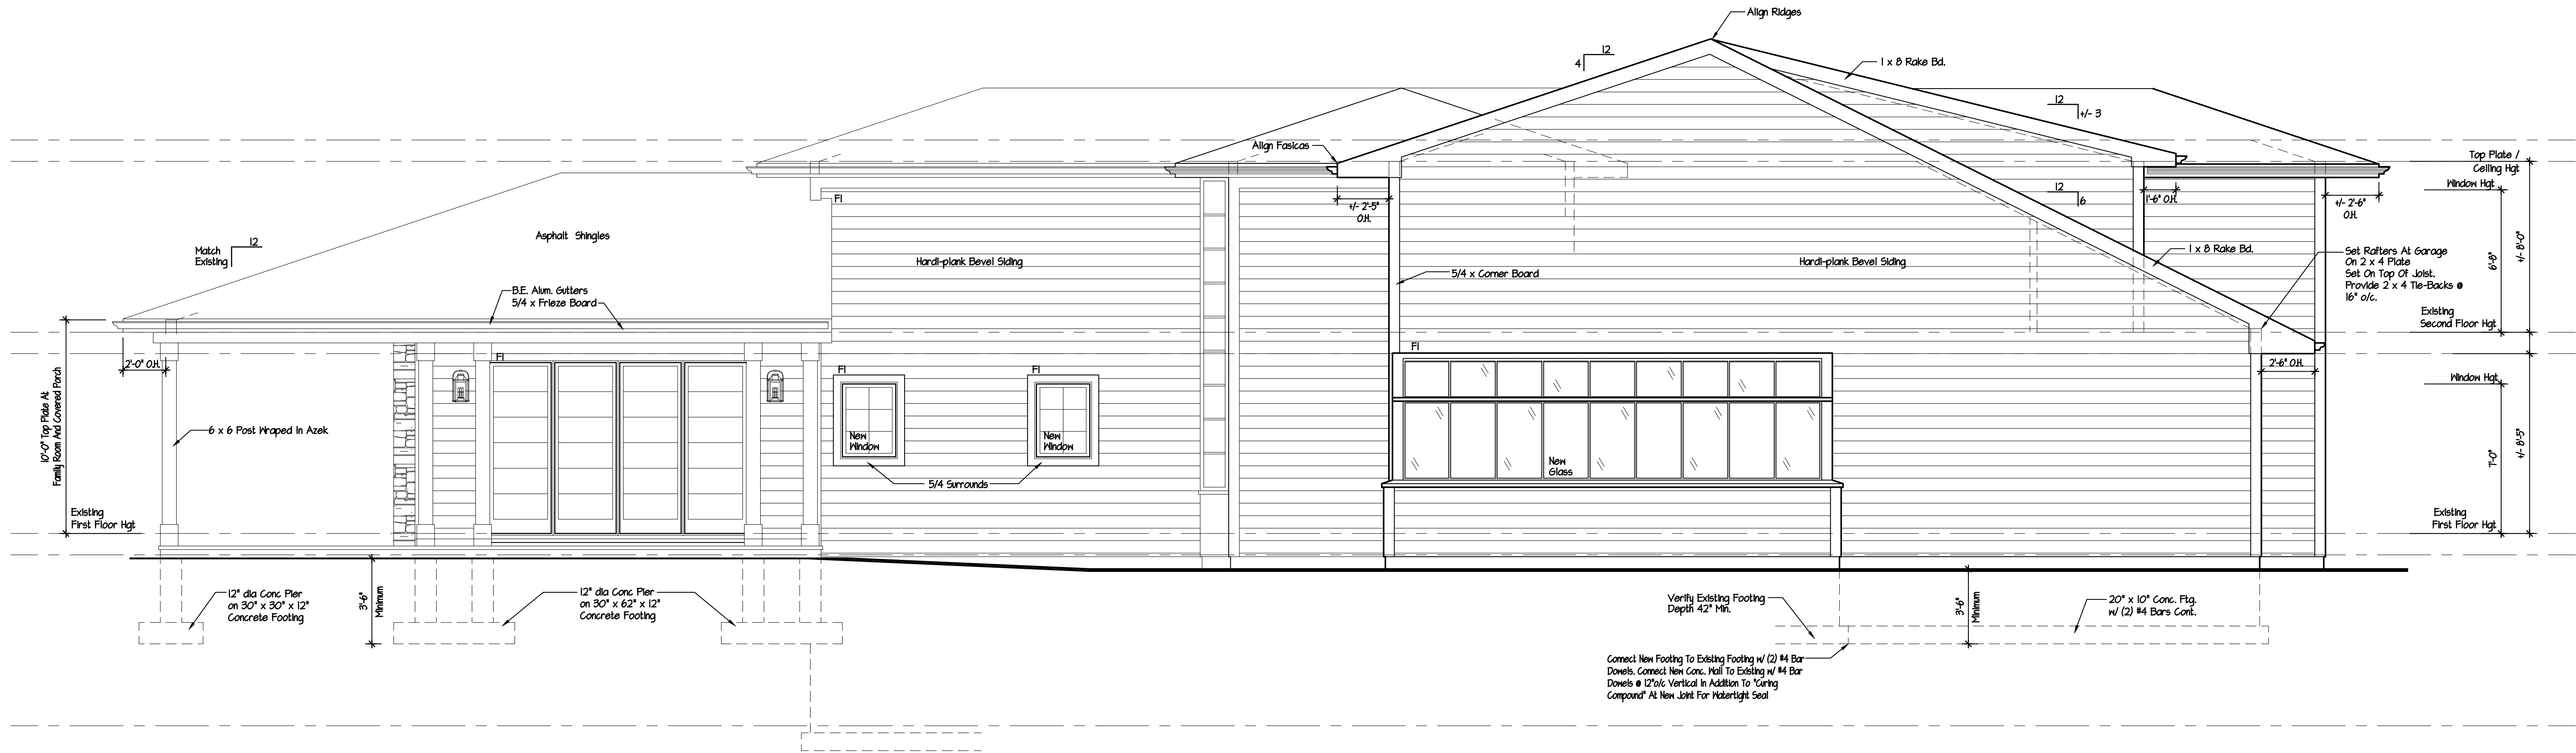


Proposed  
**Left Side Elevation**  
Scale: 1/4" = 1'-0"


**Schedule For Proposed Building Material and Color Scheme**

	Name:	Type:	Color:
Siding:	Hardi-plank	Bevel	Snowbound
Windows:	Pella	Double Hung	Jogging Path
Trim:	Hardi-plank	Composite	Jogging Path
Front Door:		Wood	Mahogany
Roofing:		Asphalt Shingle Roof	Black
Garage Door		Composite	Jogging Path

All Materials Shall Be As Specified Or Similar

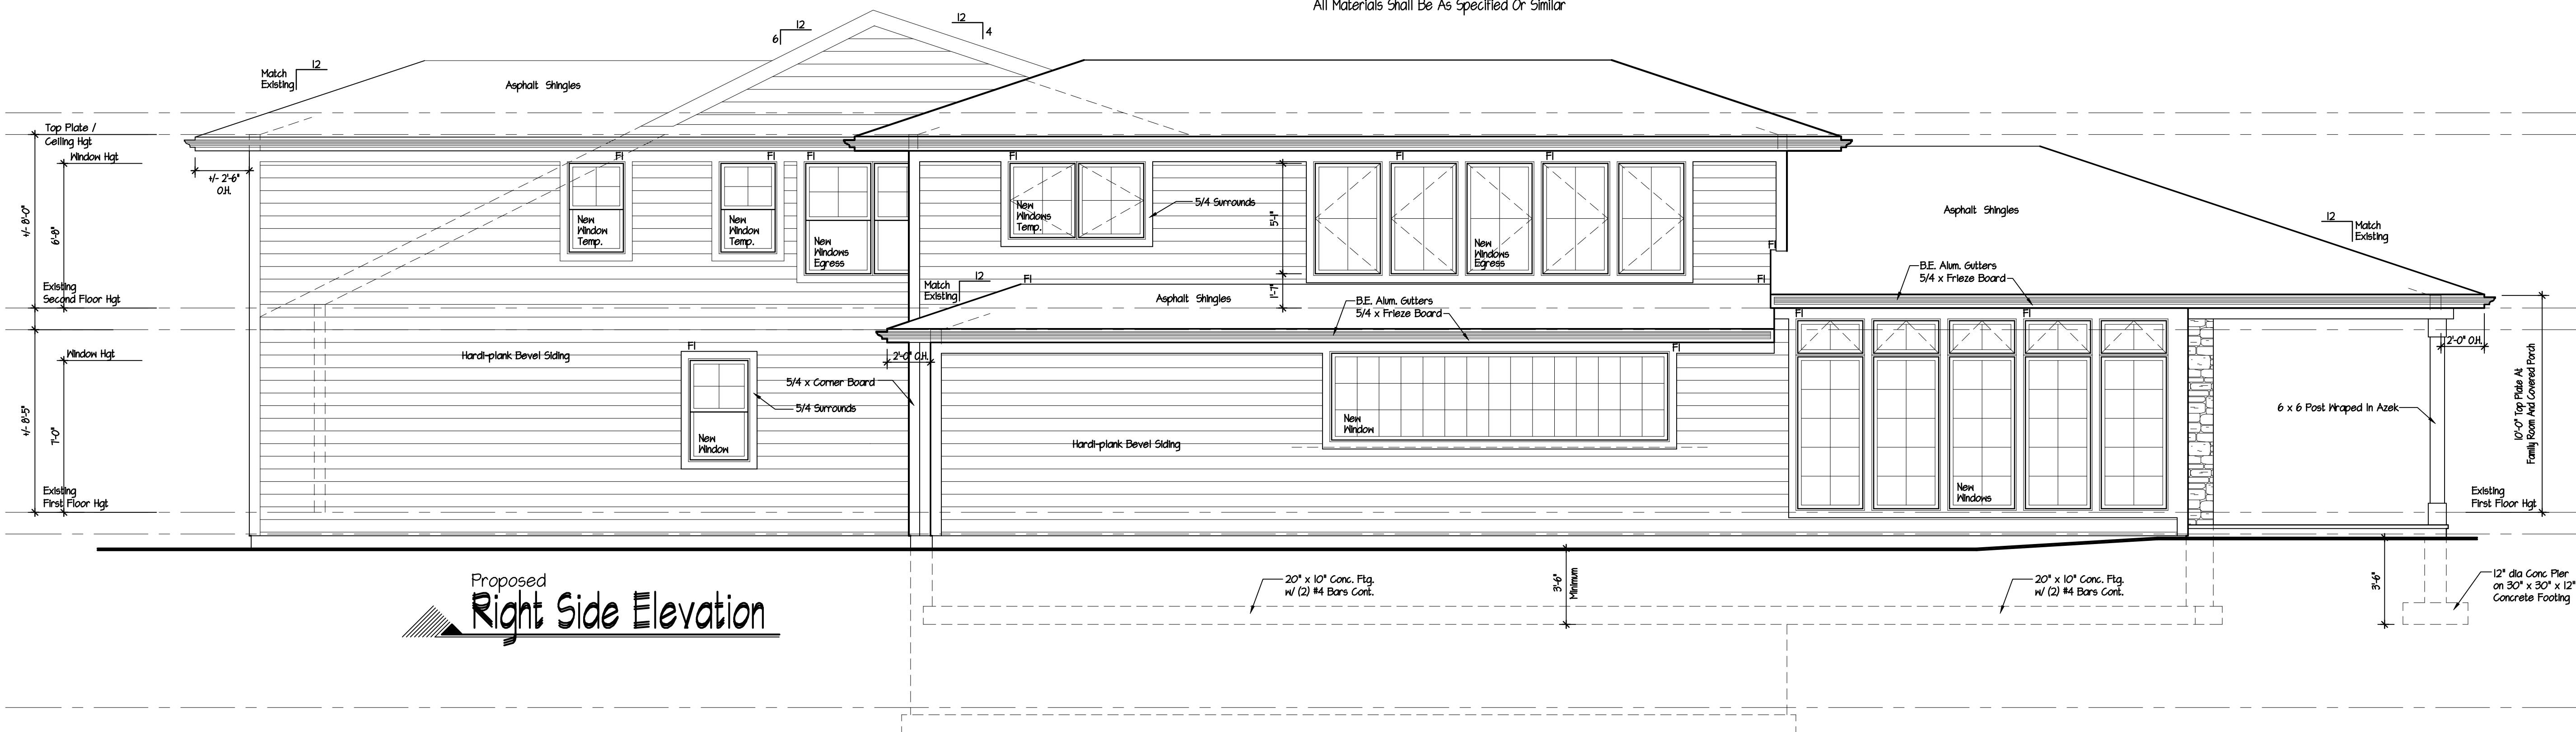


Proposed  
**Right Side Elevation**

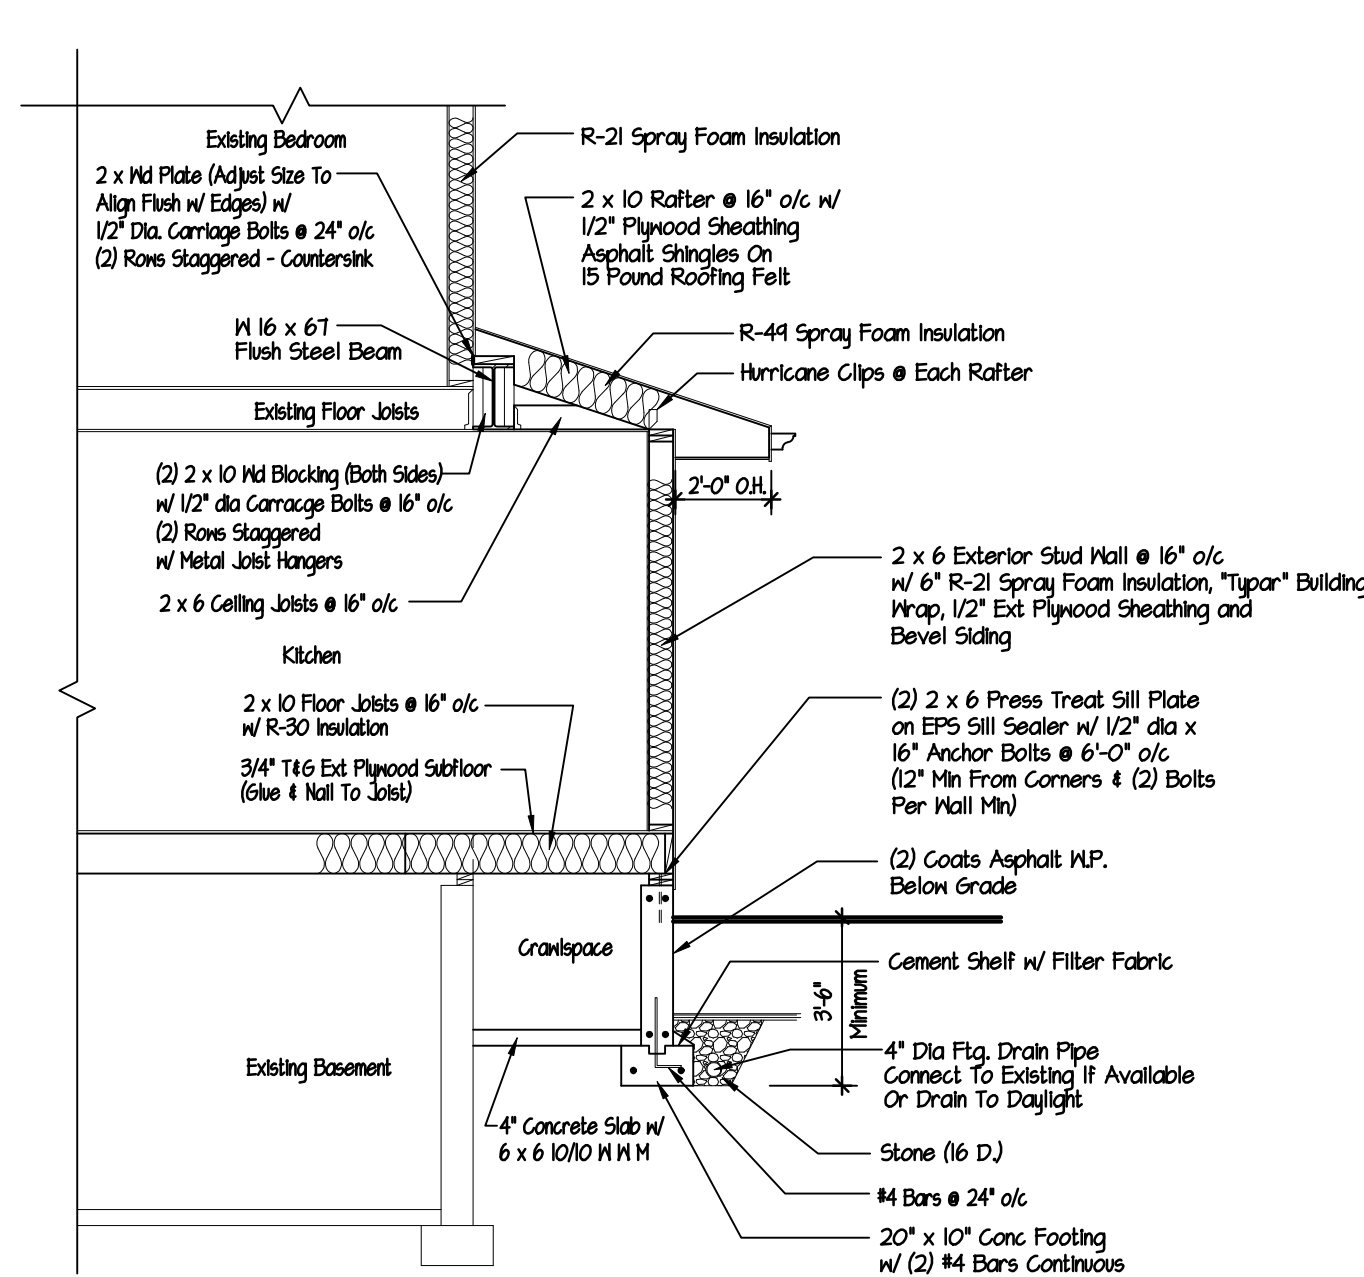

ALL FOOTINGS TO BEAR ON SOLID UNDISTURBED EARTH.

**Section B**  
Scale: 1/4" = 1'-0"

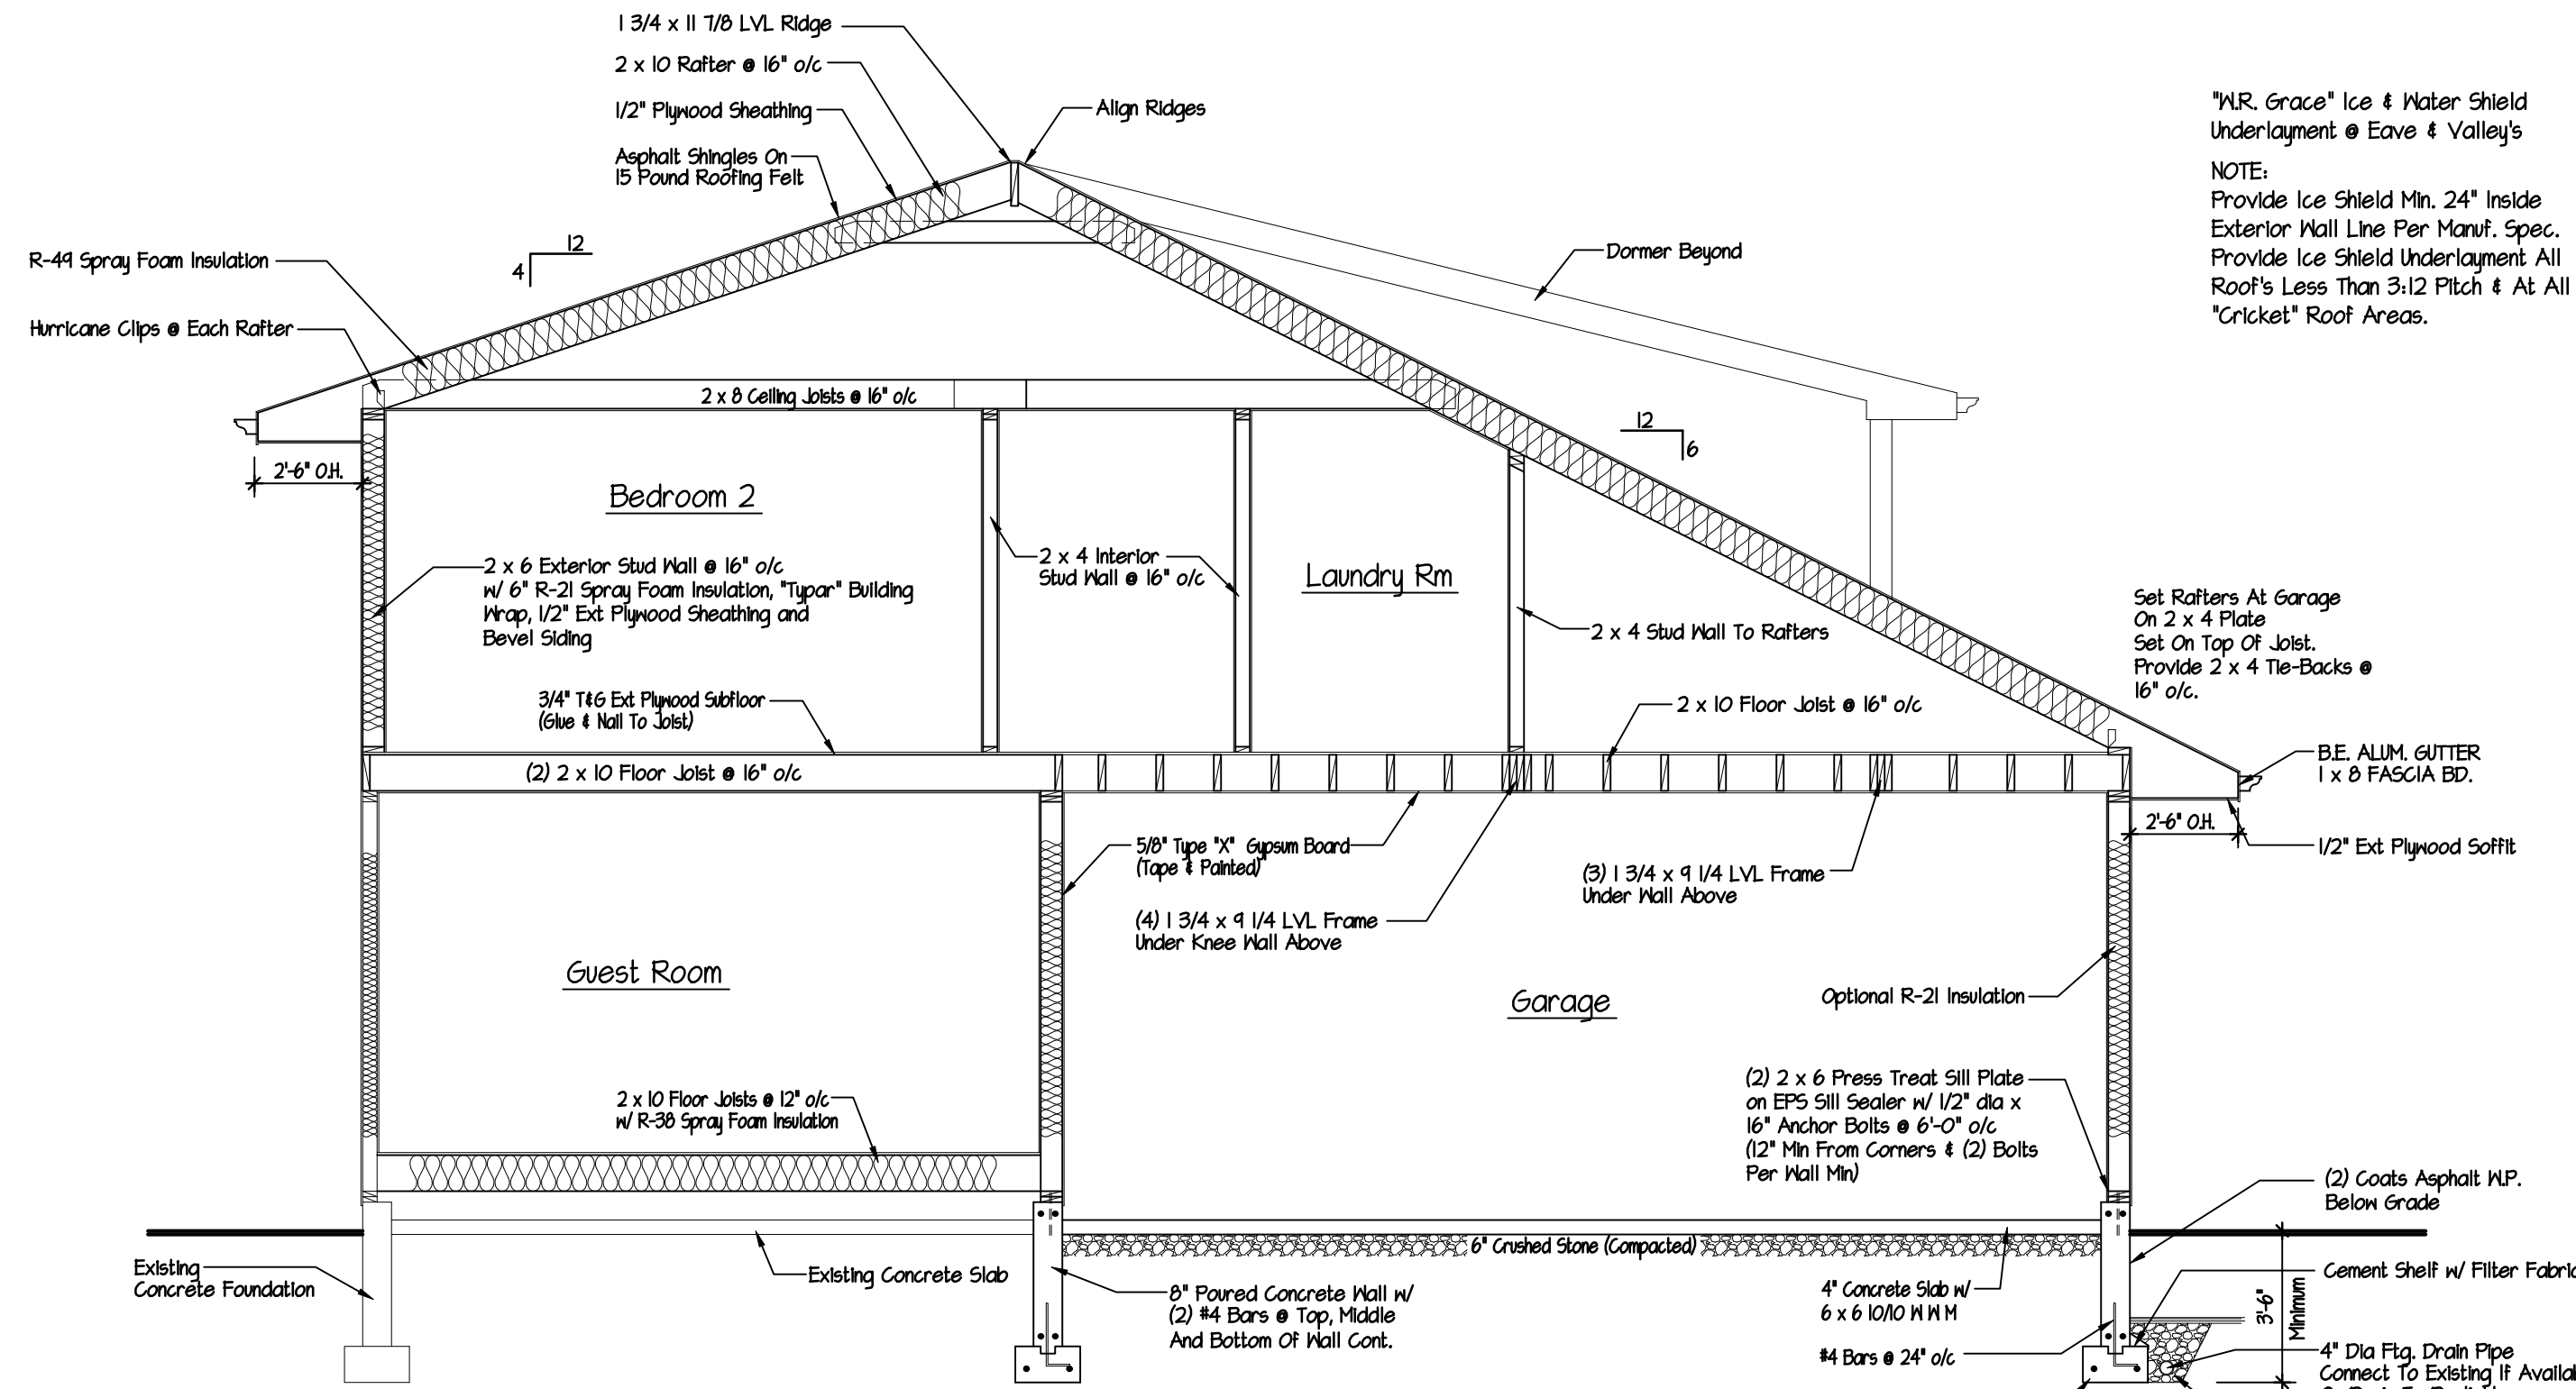


ALL FOOTINGS TO BEAR ON SOLID UNDISTURBED EARTH.

**Section A**  
Scale: 1/4" = 1'-0"


**Schedule For Proposed Building Material and Color Scheme**

	Name:	Type:	Color:
Siding:	Hardi-plank	Bevel	Snowbound
Windows:	Pella	Double Hung	Jogging Path
Trim:	Hardi-plank	Composite	Jogging Path
Front Door:		Wood	Mahogany
Roofing:		Asphalt Shingle Roof	Black
Garage Door:		Composite	Jogging Path

All Materials Shall Be As Specified Or Similar

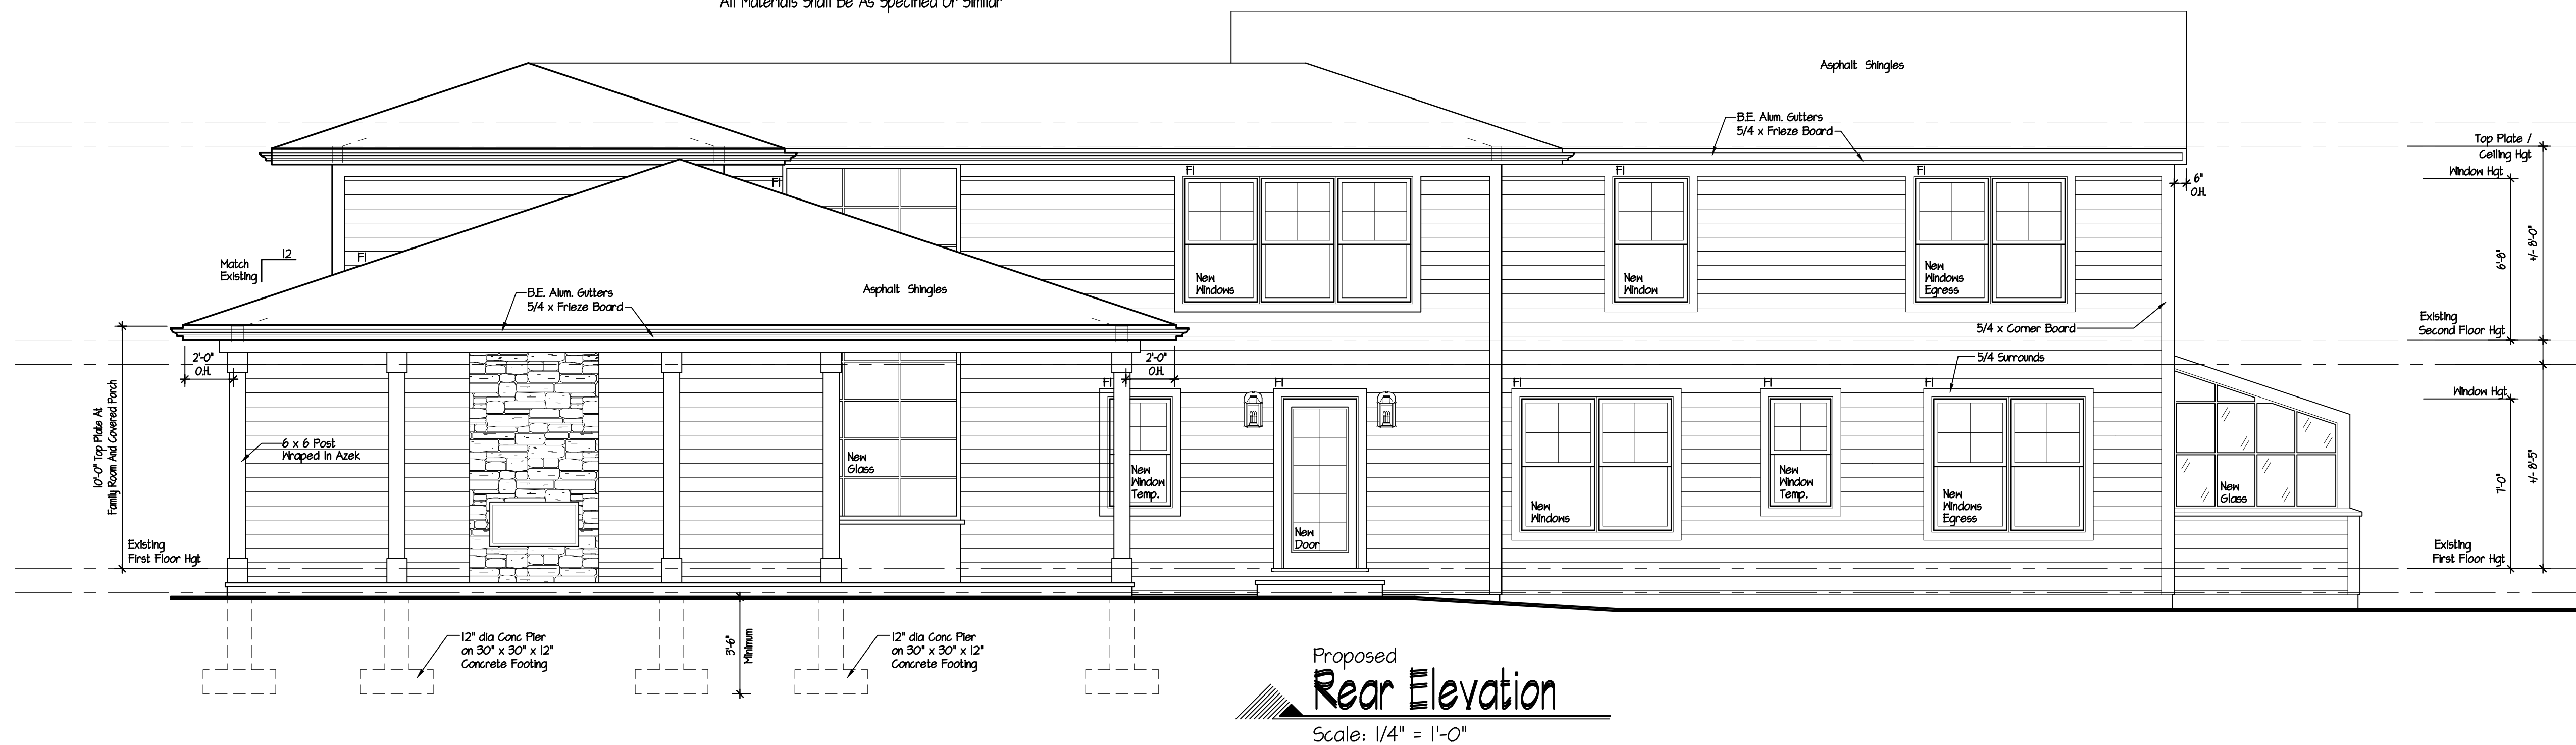

**Proposed Rear Elevation**  
Scale: 1/4" = 1'-0"

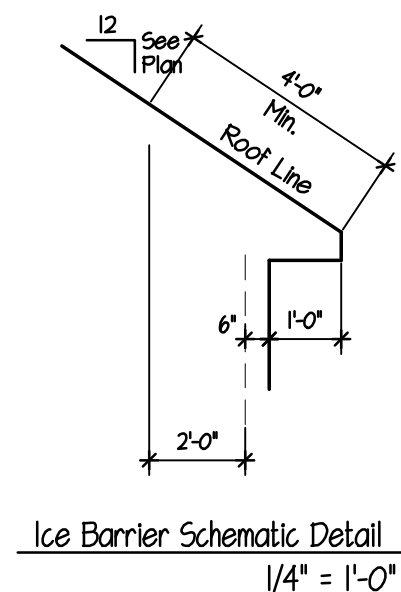

"MR. Grace" Ice & Water Shield Underlayment @ Eave & Valley's  
NOTE:  
Provide Ice Shield Min. 24" Inside Exterior Nail Line Per Manuf. Spec.  
Provide Ice Shield Underlayment All Roofs Less Than 3:12 Pitch & At All "Cricket" Roof Areas.

Addition For

231 Clinton Avenue  
Dobbs Ferry, NY

Revision Date  
Date Nov. 24, 2022  
Job No 222-118  
Drawing 3 OF 2

These plans are the property of the Architect. Any use or reproduction in whole or part without the written authorization of the Architect is prohibited. Any person or corporation who reproduces these plans without the written authorization of the Architect will be responsible to compensate the Architect.  
These plans are not valid for a building permit unless the Architect's professional seal and signature are present for the construction of one structure only by the person whose name appears on the plans.



**DeMasi Architects P.C.**




105 SMITH AVENUE, MOUNT KISCO, NEW YORK 10549

PHONE: (914) 666-3850

EMAIL: Lou@DemasiArchitects.com

Do Not Scale Prints



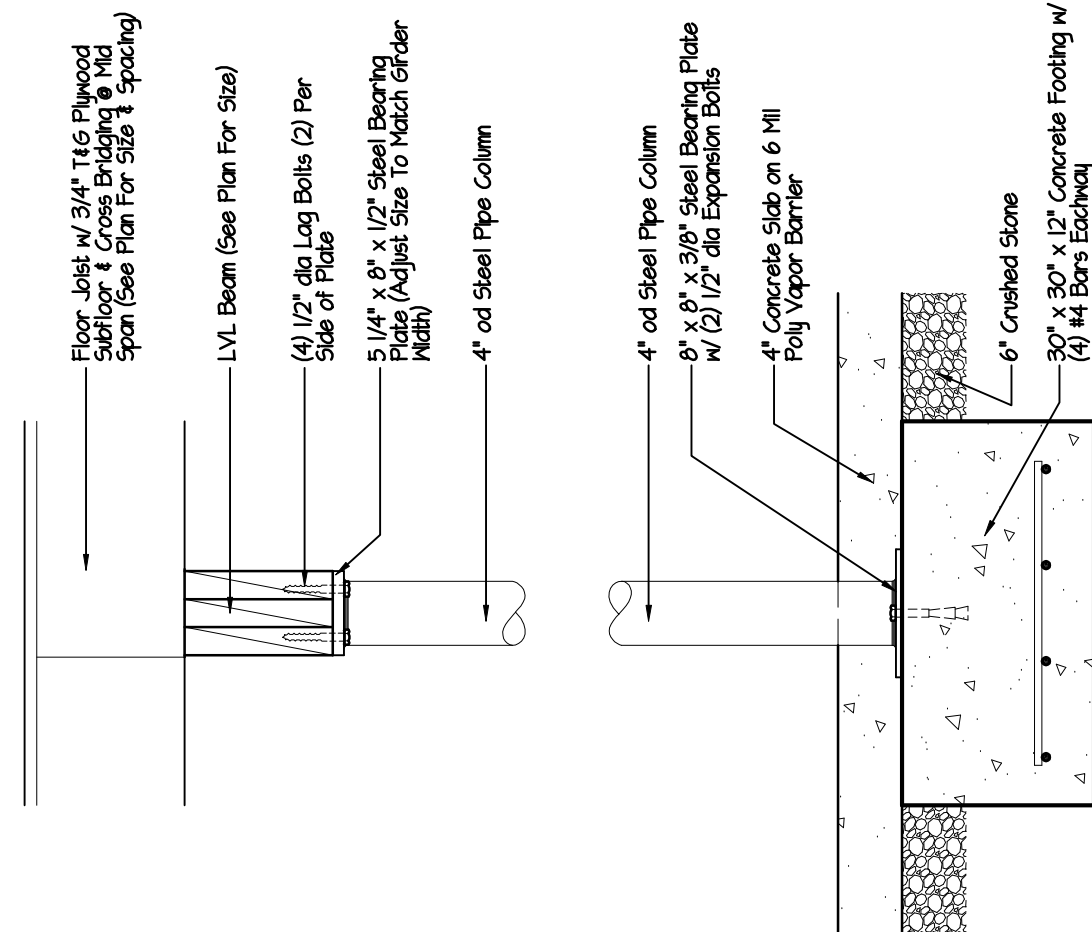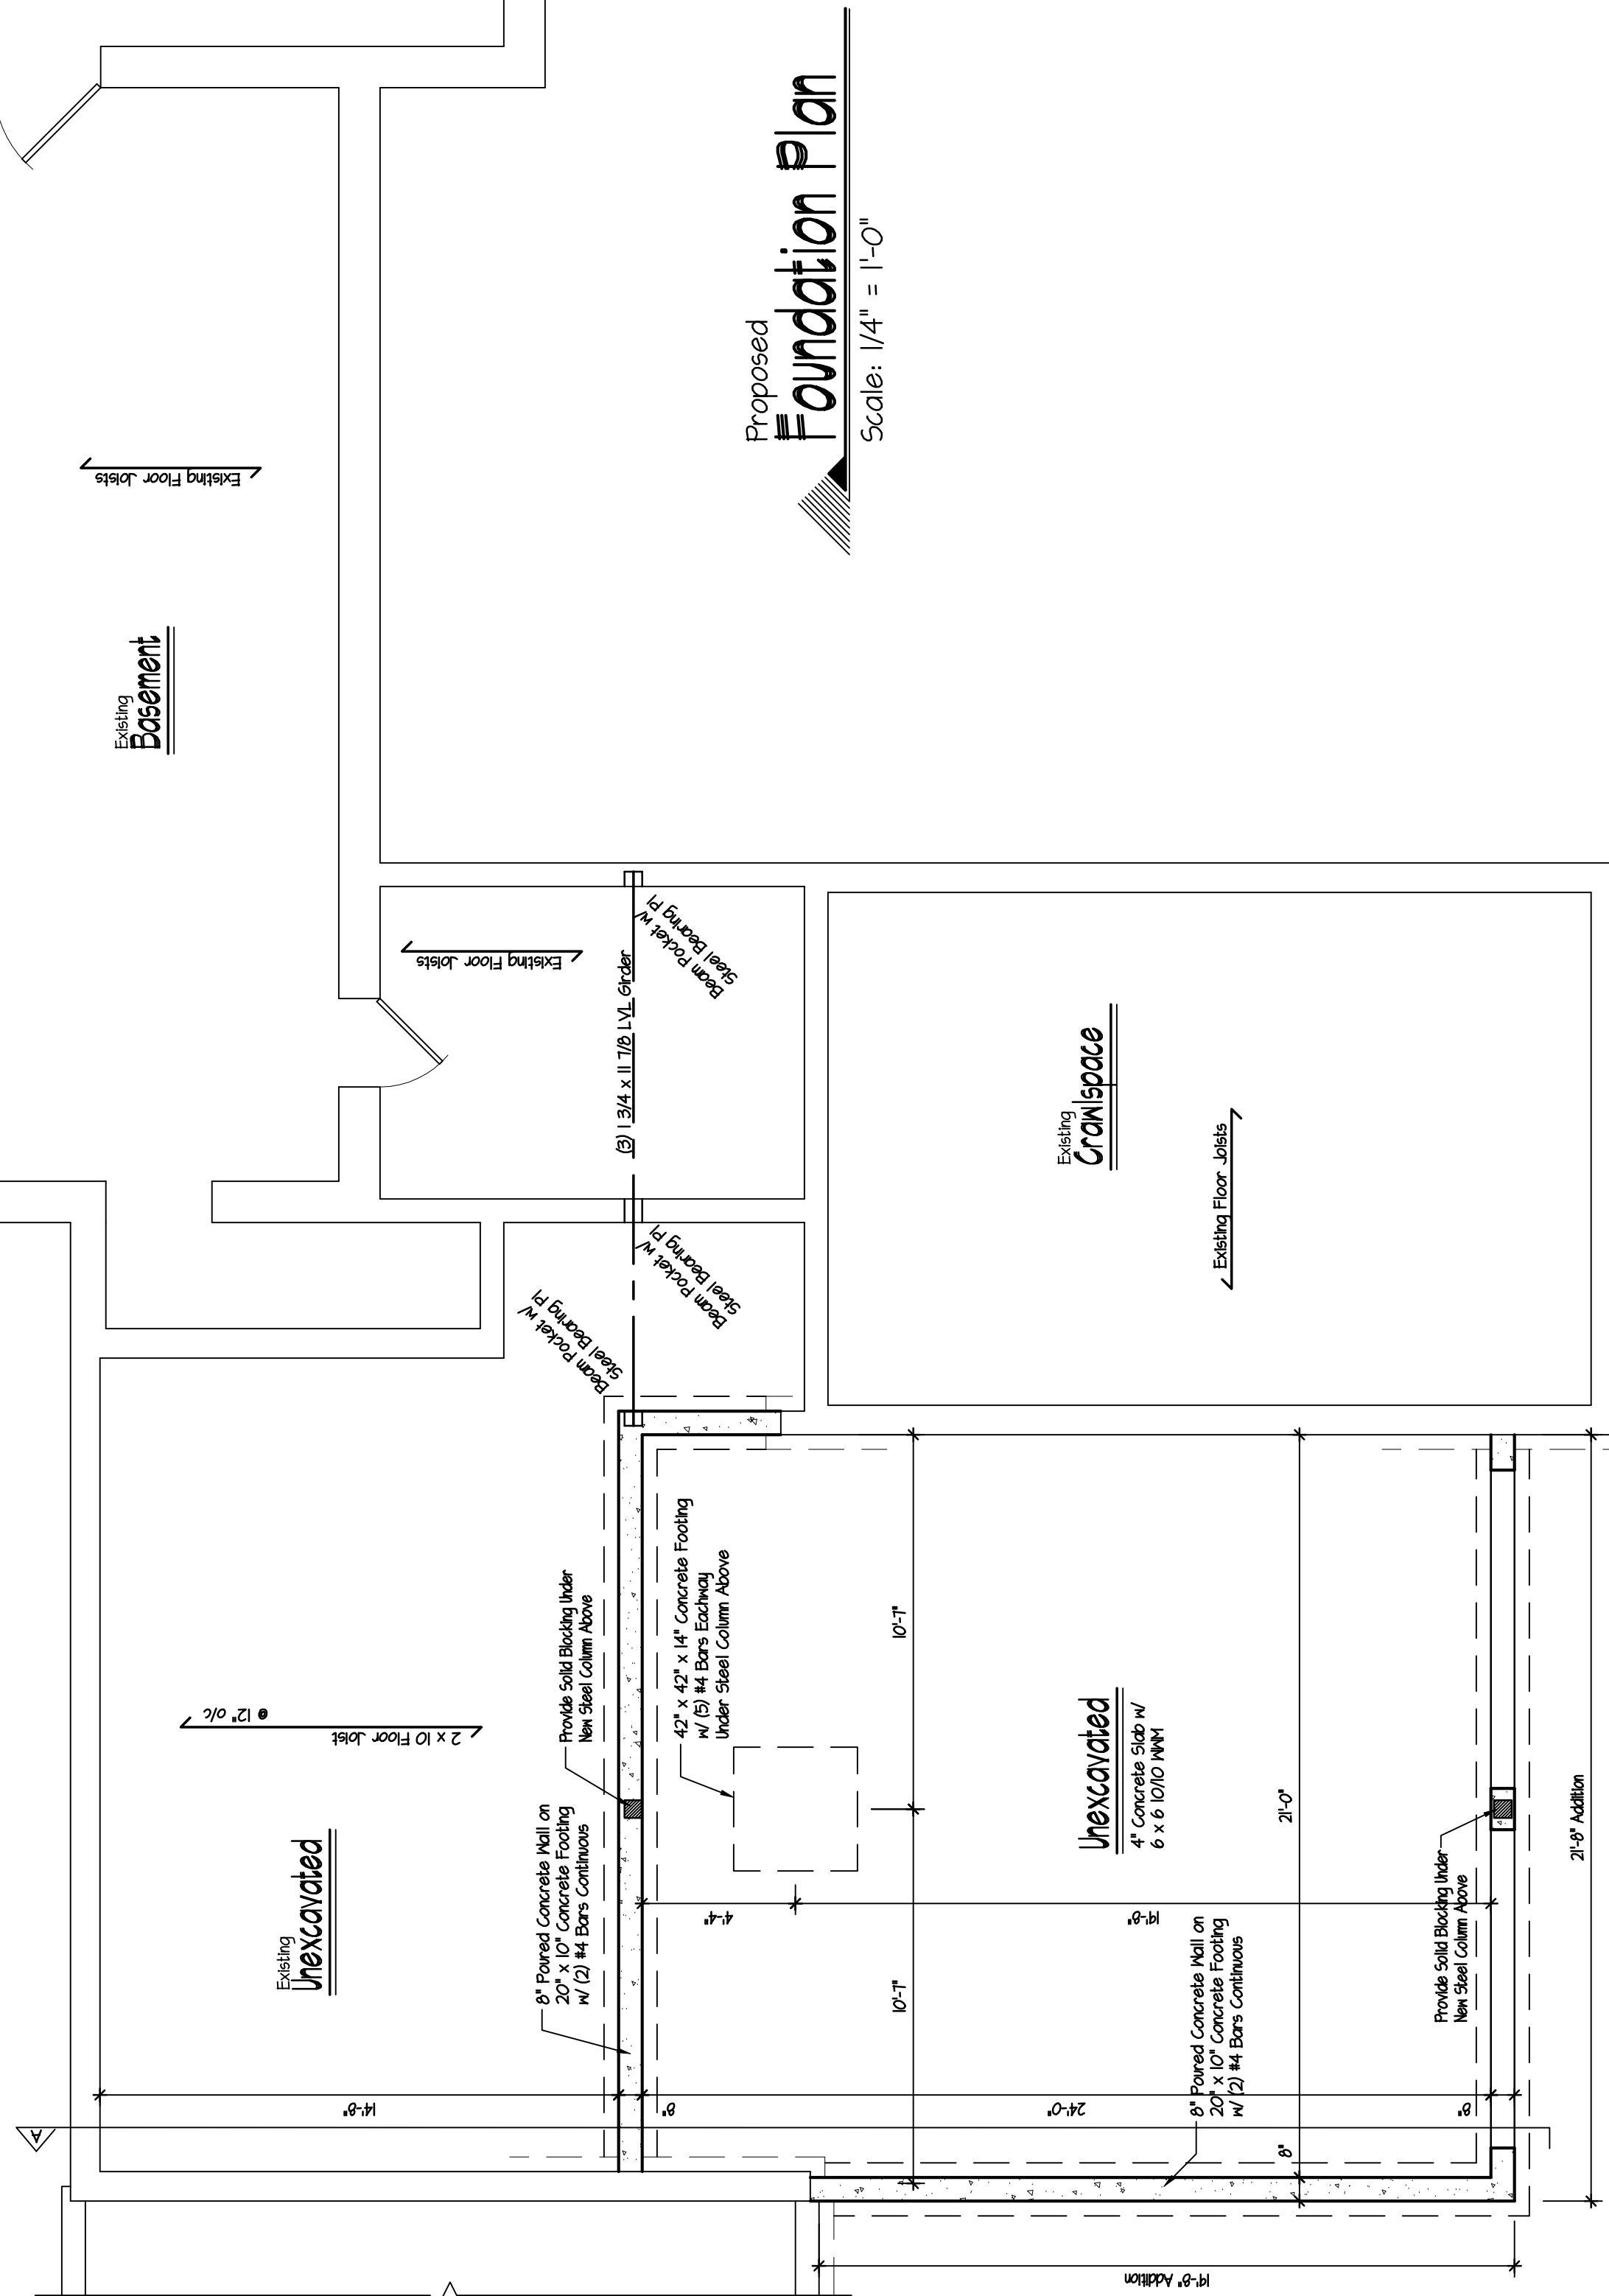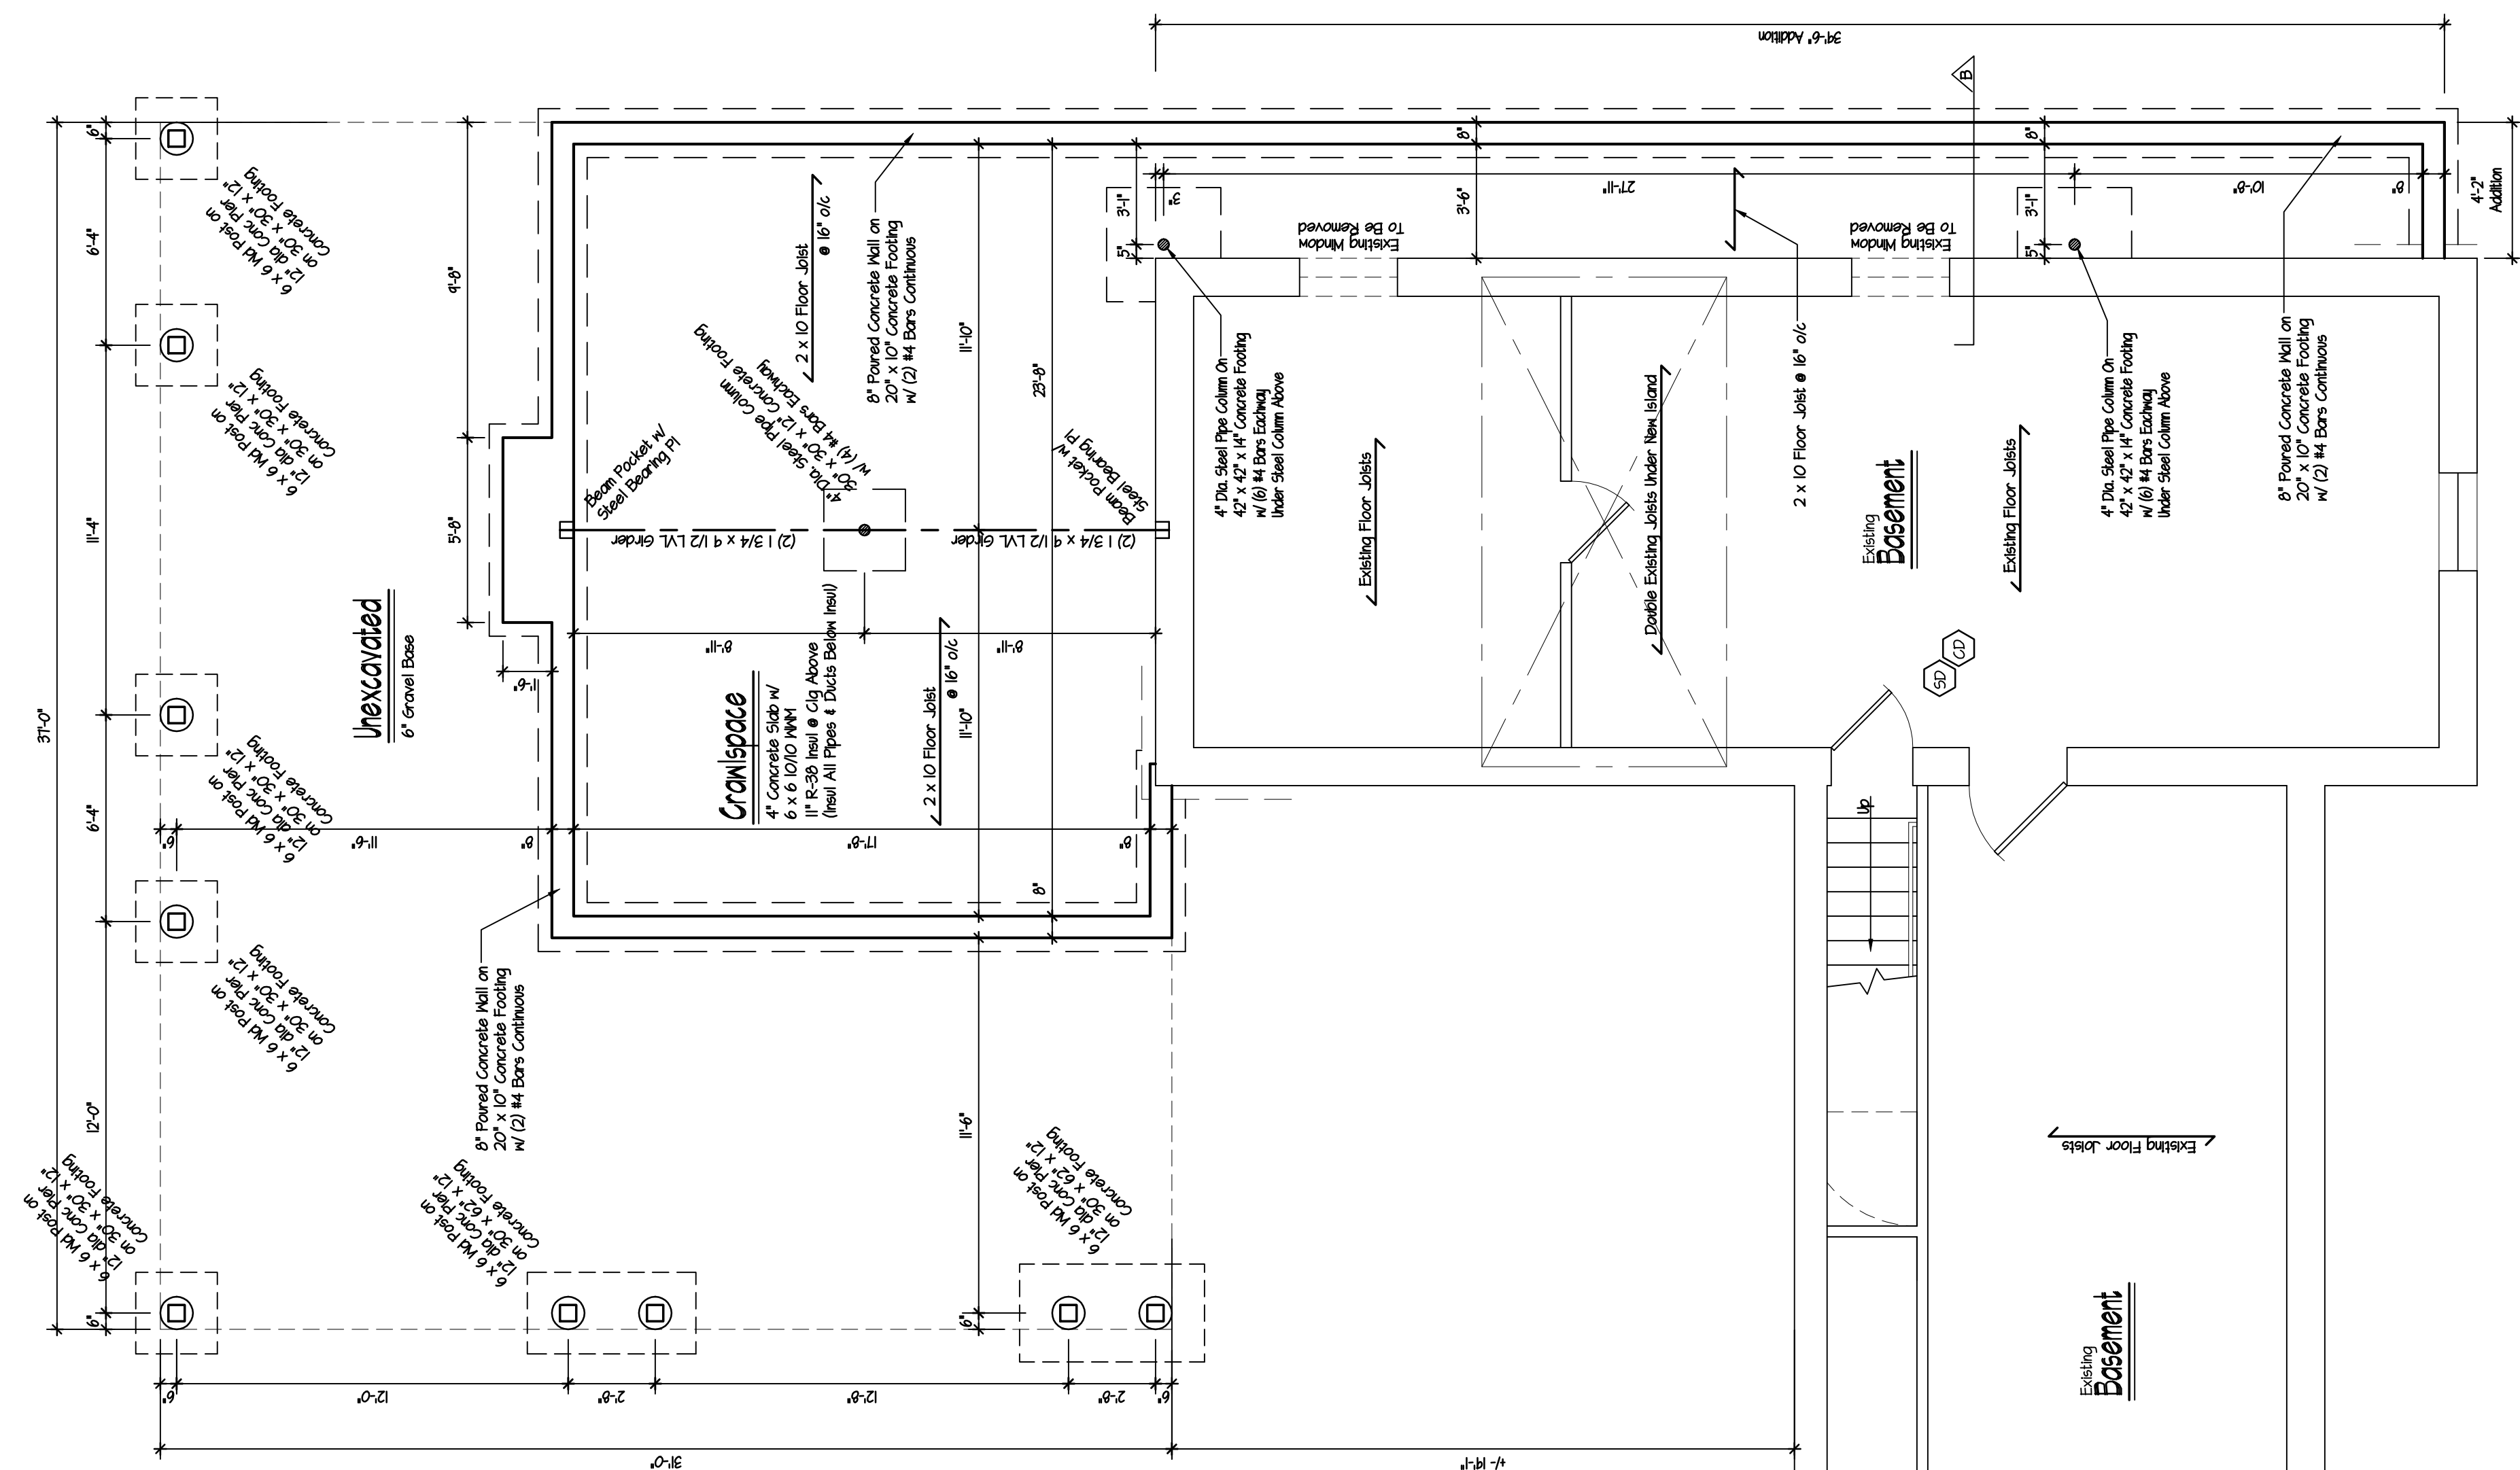

<b>Notes:</b>	<p>All Fixtures To Be 2' Below Solid Unobstructed Floor</p> <p>All Fixtures Minimum 6" # 2 Douglas Fir - Larch Or Better</p> <p>Double Frame Under All Partitions Parallel To Framing</p> <p>Double All Box, Josh. All Ceiling Type Windows</p> <p>If The Floor Is To Be MD Job, Consult Architect For Additional Framing Required</p>										
<b>Legend:</b>	<p>2 x Wood Post Match Existing 4' x 6' Wood Scribe Detector</p> <p>Cathode Anodic Rod w Battery Back-Up</p> <p>Existing Wall To Remove</p> <p>New Concrete</p>										
<b>Wood Header Schedule</b>	<table> <tr> <th>Span</th><th>Header Size</th></tr> <tr> <td>Up to 4'-0"</td><td>(1) 2 x 4 Wet</td></tr> <tr> <td>Up to 6'-0"</td><td>(2) 2 x 6 Wet</td></tr> <tr> <td>Up to 8'-0"</td><td>(3) 2 x 6 Wet</td></tr> <tr> <td>Up to 10'-0"</td><td>(4) 2 x 8 Wet</td></tr> </table> <p>Notes:</p> <p>Header Otherwise Noted On Plans</p>	Span	Header Size	Up to 4'-0"	(1) 2 x 4 Wet	Up to 6'-0"	(2) 2 x 6 Wet	Up to 8'-0"	(3) 2 x 6 Wet	Up to 10'-0"	(4) 2 x 8 Wet
Span	Header Size										
Up to 4'-0"	(1) 2 x 4 Wet										
Up to 6'-0"	(2) 2 x 6 Wet										
Up to 8'-0"	(3) 2 x 6 Wet										
Up to 10'-0"	(4) 2 x 8 Wet										

### Addition For

231 Clinton Avenue  
Dobbs Ferry, NY

These plans are the property of the Architect. Any use or reproduction in whole or part without the written authorization of the Architect is prohibited. Any person or corporation using these plans without proper authorization will be responsible to compensate the Architect.

These plans are not valid for a building permit unless originally signed and sealed by the Architect and are for the construction of one structure only by the person whose name appears on the plans.




DeMasi Architects P.C.

105 SMITH AVENUE, MOUNT KISCO, NEW YORK 10549

PHONE: (914) 666-3858

EMAIL: [Lou@DemasiArchitects.com](mailto:Lou@DemasiArchitects.com)



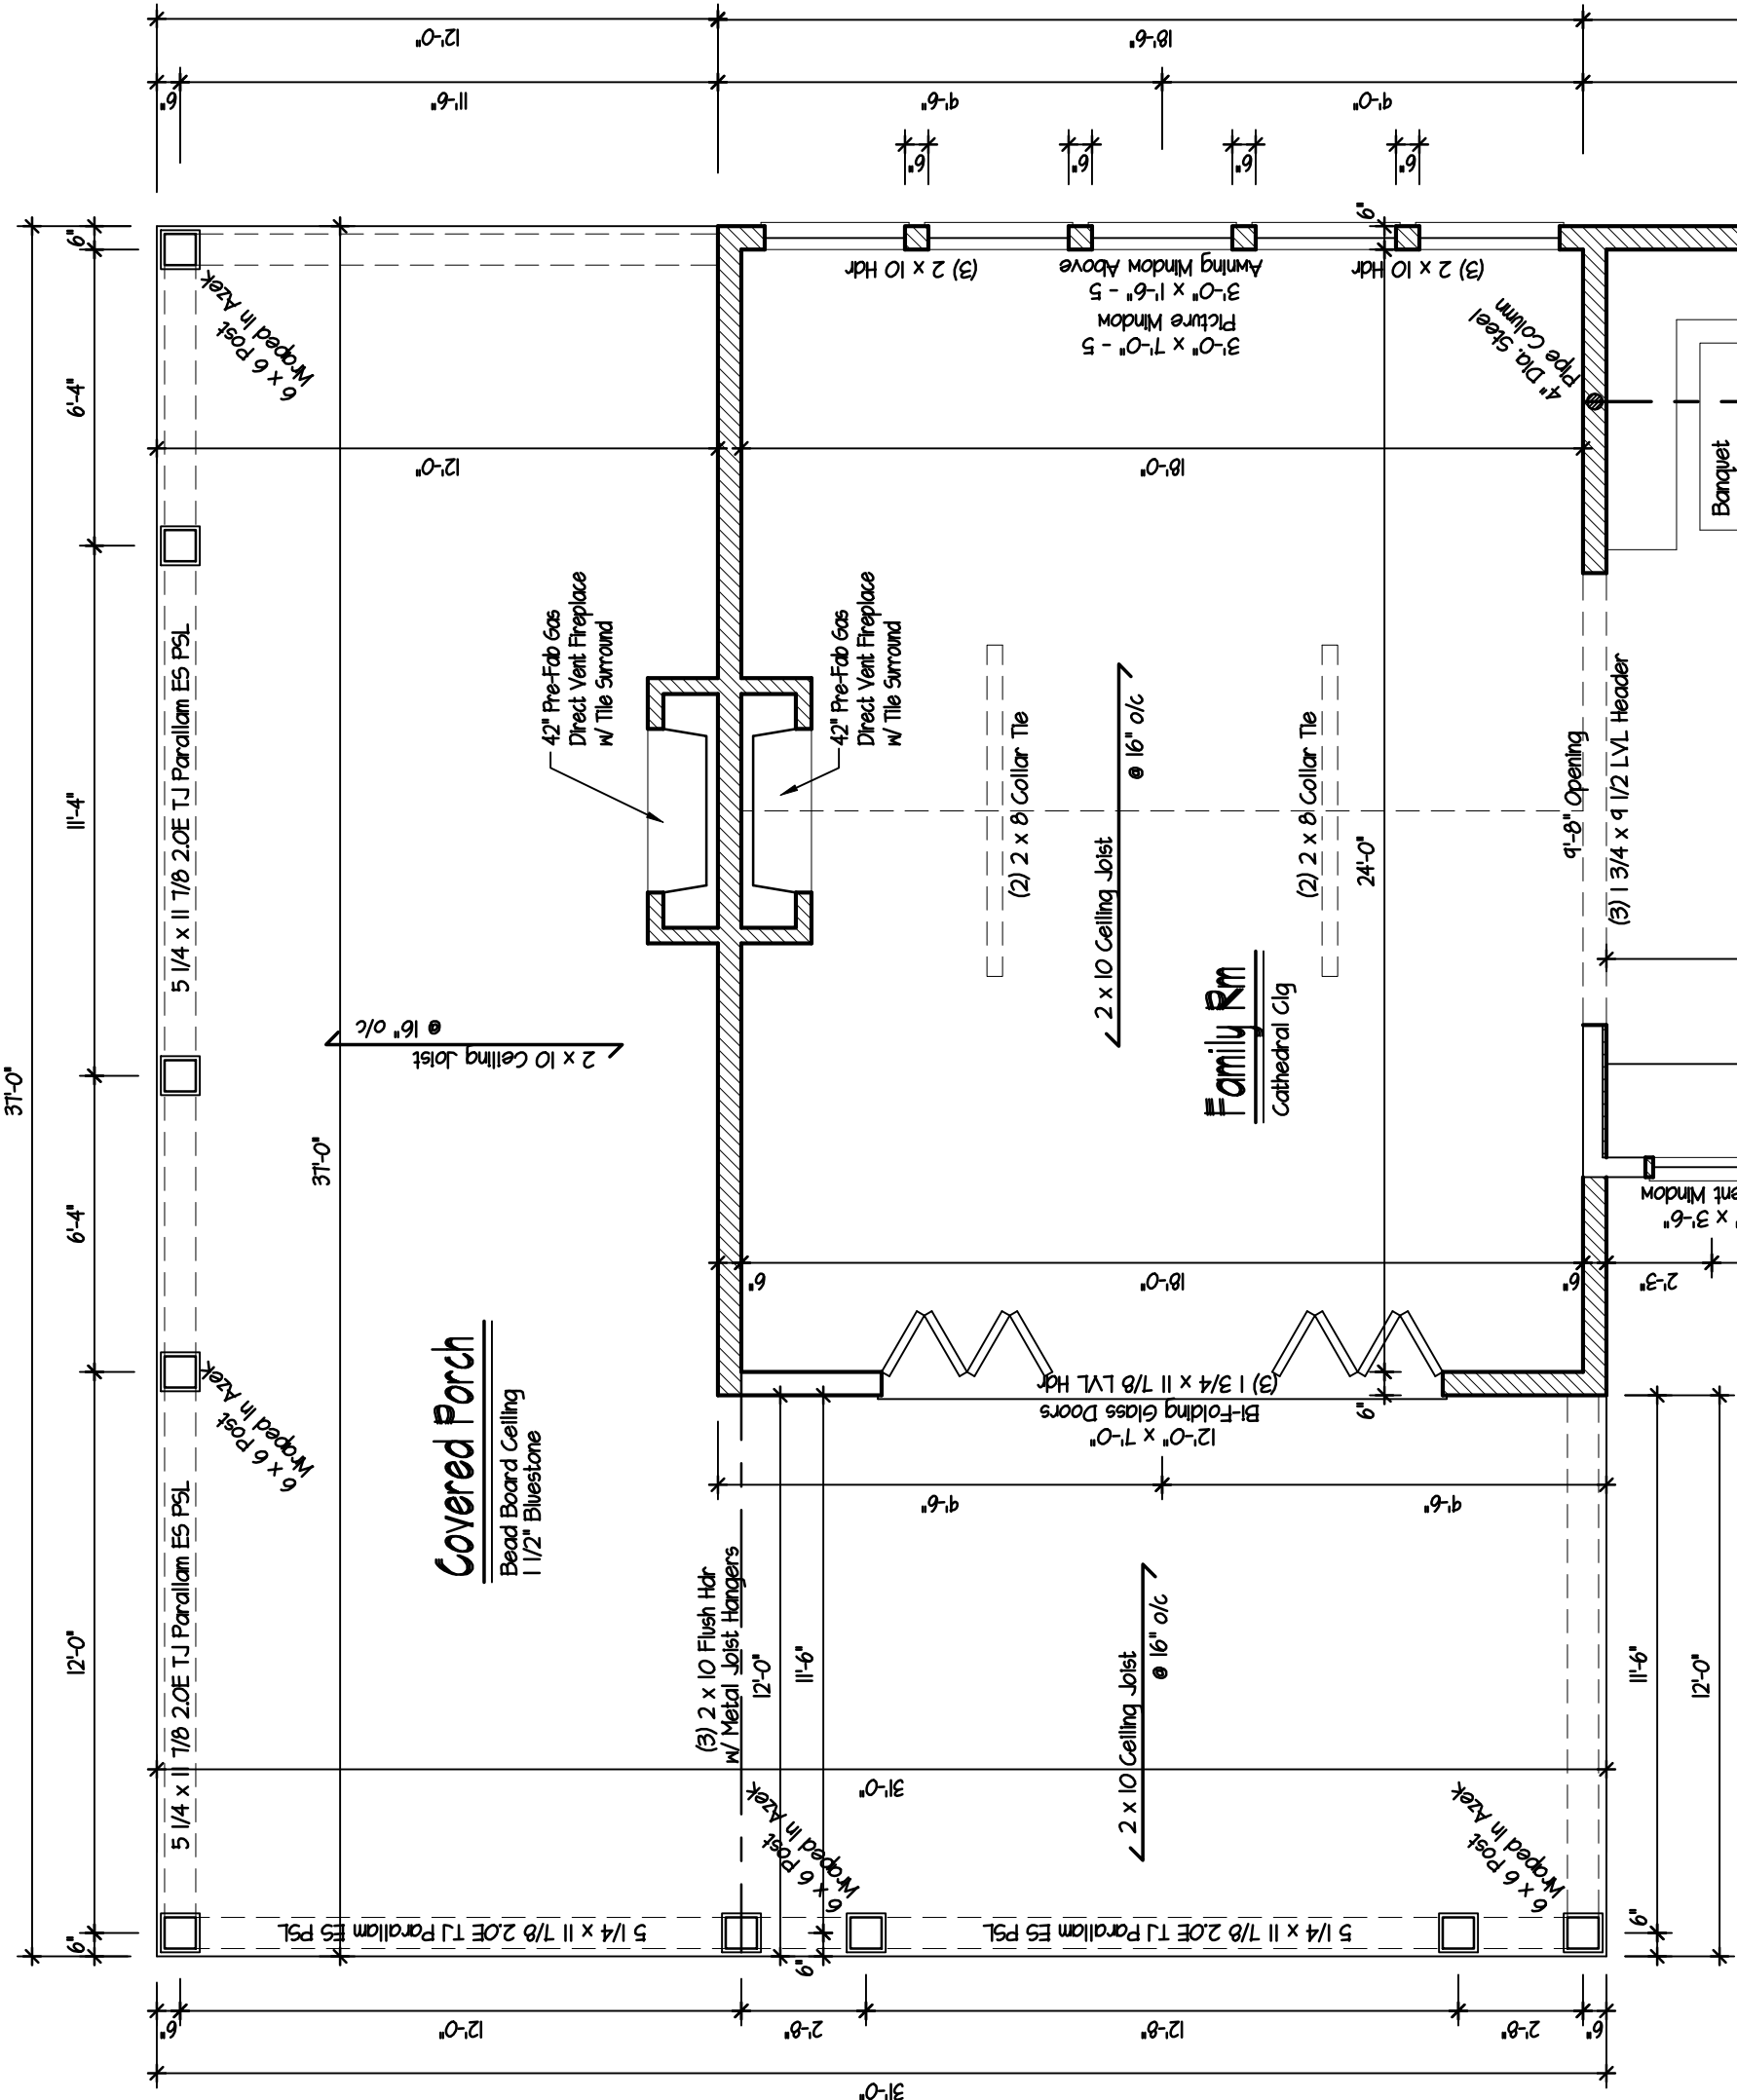

Covered Porch


Board Board Ceiling  
1/2" Blue Stone

Family Rm

Cathedral Clg


## Steel Beam Detail @ Garage

Scale: 1 1/2" = 1'-0"

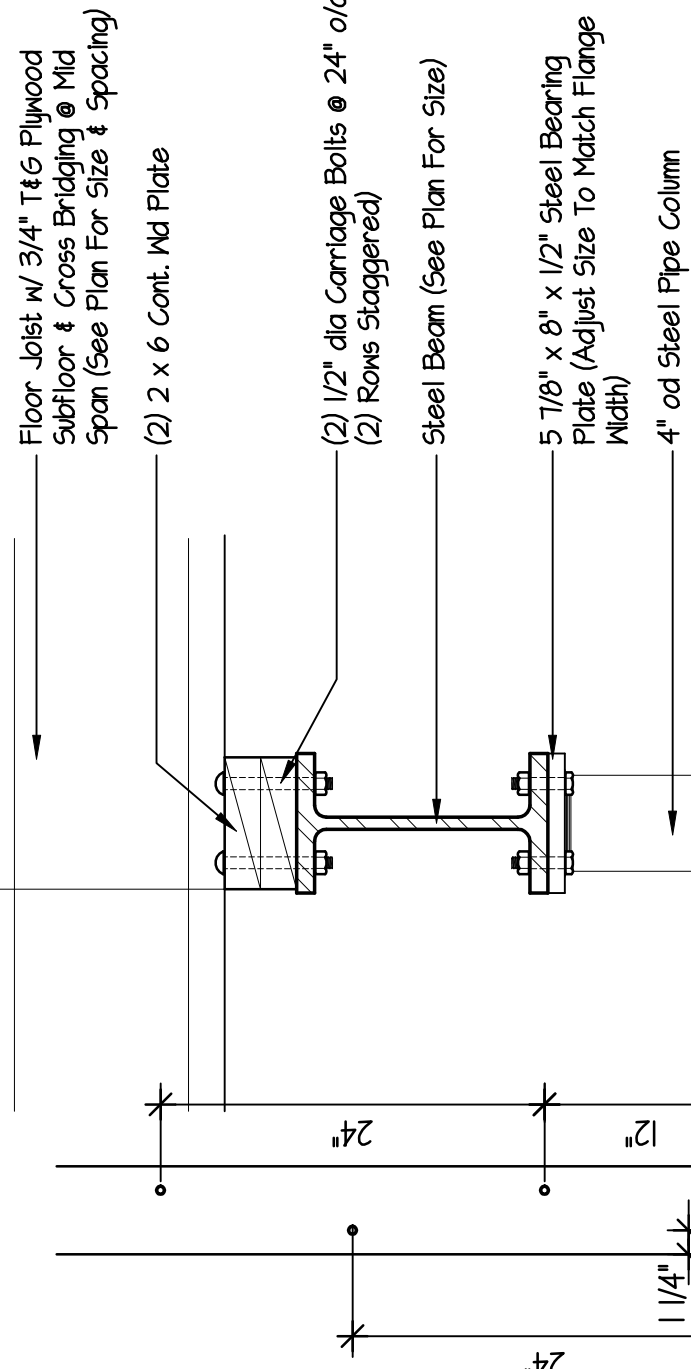

Bolt Pattern

Scale: None

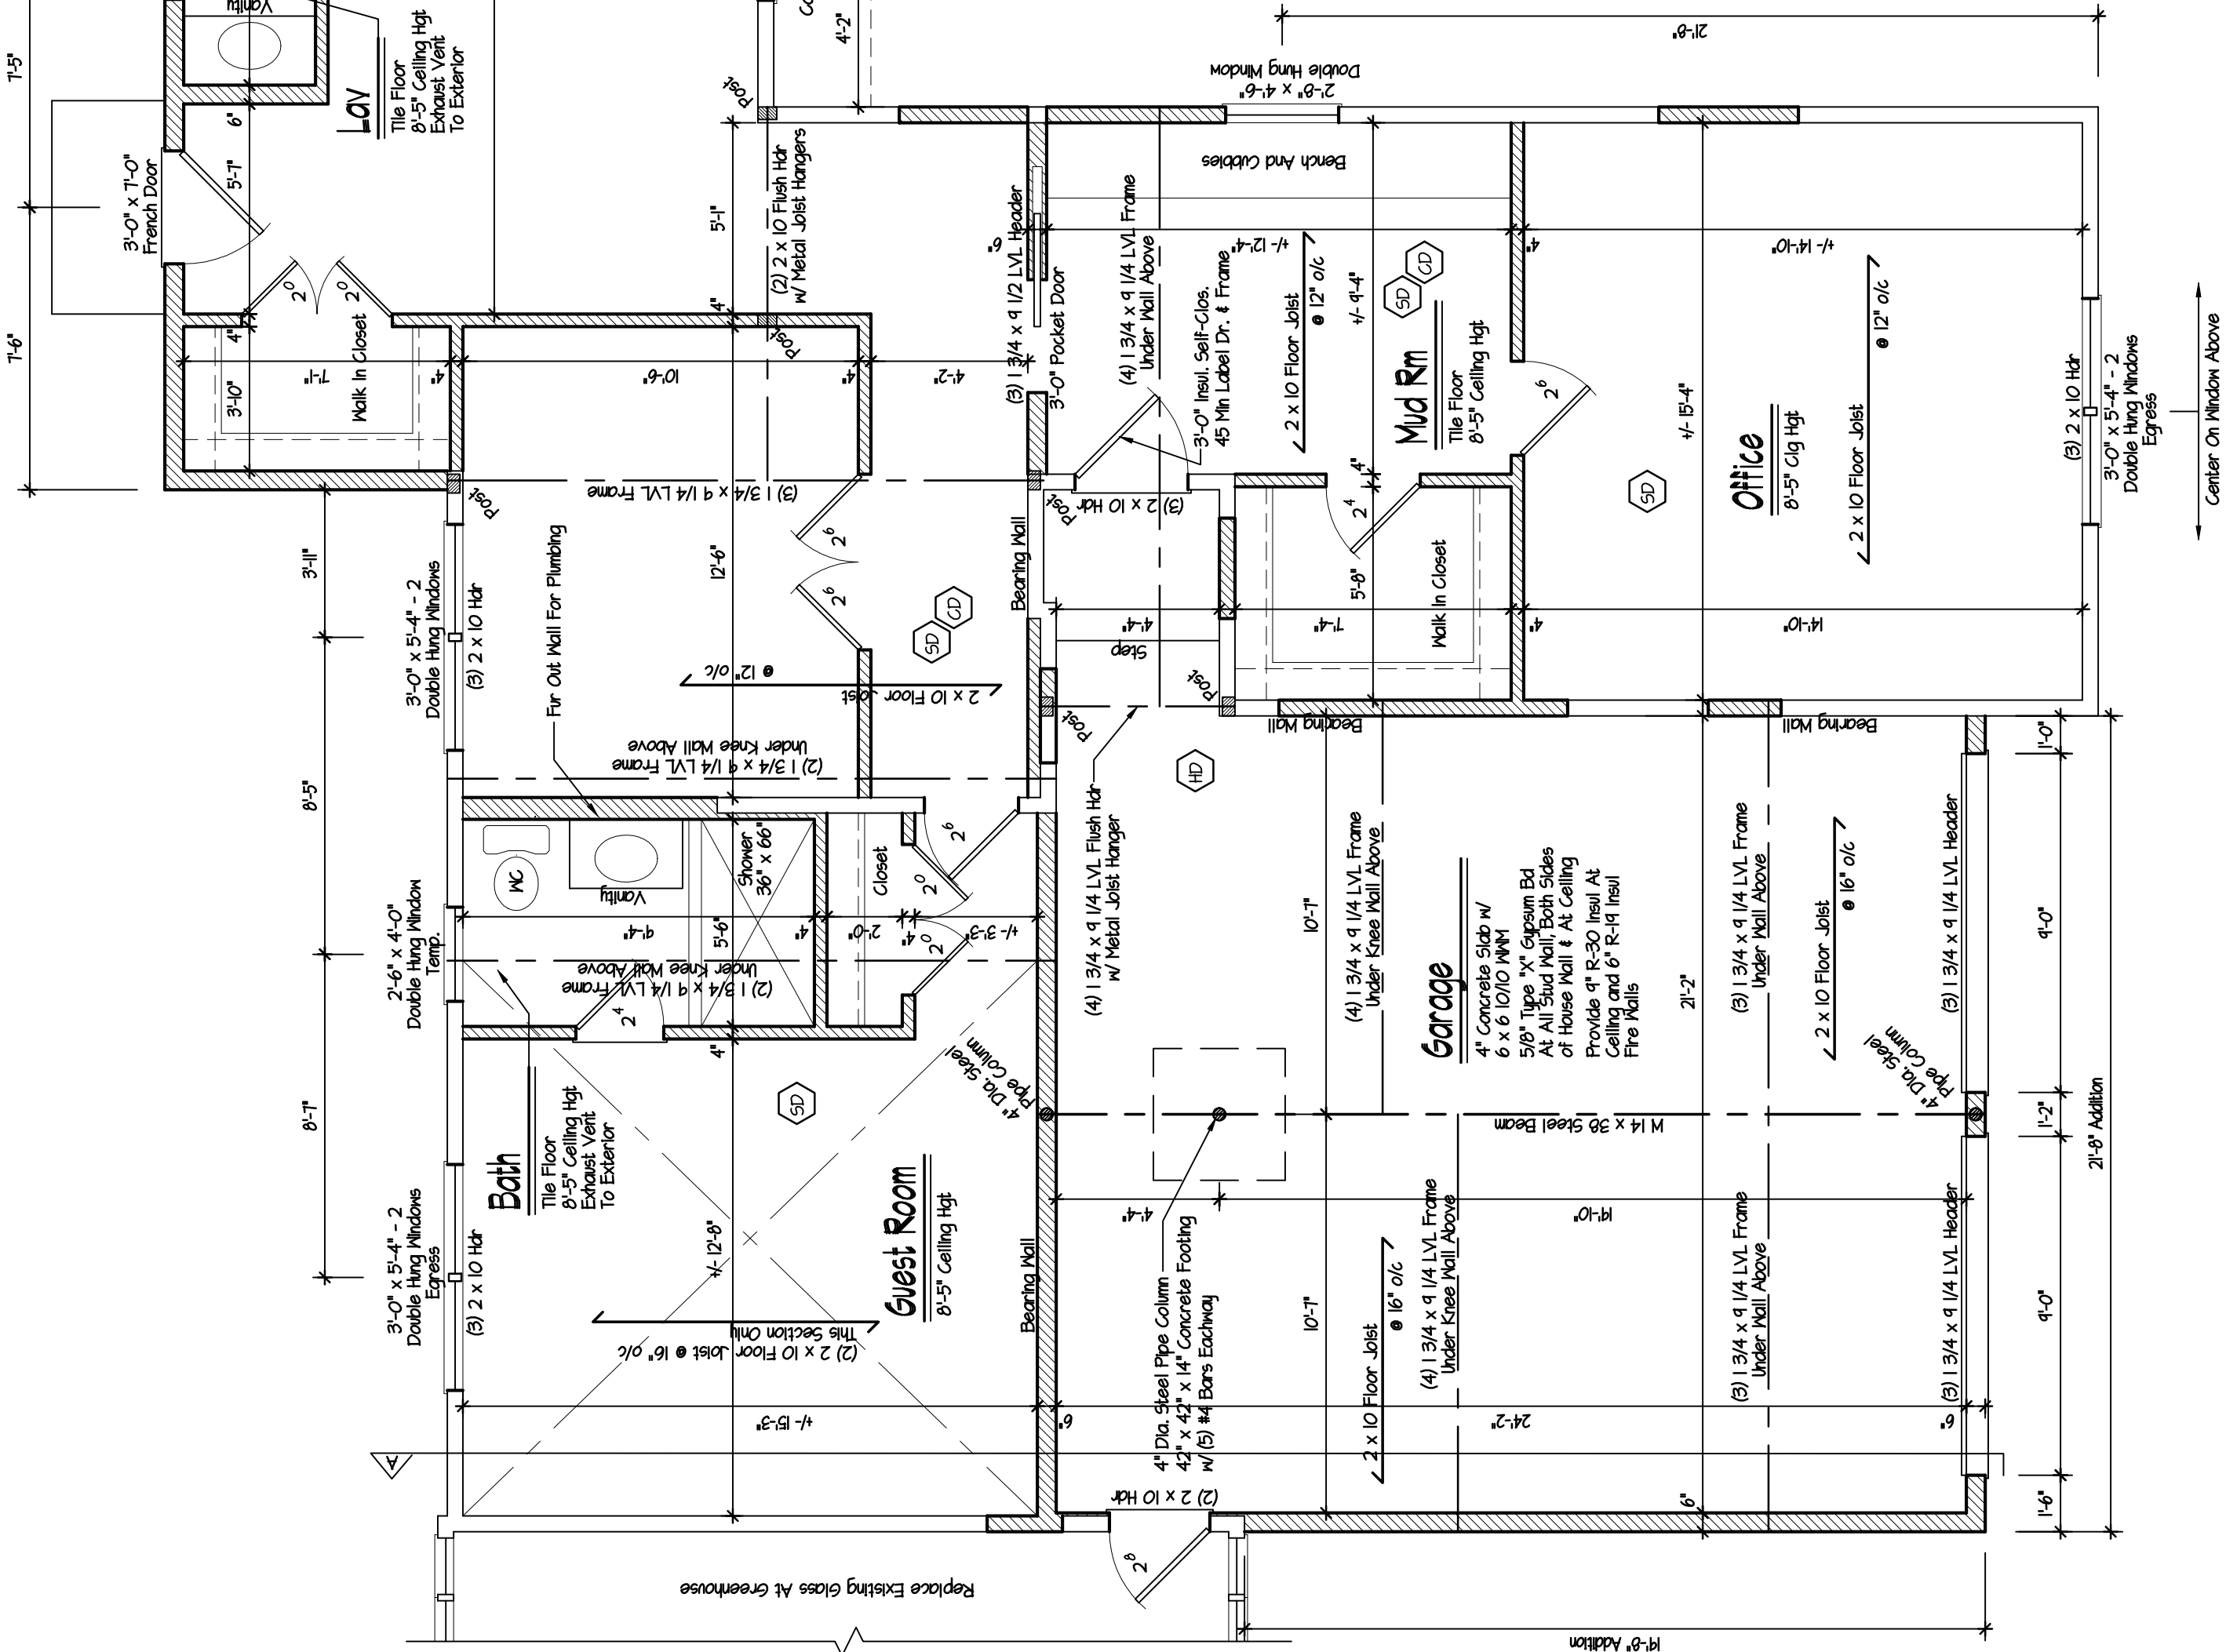

Proposed First Floor Plan

Scale: 1/4" = 1'-0"

**Notes:**

All Framing Members To Be # 2  
Double End Studs  
Parallel To Framing  
If The Floor Is To Be MID Job  
Consult Architect For Additional  
Framing Required

**Legend:**

2 x Wood Post (Match  
Beam Width or As Noted)  
Smoke Detector  
w/ Battery Back-Up  
Carbon Monoxide Det  
w/ Battery Back-Up  
Heat Detector  
w/ Battery Back-Up  
Existing Wall  
(To Remove)  
New Wall

**Wood Header Schedule**

Span	Header Size
Up To 3'-0"	(2) 2 x 8 1st
Up To 4'-0"	(2) 2 x 10 1st
Up To 6'-0"	(2) 2 x 10 1st

Note:  
Unless Otherwise Noted On Plans

### Window Note:

- All Glazing To Be Low E Insulated Glazes  
w/ Minimum U-Factor Of 0.27 And SHGC Of 0.4
- All Windows Within 18" Of Floor To Have  
Tempered Glazes (Double Hangs-Bottom  
Sash Only, All Others Full Unit).
- All Glazing In Doors & Windows Enclosing  
Hot Tiles, Whirlpool Tiles, Saunas, Steam  
Rooms, Bathtubs and Showers Within 60"  
Of Window or Door Unit Shall Have  
Tempered Glazes.
- All Express Windows To Have A Minimum  
Clear Opening Area Of 5.71 Sq Total w/  
24" min Clear Opening Height & 20" min  
Clear Width. Refer To Manufacturers  
Specifications For All Other Information.
- All Windows or Doors Marked w/ "T" Shall  
To Have Full Unit Tempered.
- All Windows Sills Within 24" Above The  
Finished Floor & Greater Than 12" Above  
Finished Grade Or Other Surface.  
Requires Fall Protection.  
See Section R902.2 For More Info.

Addition For

231 Clinton Avenue  
Dobbs Ferry, NY

Revision  
Date  
Job No

Drawing  
OF

These plans are the property of the Architect. Any use or reproduction in whole or part without the written authorization of the Architect is prohibited. Any person or corporation who uses these plans for any purpose other than that intended by the Architect shall be liable to the Architect for the construction of one structure only by the person whose name appears on the plans.



DeMasi Architects P.C.



105 SMITH AVENUE, MOUNT KISCO, NEW YORK 10549

PHONE: (914) 666-3850

EMAIL: Love@DemasiArchitects.com


Do Not Scale Prints



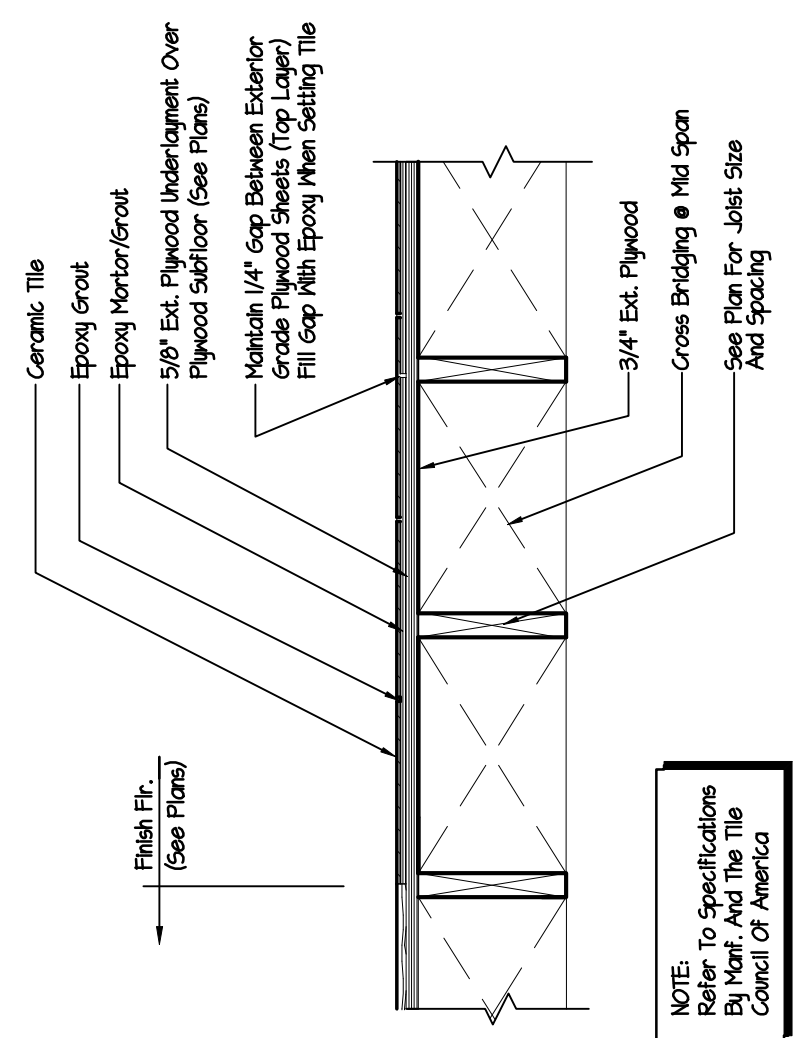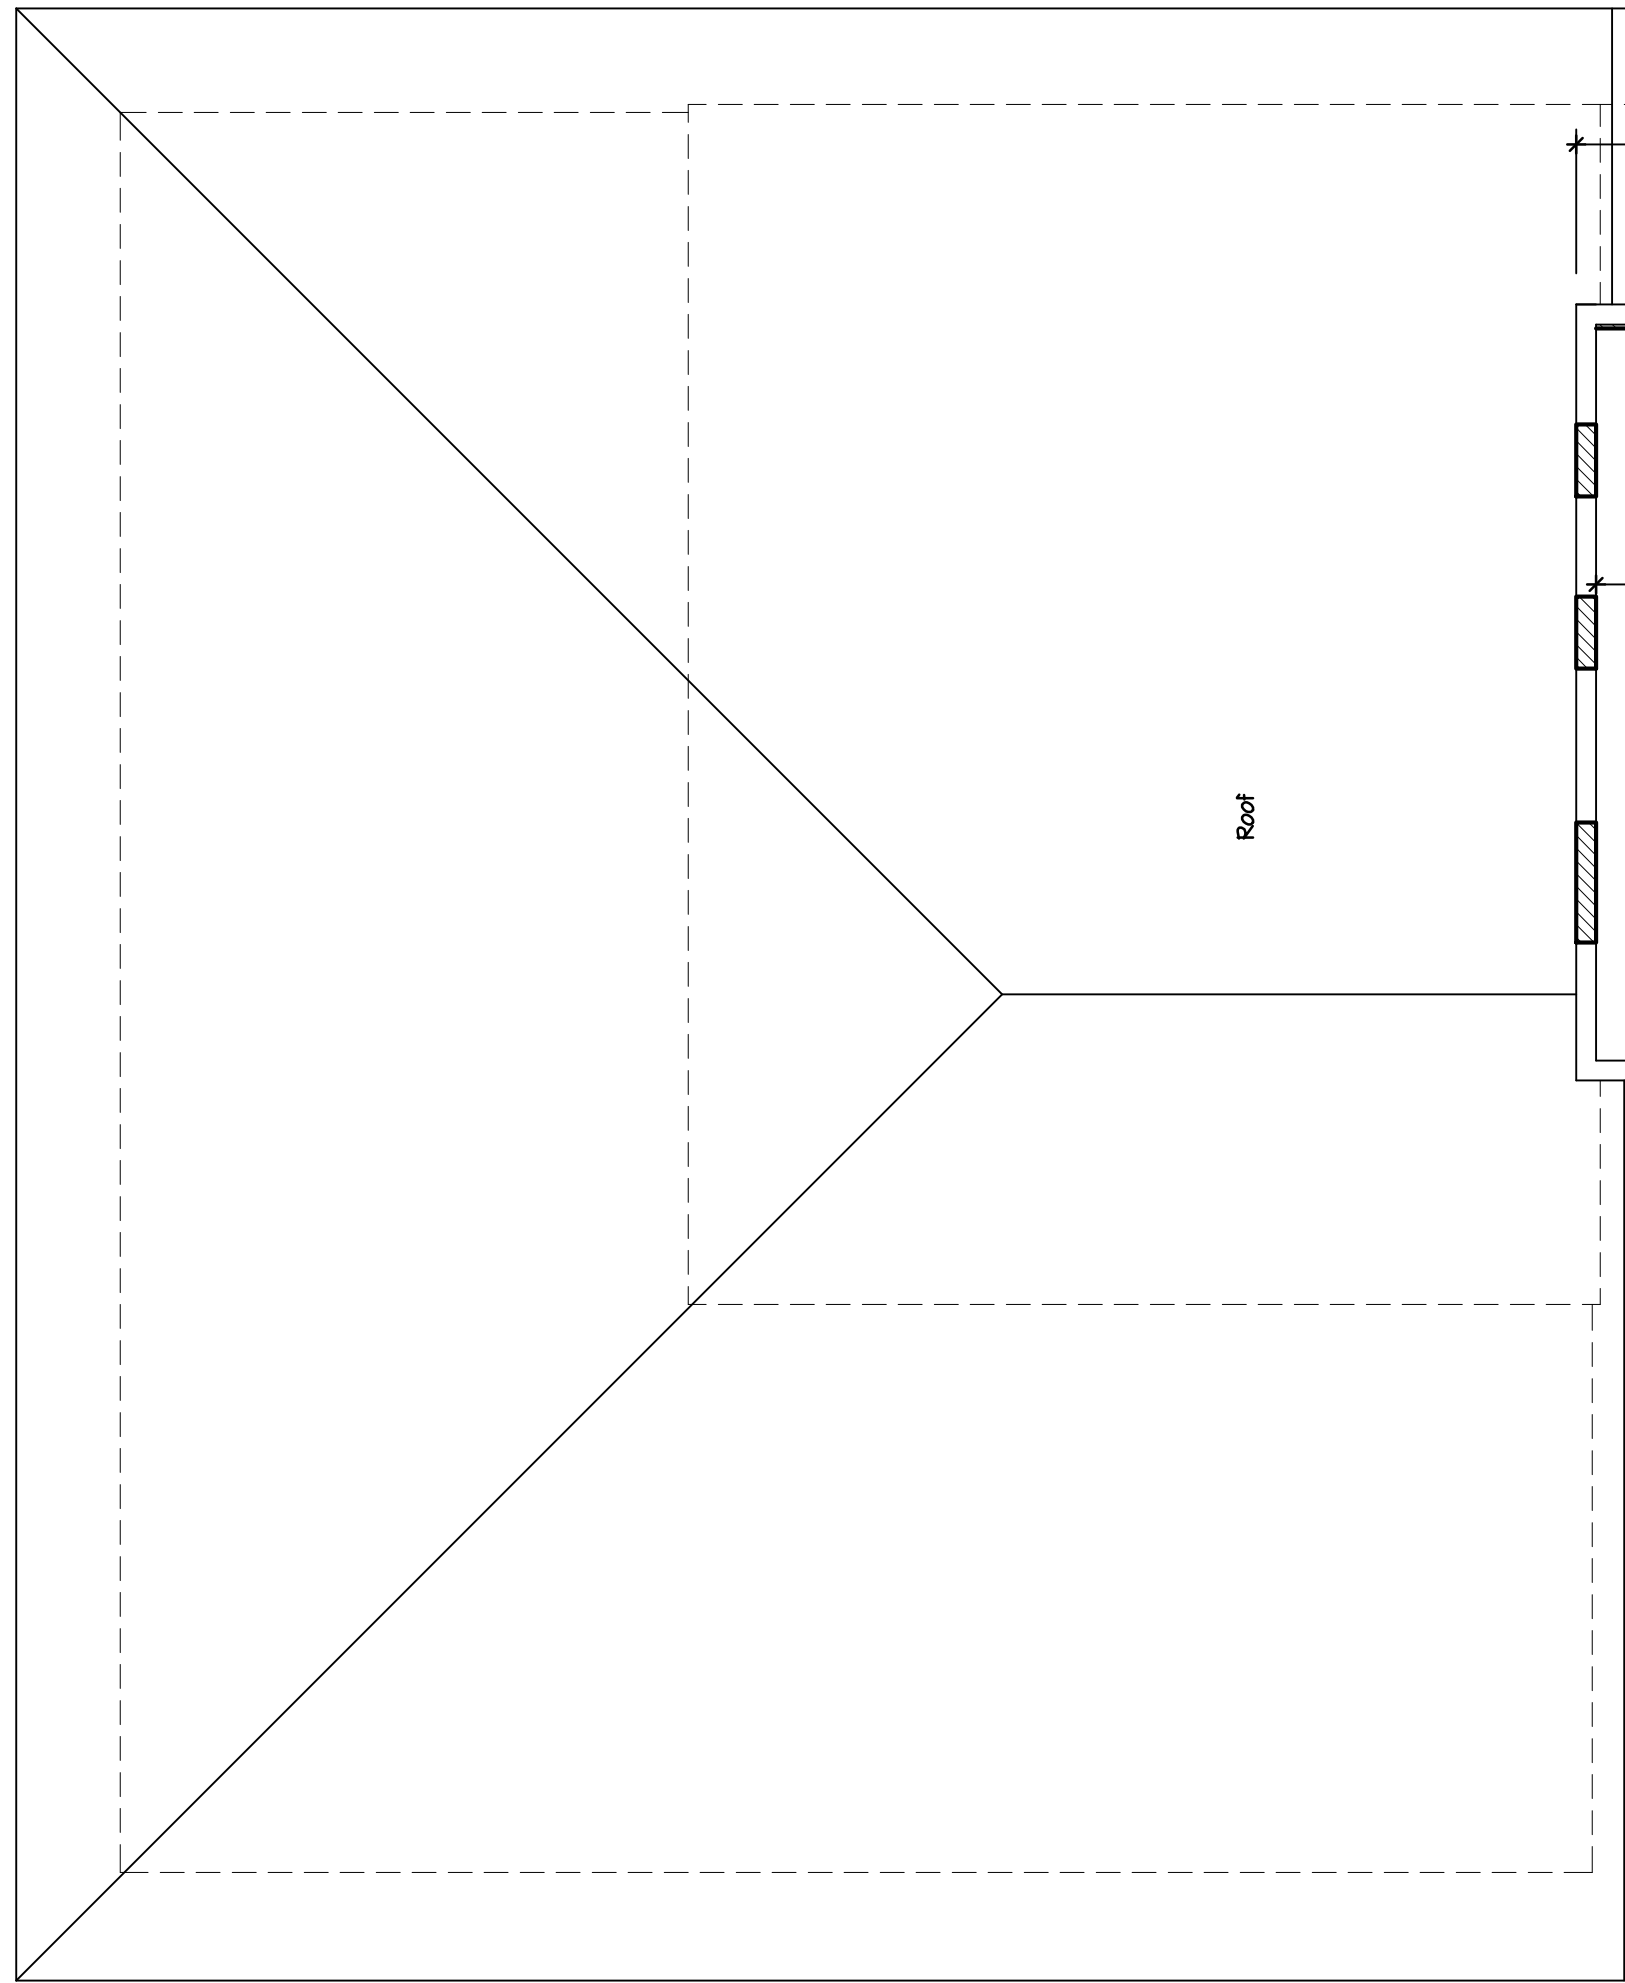

Tile Floor Detail (Thin Set)

Scale: 1" = 1'-0"

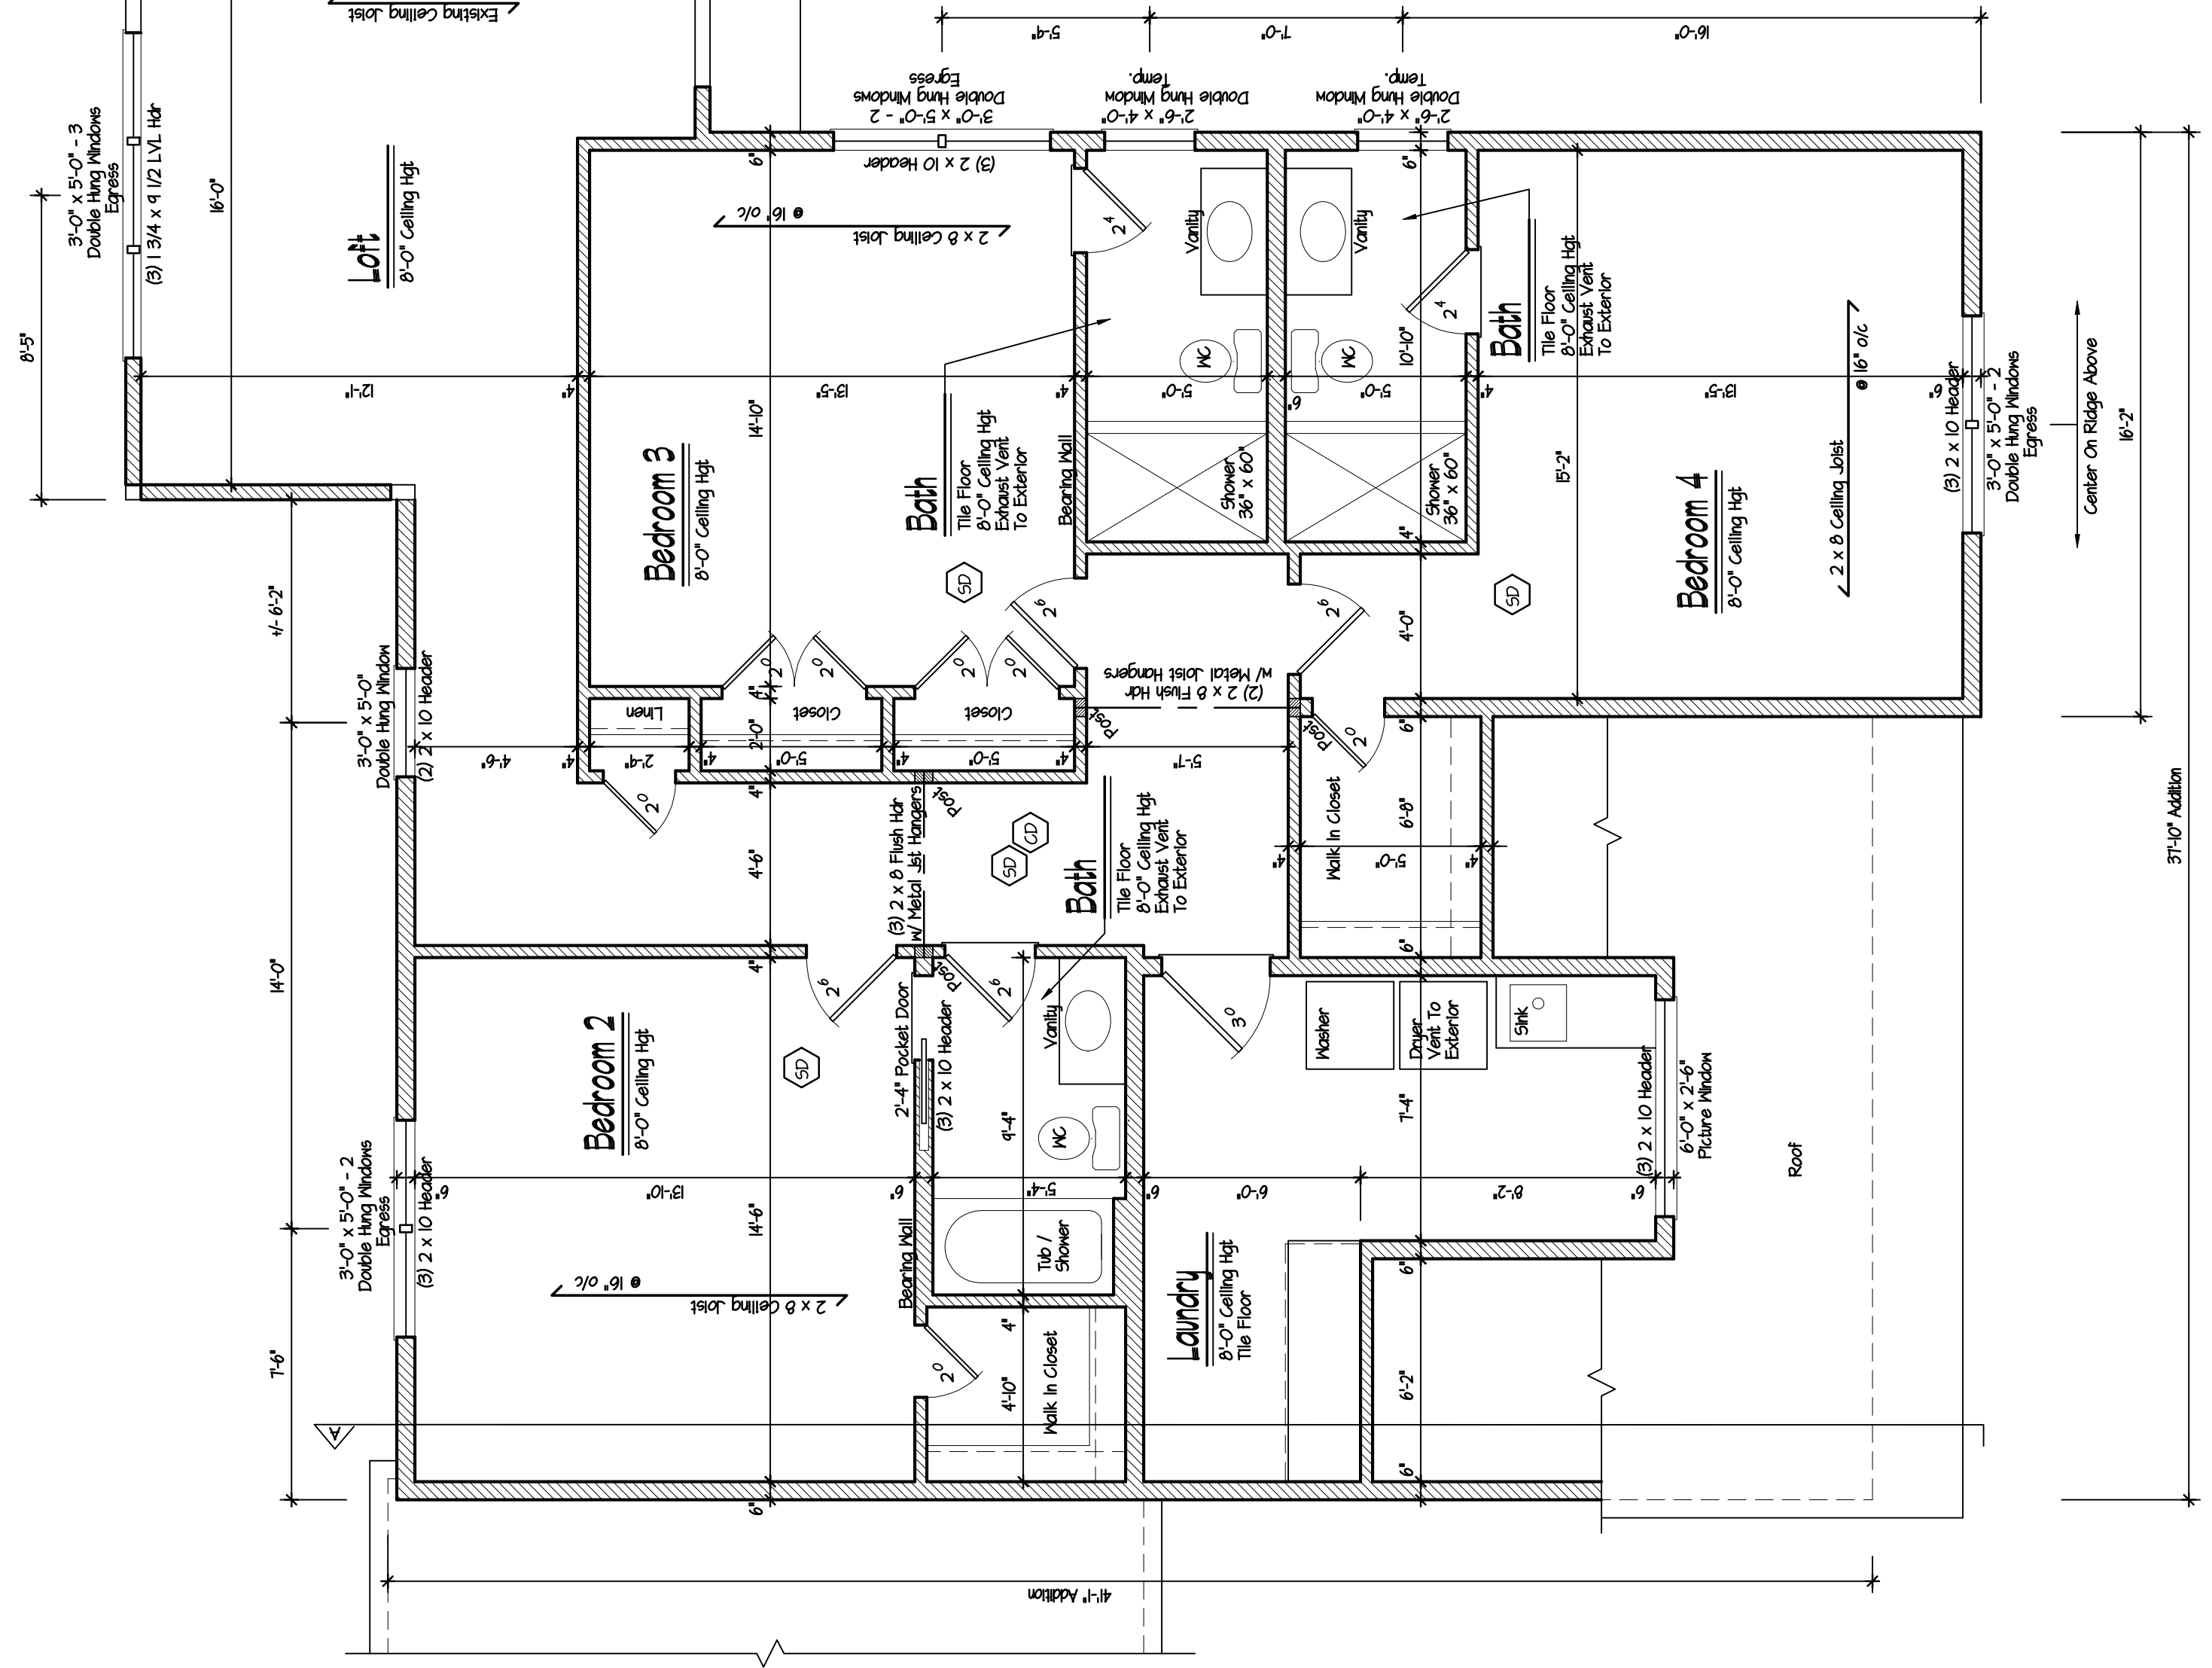

Proposed Second Floor Plan

Scale: 1/4" = 1'-0"

Notes:

- All Framing Members To Be # 2 Douglas Fir - Larch Or Better
- Double Frame Under All Partitions Parallel To Framing
- If Tile Floor Is To Be MD Job, Contact Architect For Additional Framing Request

Legend:

- 2 x 12 Wood Deck Match Beam With 6" x 6" Noted
- Spoke Detector
- N' Batting Back-Up
- Carbon Monoxide Det
- N' Batting Back-Up
- Existing Mail (To Remove)
- New Mail

Wood Header Schedule

Span	Header Size
Up To 3'-0"	(2) 2 x 6
Up To 4'-0"	(2) 2 x 10
Up To 6'-0"	(2) 2 x 12

Note: Unless Otherwise Noted On Plans


Addition For

231 Clinton Avenue  
Dobbs Ferry, NY

Revision	Date
Date	Nov. 24, 2022
Job No	222-118
Drawing	




These plans are the property of the Architect. Any use or reproduction in whole or part without the written authorization of the Architect is prohibited. Any person or corporation who reproduces these plans without the written consent of the Architect shall be liable to the Architect for the construction of one structure only by the person whose name appears on the plans.

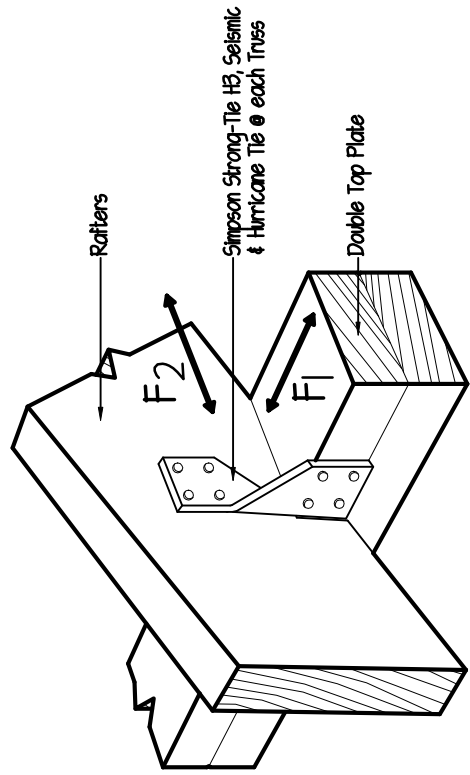

Note:  
Simpson Strong Tie is Recommended by This Supplier

### Rafter Tie Down Detail

Scale: None

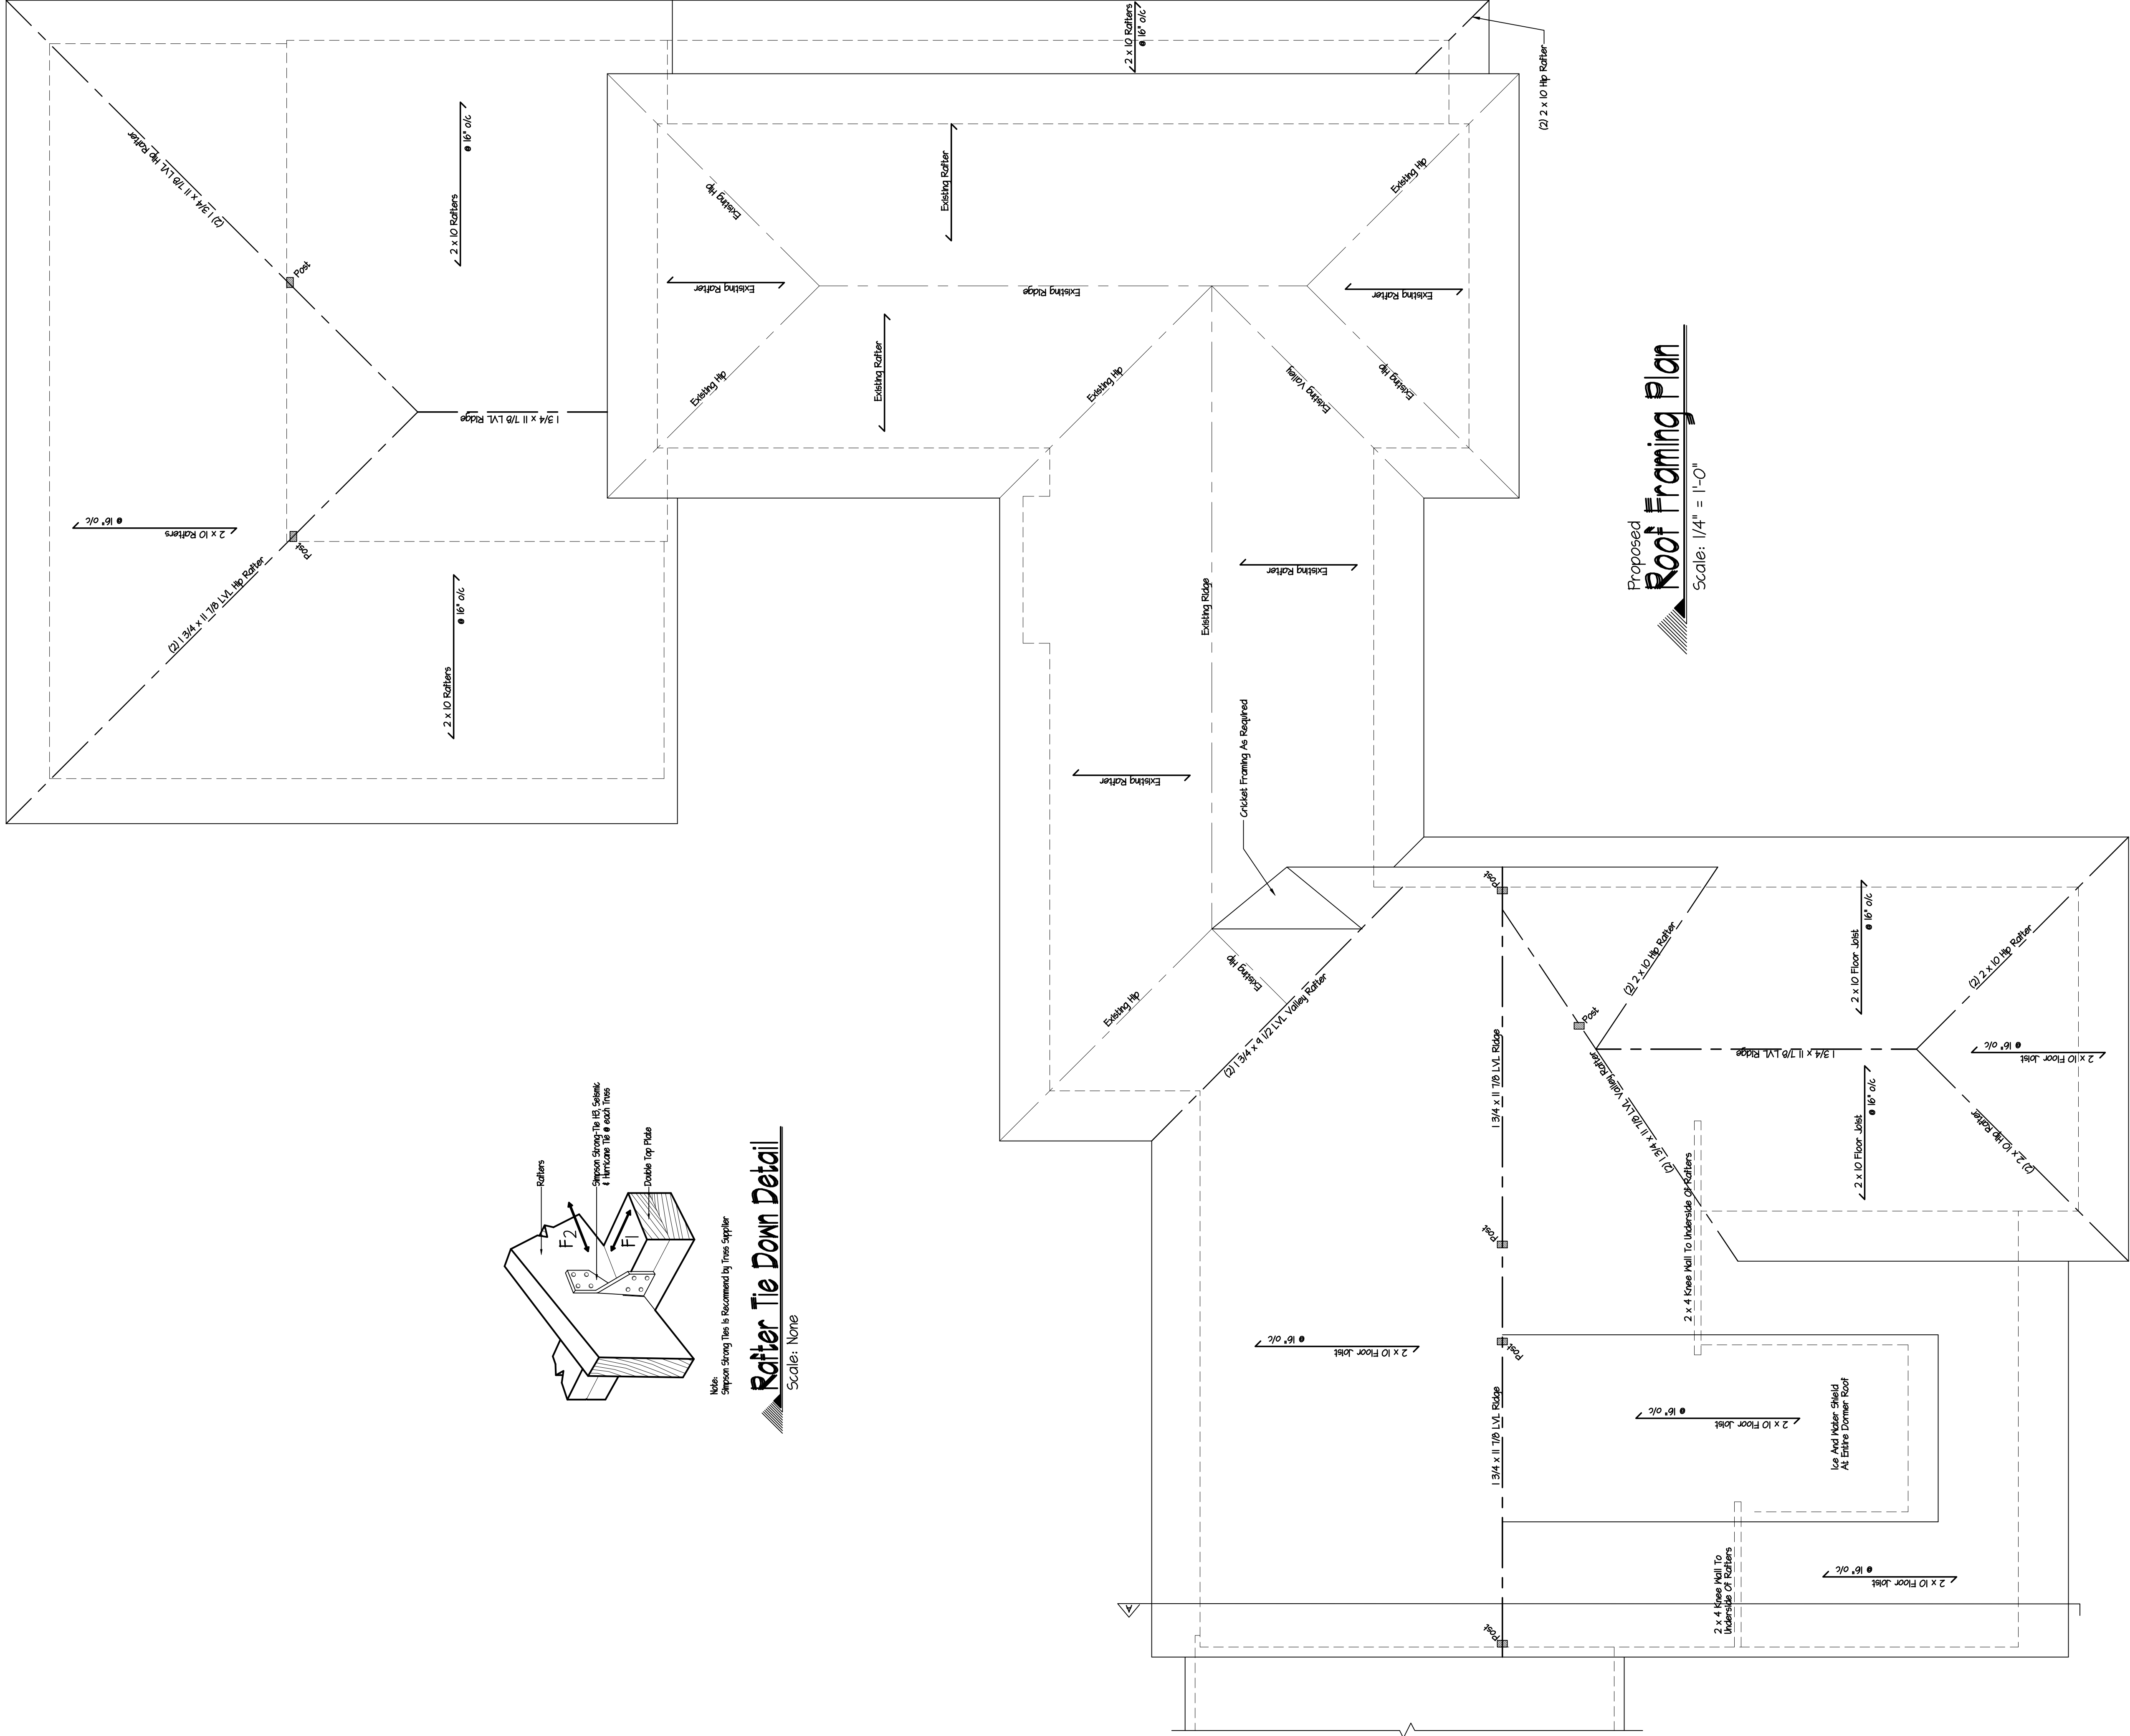

Addition For

231 Clinton Avenue  
Dobbs Ferry, NY

Revision	Date
Date	Nov. 24, 2022
Job No	222-118

Drawing

7 of 12



These plans are the property of the Architect. Any use or reproduction in whole or part without the written authorization of the Architect is prohibited. Any person or corporation who reproduces these plans without the written authorization of the Architect will be responsible to compensate the Architect.

These plans are not valid for a building permit unless accompanied by a professional seal and signature for the construction of one structure only by the person whose name appears on the plans.

**DeMasi Architects P.C.**

105 SMITH AVENUE, MOUNT KISCO, NEW YORK 10549


PHONE: (914) 666-3850

EMAIL: [Low@DemasiArchitects.com](mailto:Low@DemasiArchitects.com)

Do Not Scale Prints





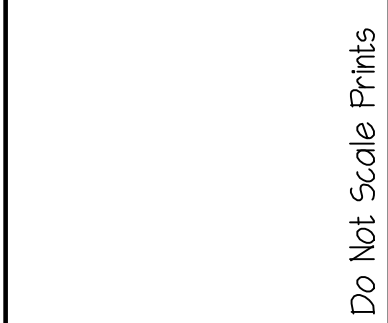

**DeMasi Architects P.C.**

105 SMITH AVENUE, MOUNT KISCO, NEW YORK 10549

EMAIL: Lou@DemasiArchitects.com

PHONE: (914) 666-3858



These plans are the property of the Architect. Any use or reproduction in whole or part without the written authorization of the Architect is prohibited. Any person or corporation using plans without proper authorization will be responsible to the Architect.

These plans are not valid for a building permit unless originally signed and sealed by the Architect and are for the construction of one Structure only by the person whose name appears on the plans.

### Addition For

231 Clinton Avenue  
Dobbs Ferry, NY


Revision	Date
Date	Nov. 29, 2022

Job No	222-118
--------	---------

### Drawing

9 OF 2





Existing  
**Front Elevation**  
Scale: 1/4" = 1'-0"



Existing  
**Rear Elevation**  
Scale: 1/4" = 1'-0"

**DeMasi Architects P.C.**  
105 SMITH AVENUE, MOUNT KISCO, NEW YORK 10549  
PHONE: (914) 666-3858  
EMAIL: Lou@DemasiArchitects.com





These plans are the property of the Architect. Any use or reproduction in whole or part without the written authorization of the Architect is prohibited. Any person or corporation who reproduces these plans without the written authorization of the Architect will be responsible to compensate the Architect.  
These plans are not valid for a building permit unless countersigned by the Architect. The Architect's signature for the construction of one structure only by the person whose name appears on the plans.


Addition For  
**231 Clinton Avenue  
Dobbs Ferry, NY**

Revision	Date
	Nov. 24, 2022
Job No	222-118

Drawing  
10 OF 2

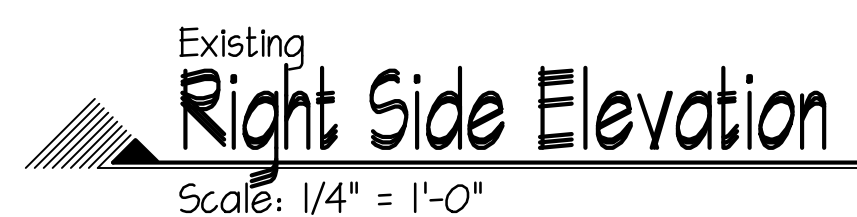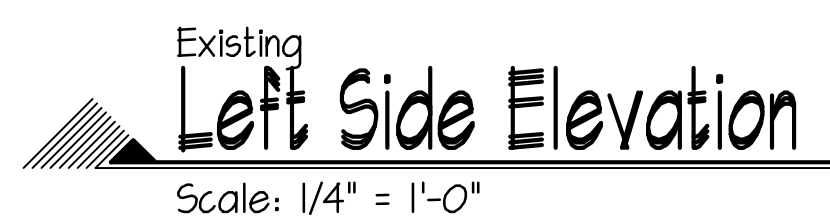


PHONE: (914) 666-3858

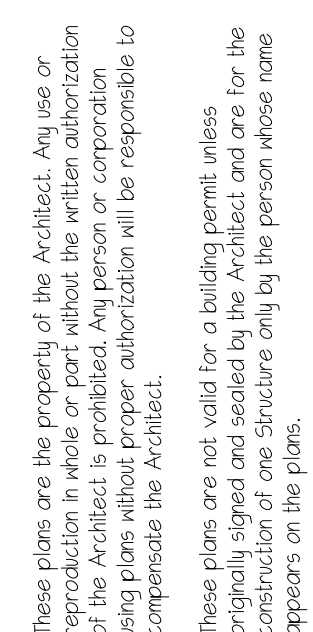

23 Clinton Avenue  
Dobbs Ferry, NY

Revision	Date
Date	Nov. 29, 2022
Job No	222-118
Drawing	
<div style="display: flex; align-items: center; justify-content: center;"> <div style="border: 1px solid black; width: 20px; height: 20px; margin-right: 5px;"></div> <div style="border: 1px solid black; width: 20px; height: 20px; margin-right: 5px;"></div> <div style="margin: 0 10px;">OF</div> <div style="border: 1px solid black; width: 40px; height: 40px; display: flex; align-items: center; justify-content: center; font-size: 24px;">2</div> </div>	



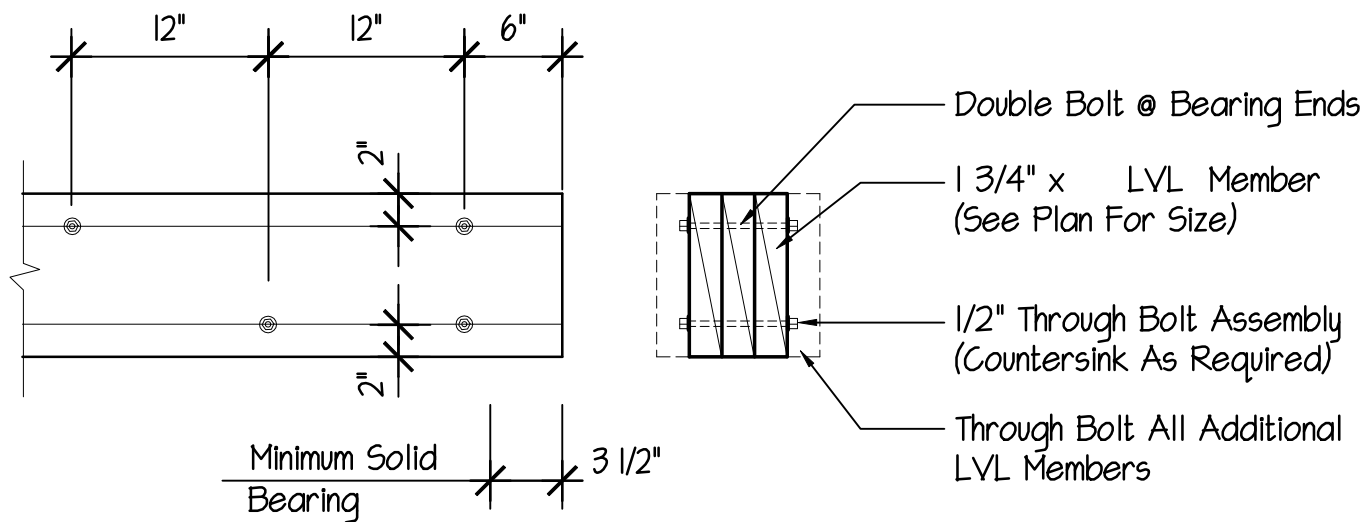


### Elevation

#### Note:

LVL = Laminated Veneer Lumber  
By Trus-Joist Meyerhaeuser (1.9 E)  
Minimum or Equal

## LVL Beam Detail (Bolted)

Scale: None

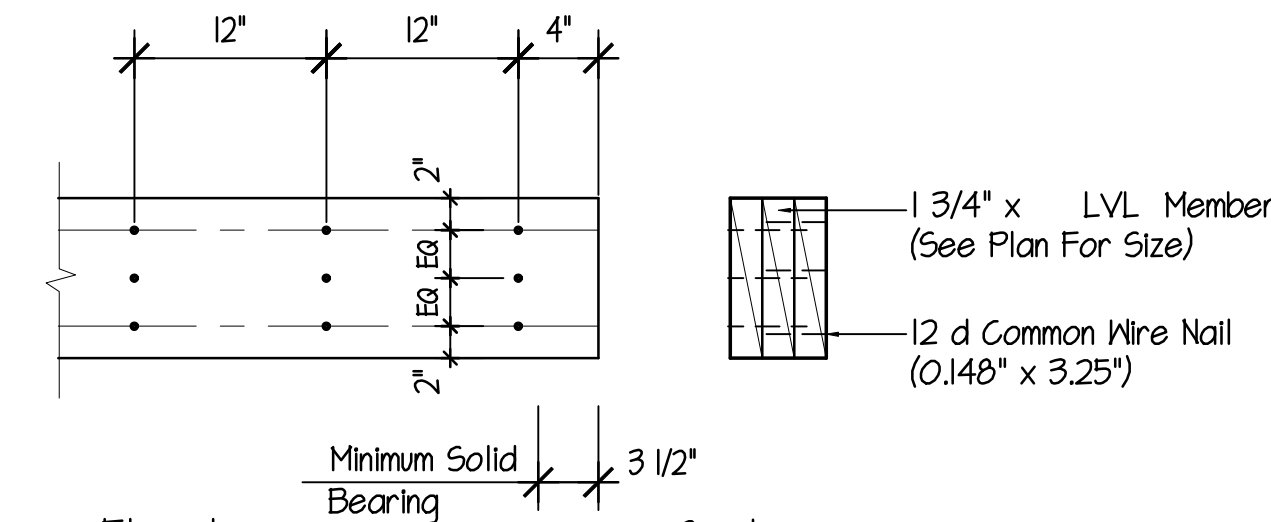

### Elevation

#### Note:

LVL = Laminated Veneer Lumber  
By Trus-Joist Meyerhaeuser (1.9 E)  
Minimum or Equal

## LVL Beam Detail (Nailed)

Scale: 1" = 1'-0"

#### General Conditions:

SPECIFICATIONS: These specifications are made in general form only and not specifically for any one building. The owner applying these specifications, assumes complete responsibility for their use, changes, or omissions.

SCOPE OF WORK: The Contractor shall provide all labor, materials, appliances and equipment required to complete all work, etc., as shown on the drawings necessary for a complete job, unless otherwise specified. All material and workmanship shall be of good quality.

OMISSIONS: All written figures (notes and dimensions) on the floor plans or specifications shall take precedence over any drawn figures (elevations). Do not scale prints. All dimensions must be verified by the contractor before start of construction. Any discrepancies on the plans or specifications must be reported to the Architect prior to the start of construction.

CODES: All work and materials must conform to all local and The 2020 Residential Code Of New York State, National Board of Fire Underwriters, NYStretch Energy Code 2020 Of New York State and requirements of the Board of Health.

ACCEPTABLE BUILDING STANDARDS: Installation of materials shall comply with industry standards as instituted by the national association or equivalent group of material used. Acceptable associations shall include, but are not limited to, the following: Western Wood Products Assoc., Cedar Shake & Shingle Bureau, Brick Industry Assoc., Tile Council of America, National Roofing Contractors Assoc., and American Concrete Institute, etc.

MATERIALS: Shall be installed according to the manufacturer's specifications. All work shall comply with applicable sections of the state and local codes and the generally accepted standards as listed in the state building code.

PERMANENT CERTIFICATION A permanent certificate shall be completed by the builder or registered design professional and posted on a wall in the space where the furnace is located, a utility room, or an approved location inside the building. Here located on an electrical panel, the certificate shall not cover or obstruct the visibility of the circuit directory label, service disconnect label or other required labels. The certificate shall list the predominant R-values of insulation installed in an ceiling/roof, walls, foundation (slab, basement wall, crawlspace wall and floor) and ducts outside conditioned spaces; U-factors for fenestration and the solar heat gain coefficient (SHGC) of fenestration, and the results from any required duct system and building envelope air leakage testing done at the building. Where there is more than one value for each component, the certificate shall list the value covering the largest area. The certificate shall list the types and efficiencies of heating, cooling and service water heating equipment. Where a gas-fired inverted room heater, electric furnace or baseboard electric heater is installed in the residence, the certificate shall list "gas-fired inverted room heater," "electric furnace" or "baseboard electric heater," as appropriate. An efficiency shall not be listed for gas-fired inverted room heaters, electric furnaces or electric baseboard heaters. See Section R403.3 of the NYStretch Energy Code 2020

SITE CONDITIONS: The General Contractor shall verify all conditions before submitting his proposal. No allowance for extra changes will be permitted because of lack of knowledge of the conditions peculiar thereto except as otherwise specified elsewhere in the contract documents. Each contractor will be responsible for his own engineering and layout once the owner has established property lines and minimum number of benchmarks. The contractor shall verify all lines, levels and dimensions shown on the drawings and will be held responsible for the correctness and setting out of his work.

OWNERSHIP OF PLANS: These plans are the property of DeMasi Architects P.C. Any use or reproduction, in whole or in part, without the written authorization of DeMasi Architects P.C. is prohibited. Any person or corporation using plans without proper authorization will be responsible to compensate the Architect. This plan is for the construction of one house only.

ARCHITECT STATUS: Architect has not been retained by owner to provide periodic job inspections or job administration. Purchaser of the plans shall assume full responsibilities for any deviations or changes to these plans.

#### Excavation:

FOUNDATION: Excavate all earth, boulders, loose and soft rock to the lines and depths indicated on the drawings. All footings to bear on solid, undisturbed earth. Excavate for all utilities as required.

FOOTINGS: To bear 12" below line of solid undisturbed earth. Design of footings are based on 2,000 psi soil. If soil bearing conditions are questionable, contractor shall consult engineer for footing design. Sloped footings shall be 1:2 max. slope. Provide (2) #4 bars continuous (refer to wall section). All footings bearing from rock to soil shall be reinforced with (4) #5 bars (8 min. on both sides of joint). Dowel and pin all footings bearing on rock with a slope greater than 1:12 (50 degrees) w/ #4 dowels @ 24" o/c max.

FINISH GRADING: Finish grading shall be established to provide surface drainage in all directions away from the house and excavated areas.

#### Concrete & Masonry:

Weathering Condition: Severe

CONCRETE: Shall be a min.  $F_c = 3,000$  psi compressive strength for footings & foundation walls and  $F_c = 3,500$  psi compressive strength for porches, steps & garage floors. Concrete shall be "Air Entrained", total air content shall not be less than 5 % or more than 7 %. All concrete work shall conform to the latest American Concrete Institute (ACI) guidelines.

CONCRETE FLOORS: Shall have a smooth, dense steel trowel finish, suitable to receive composition flooring. Concrete floors in living areas shall have 6 mil. poly vapor barrier and 2" x 24" (min) rigid polystyrene foam insulation around the perimeter of the slab, where slab is within 2'-0" of grade. Pitch all garage and porch floors for drainage. (1/8"/ft. min)

POURED CONCRETE FOUNDATION: Shall comply with the latest edition of American Concrete Institute Specification and shall be plumb, straight, level and true. Forms to be properly constructed to hold concrete. Provide (2) #4 bars located at top and bottom of wall. All reinforcing bars for concrete work shall conform to A.S.T.M. A615 grade 60.

MASONRY: Concrete block shall be load bearing laid level, plumb and straight in a full bed of cement mortar (TYPE "S") with galvanized metal truss-type ties @ 24" horizontal and vertical. All joints to be well tooled. All masonry work shall conform to ACI 530 code and all reinforcement work shall conform to ACI 318-T. Fill top two courses solid with cement mortar.

MASONRY CHIMNEY & FIREPLACES: Where shown on the plans, shall be brick or stone where exposed and laid in a full bed of cement mortar with well tooled joints. Flues to be fire clay, size shown on the plans. Provide cast iron damper, ash pit and clear-out doors. Provide for proper clearances with combustible construction. Firestop at all clearances with non-combustible material. Contractor shall ensure proper clearances of chimney and fireplace per 2020 Residential Code Of New York State And NYStretch Energy Code 2020.

FIREPLACES: All fireplaces shall have tempered glass fire doors and closable combustion air intake ducts and comply with the NYStretch Energy Code 2020

FRE FAB CHIMNEY AND FIREPLACE: Installation of prefab flues and fireplaces shall be in strict accordance with manufacturer's specification. Install firestops as required by code. Fireplace shall be metal prefab with compatible flue and shall be UL listed.

DAMP-ROOFING: Foundation wall shall be dampproofed with two (2) coats of asphalt waterproofing over 1/2" cement parge (black wall) or cement wash (poored wall). Provide 4" perforated pipe footing drain laid in 16" stone with layer of filter fabric. Drain to outflow above ground or stone drain.

DAMP-ROOFING: Provide a complete TUFF-N-DRI Exterior Foundation Waterproofing System as manufactured by KOCH MATERIALS COMPANY or equal. Provide 4" perforated PVC footing drain laid in 16" deep (min) stone with a layer of filter fabric cover. Drain to outflow above ground, min. 30' from house, when not permitted, provide drywell.

DAMP-ROOFING: In areas of high water table or severe soil-water conditions are known to exist, provide 2-ply hot mapped felts, 55 pound roll roofing from top of footing to finished grade. All joints are to be lapped and sealed with adhesive.

#### Miscellaneous Metals:

STEEL: Shall conform to ASTM specification A-36 for structural steel.

FLITCH BEAMS: All steel plates shall conform to ASTM specifications A-36 for structural steel. All bolt holes to be properly drilled. Torched holes are not acceptable.

ANCHOR BOLTS: Provide 1/2" dia. X 16" with hooked end. Bolts to be placed 6'-0" o.c. max. 12" min. from corner and 2 bolts min. per sill. Consult Architect for anchoring in other seismic zone.

#### Carpentry:

Decay Design Condition: Slight - Moderate

Termite Design Condition: Moderate - Heavy.

#### Design Loads:

First Floor Loads	Live Load	40 #/sf
	Dead Load	12 #/sf
Second Floor Loads	Live Load	30 #/sf
	Dead Load	12 #/sf
Attic Head	Live Load	20 #/sf
(4'-6" Headroom)	Dead Load	12 #/sf
(4'-6" Headroom)	Live Load	30 #/sf
	Dead Load	12 #/sf
Ground Snow Load	Live Load	45 #/sf
	Dead load	7 #/sf

Wind Speed Design load: 115-120 mph

LUMBER: All framing lumber to be stress grade Douglas Fir Larch No. 2 or better.

FRAMING: Framing of the entire house shall be erected plumb, level and true, securely nailed. Joists, studs and rafters shall be doubled above all openings. All flush headers shall be connected with metal joist hangers. Double frame under all partitions parallel to framing. Sizes of joists, sheathing and rafters are shown on plans. Provide solid blocking under all posts. Contractor to provide all fire blocking at all stud wall over 10'-0" high or all horizontal turned spaces at 10'-0" intervals max.

TERMITE SHIELD: Shall be bent aluminum with sealed lapped joints (refer to wall section for other information).

SILL PLATES: All wood sill plates that rest on concrete or masonry exterior walls shall be pressure preservative treated in accordance with ANFA standards or shall be of decay-resistant hardwood of redwood, black locust, or cedars. All sill plates to be set on fiberglass sill sealer or equal.

GLULAM BEAM: Shall be No. 1 Douglas Fir (min. Fb-2200 PSI).

LAMINATED VENEER BEAM: Shall be "Microlam 1.9E" by Trus-Joist Meyerhaeuser or equal, min. lb. 2600. Install as per manufacturer's specifications. Install as per manufacturer's specifications.

PLYWOOD JOISTS: Shall be "TJI" Joists by Trus Joist Meyerhaeuser. Install as per manufacturer's specifications.

SUB FLOOR: Shall be 23/32" Advantech Flooring w/ manufacture recommendation for glue and screwed to each framing member @ 6" o/c.

SHEATHING: Shall be 1/2" exterior grade plywood nailed to each framing member.

WOOD DECKS AND RAILINGS: Where shown on plans, shall be pressure treated No. 1 Southern yellow pine wood. All nails, bolts and all metal fastenings to be hot-dipped galvanized steel, silicon bronze or copper (see detail).

BRICK OR STONE VENEER: Shall be as shown on plans, laid in cement mortar with galvanized metal ties 24" horizontal and vertical. Provide weep holes at 4' o/c max. or as required (option: provide "MortarNet" at bottom of cavity). All joints to be well tooled. Brick and/or stone shall be selected by owner.

WINDOWS: Shall be ANDERSEN "400 Series" or equal windows with insulated "Low E" glass and screens. Size and type shown on plans. Provide tempered glass where shown or where within 18" of floor.

FRENCH DOORS: Shall be ANDERSEN Frenchwood or equal with tempered insulated "Low E" glass and screens.

FIBER-CEMENT SIDING: Shall be fiber-cement plank siding by Hardie or CertainTeed. Install according to manufacture's guidelines and details. Provide 3/8" x 1 1/2" wood starter strip set to true level 1/4" up from bottom edge of siding. Lap siding on 1 1/4" minimum over course below, placing all end joints over stud bearing. Use only galvanized or corrosion resistant fasteners.

INTERIOR DOORS: Interior doors shall be 1 3/8" flush mahogany stain grade or 6 panel pre-hung units, complete with hardware and casing. Siding, bi-fold and pocket doors shall be 1 3/8" flush mahogany or 6 panel doors or as shown on plans, complete with hardware. Provide a self-closing "50 Min." label insulated door and frame between garage and house.

EXTERIOR TRIM: Shall be "Azek" or Equal. Size and shape shown on plans.

INTERIOR TRIM: Shall be stock sections of pine and shall be neatly fitted and mitered and complete, including doors and window casings, aprons and stools, based at the floor. Closets to have one 3/4" shelf with clothes pole adequately supported. Linen closets to have five (5) 3/4" shelves.

WOOD STAIR: Provide oak tread stair, size shown on the plan. Provide complete hardwood railing post, newel, and balusters (4 1/2" o.c. max.), as required. Stair to have oaktread (10" w/ 1 1/8" nosing @ closed stair), clear pine stringer and risers (8 1/4" max.). Provide oak tread return and bullnose on open sides. Stair shall be glued and wedged. All trim to be mitered and glued. Stair shall be fabricated in millshop by professional stair-builder. The general contractor shall be responsible to field check and verify stair dimensions and compliance with local & state building codes.

FLOORS: Wood floors shall be 23/32 strip oak securely nailed to joists over a layer of rosh paper. Composition floors shall be 1/16" vinyl set in mastic on concrete, or 5/8" exterior A/C plywood underlayment in joist areas.

ATTIC CRAWLSPACE ACCESS: Access doors from conditioned spaces to unconditioned spaces such as attics and crawl spaces shall be weatherstripped and insulated to a level equivalent to the insulation on the surrounding surfaces. Access shall be provided to all equipment that prevents damaging or compressing the insulation. A wood-framed or equivalent barrier or retainer is required to be provided when loose-fill insulation is installed, the purpose of which is to prevent the loose-fill insulation from spilling into the living space when the attic access is opened, and to provide a permanent means of maintaining the installed R-value of the loose-fill insulation. See Section R402.2.4 Of the NYStretch Energy Code 2020.

BUILDING CAVITIES: Building framing cavities shall not be used as ducts or plenums As Per Section R403.35 Of the NYStretch Energy Code 2020.

ROOFING: All chimneys shall be properly flashed. Provide self-sealing ribbertized waterproof membrane (36" wide min) at all eaves, openings, hips, valleys, and ridges by M/R Grace and Company or equal (ice and watershield). All roofing shall be installed by qualified roofing contractors, in strict accordance with manufacturer's specifications.

ASPHALT SHINGLE ROOF: Shall be 30-yr nstic asphalt shingles laid on 15 lb. roofing felt.

ROOF VENTILATION: Ventilate all attic and rafter spaces with proper sized screened ridge and soffit vents or lowers (see plans).

GYPSUM BOARD: 1/2" nailed with rosh nails according to manufacturer's specifications. All joints to be taped and receive three (3) coats of joint compound. Finish to be smooth and even, ready for painting. Provide 5/8" type "X" gypsum board at both sides of garage house walls and ceilings. Also, provide 100 SF min. over furnace.

GUTTERS AND LEADERS: Provide baked enamel gutters and leaders as required. All leaders and gutters are to be properly supported at all joint areas.

INSULATION: Shall be fiberglass batts with vapor barrier. Provide insulation as per NYStretch Energy Code 2020 Section R402.

RES-CHECK software is allowed to be used to calculate insulation requirements.

#### Tile Work:

CERAMIC TILE: Baths and lavatory floors to receive matt glazed ceramic tile set in thin-set grout. Installation to be as per latest edition of the Tile Council of America specifications. Consult Architect if other setting methods are to be used to verify floor structure. Tub and shower wall to receive glazed ceramic tile set in mastic. 6" tile set in mastic. Provide water-resistant cement backer boards to tub shower walls and wet areas.

ACCESSORIES AND ATTACHMENTS: Provide ceramic accessories such as soap dish, paper holder, 2 towel bars per bath. Provide mirror medicine cabinet with light over. Provide formica stock vanity where shown on plans.

#### Painting:

EXTERIOR: Siding, fascias, and trim shall receive one (1) prime coat and one (1) finish coat of exterior stain or paint.

INTERIOR: Walls to receive one (1) prime coat and one (1) finish coat of latex or oil flat paint. Flush hardwood doors to receive one (1) coat of stain and one (1) coat of satin polyurethane finish. Six (6) panel doors to receive one (1) coat primer and one (1) coat of satin enamel finish. Floors to be sanded and receive one (1) coat of sealer and one (1) coat of floor polyurethane, gloss finish.

TRIM AND MISCELLANEOUS WOOD: Shall have one (1) prime coat and one (1) finish coat of satin enamel.

#### Heating:

HEATING AND AIR CONDITIONING: Shall be oil-fired hydro-air system, complete with boiler, hydronic zone controls, thermostats, oil tank, etc. for 5 zones. Provide domestic hot water coil or separate circulating storage tank if required in boiler. Provide air handling units, condensers, insulated supply ducts and vents to each room. Heating and cooling system to be designed and guaranteed to conform to the latest ASHREA specifications and the NYStretch Energy Code 2020. Heating system shall be designed and guaranteed to maintain 73 degrees F indoor temperature with 7 degrees F outdoor temperature.

DUCTS: All ducts shall be fabricated and rigidly installed with required bracing and supports. The main supply and return duct shall be isolated from the heater and blower by means of fabric insulators. Provide duct damper for each run. Insulate all ducts located in garage, attic, and wheated areas

DUCT TESTING: Ducts shall be pressure tested to determine air leakage by one of the following methods: Rough-In test Or Postconstruction test. A written report of the results of the test shall be signed by the party conducting the test and provided to the code official. See Section R403.3.5 Of the NYStretch Energy Code 2020.

EQUIPMENT SIZING AND EFFICIENCY RATING: Heating and cooling equipment shall be sized in accordance with ACCA Manual S based on building loads calculated in accordance with ACCA Manual J or other approved heating and cooling calculation methodologies. New or replaced heating and cooling equipment shall have an efficiency rating equal to or greater than the minimum required by federal law for the geographic location where the equipment is installed. See Section R403.1 Of the NYStretch Energy Code 2020 For More Detail.

GRILLS AND REGISTERS: Provide supply and return registers in each room. All supply grills to have adjustable dampers.

BALANCING: Heating contractor shall balance entire house so that all rooms heat evenly to the required temperature set on the thermostat.

#### Plumbing:

WORK INCLUDED: Contractor shall furnish all labor, materials and equipment required to fully complete all plumbing work shown on plans.

FLASHING: All pipes passing through roof shall receive aluminum collar, strapped and fitted to provide water-proof seal.

TESTING: Contractor shall test all water, drainage, and vent piping in accordance with local codes.

WATER SUPPLY: Water supply in street or well shall be extended to house with 1" heavy copper pipe and entire house shall be supplied with both hot and cold water by means of heavy copper pipe of appropriate sizes, min. 3/4" sub main to each bath, kitchen, and laundry. The weather resistant hose fittings shall be installed. Provide hook-up for washer where shown.

DRAINAGE SYSTEM: Shall be installed in accordance with local codes and all drains and shall be complete with copper drains and copper vents, cleanouts, etc. connected to street sewer or septic system. Drains under concrete to be cast iron.

FIXTURES: As shown on plans shall be AMERICAN STANDARD, KOHLER, or equal. All exposed fittings and pipes to be chrome plated.

SEPTIC AND WELL SYSTEMS: (If required) shall conform to all requirements of the Board of Health.

#### Electrical:

Electrical system to be designed to comply with NEC 70 specification.

Electrical: Provide a minimum of 120/208-200 amp, or larger, if required, for service. Switches to be silent type. Locations of outlets, fixtures, etc., as shown on plans. All electric work to conform to the National Board of Fire Underwriters Codes. Provide a complete door bell system.

Contractor to provide exhaust fans at both rooms (vent to exterior). Provide 4 install as per code.

Contractor to provide smoke & heat detectors with battery back-up (see plans for location). Detectors shall conform to all applicable codes and shall be installed as per code R314.3. Hard-wire and interconnected per section R314.4

Contractor to provide carbon monoxide detectors with battery back-up (see plans for location). Detectors shall conform to all applicable codes and shall be installed as per building code. Section R315.

Lighting Equipment: Not less than 40 percent of the permanently installed lighting fixtures shall contain only high-efficacy lamps. Of the NYStretch Energy Code 2020.

MECHANICAL VENTILATION: The building shall be provided with ventilation that meets the requirements of the NYStretch Energy Code 2020 or 2020 Mechanical Code Of New York State, as applicable, or with other approved means of ventilation. Outdoor air intakes and exhausts shall have automatic or gravity dampers that close when the ventilation system is not operating. See Section R403.6 Of the NYStretch Energy Code 2020 For More Detail.

#### Site Work:

SITE WORK: Provide 2" blacktop driveway, 4" gravel base to street. Sidewalks to be 3' wide, 4" concrete or 1 1/2" flagstone laid in sand, from house to driveway. Provide top soil and seed to all areas disturbed by construction.

#### Insulation / Energy Code:

Refer to "RES CHECK" energy study attached to plans or fixed to first page.

INSULATION: Shall be fiberglass batt with foil faced vapor barrier, "R" value stated on attached RES-CHECK.

Pack insulation in all cavities around all exterior windows, doors and other openings.

AIR LEAKAGE: Joints, penetrations, and all other such openings in the building envelope that are sources of air leakage must be sealed in accordance with the requirements of Sections R402.4.1 through R402.4.4. Of the 2020 Energy Conservation Code Of New York State. Recessed lights must be 1) Type IC rated, or 2) installed inside an appropriate air-tight assembly with a 0.5" clearance from combustible materials. If non-IC rated, the fixture must be installed with a 3" clearance from insulation.

VAPOR RETARDER: Required on the warm-in-winter side of all non-vented framed ceilings, walls, and floors.

#### Material Identification:

Materials and equipment must be installed in accordance with the manufacturer's installation instructions. Materials and equipment must be identified so that compliance can be determined. Manufacturer manuals for all installed heating and cooling equipment and service water heating equipment must be provided. Insulation R-values and glazing U-factors must be clearly marked on the building plans or specifications.

#### Duct Insulation:

Supply and return ducts in attics shall be insulated to an R-value of not less than R-8 for ducts 3 inches (16 mm) in diameter and larger and not less than R-6 for ducts smaller than 3 inches (16 mm) in diameter.

Supply and return ducts in other portions of the building shall be insulated to not less than R-6 for ducts 3 inches (16 mm) in diameter and to not less than R-4.2 for ducts smaller than 3 inches (16.2 mm) in diameter. Exception being ducts located in conditioned spaces. See 2020 Residence Code Of New York State.

Ducts bairied within ceiling insulation both supply and return shall have an insulation R-value not less than R-8. At all points along each duct, the sum of the ceiling insulation R-values against and above the top of the duct, and against and below the bottom of the duct shall be not less than R-4, excluding the R-value of the duct insulation.

#### Duct Construction:

All joints, seams, and connections must be securely fastened with welds, gaskets, mastics (adhesives), mastic-plus-embedded-fabric, or tapes. Duct tape is not permitted.

- Exception: Continuously welded and locking-type longitudinal joints and seams on ducts operating at less than 2 in. Hg. (500 Pa).

- Exception: Air-impermeable spray foam products shall be permitted to be applied without additional joint seals.

Ducts shall be supported every 10 feet or in accordance with the manufacturer's instructions.

Cooling ducts with exterior insulation must be covered with a vapor retarder.

Air filters are required in the return air system.

The HVAC system must provide a means for balancing air and water systems.

#### Temperature Controls:

The thermostat controlling the primary heating or cooling system of the dwelling unit shall be capable of controlling the heating and cooling system on a daily schedule to maintain different temperature setpoints at different times of the day. The thermostat shall include the capability to set back or temporarily operate the system to maintain zone temperatures of not less than 55 F (13 C) to not greater than 85 F (24 C). The thermostat shall be programmed initially by the manufacturer with a heating temperature setpoint of not greater than 70 F (21 C) and a cooling temperature setpoint of not less than 78 F (26 C).

#### Electrical Systems:

Separate electric meters are required for each dwelling unit.

#### Fireplaces:

Fireplaces must be installed with tight fitting non-combustible fireplace doors. Fireplaces must be provided with a source of combustion air, as required by the Fireplace construction provisions of the Building Code, the Residential Code as applicable.

#### Service Water Heating:

Water heaters with vertical pipe risers must have a heat trap on both the inlet and outlet unless the water heater has an integral heat trap or is part of a circulating system.

#### Swimming Pools:

All heated swimming pools must have an on/off heater switch and require a cover unless over 20% of the heating energy is from non-depletable sources. Pool pumps require a time clock.

#### Heating & Cooling Piping Insulation:

Mechanical system piping capable of carrying fluids above 105 degrees F or chilled fluids below 55 degrees F must be insulated to a Minimum of R-3. See Section R403.4 of the NYStretch Energy Code 2020 for more detail.



These plans are the property of the Architect. Any use or reproduction in whole or part without the written authorization of the Architect is prohibited. Any person or corporation using these plans without proper authorization will be responsible to compensate the Architect.

These plans are not valid for a building permit unless they are stamped and signed by the Architect for the construction of one structure only by the person whose name appears on the plans.

Addition For

Revision

Date

Job No

222-118

Drawing

12 of 12

DeMasi Architects P.C.

105 SMITH AVENUE, MOUNT KISCO, NEW YORK 10549

EMAIL: Lou@DemasiArchitects.com

PHONE: (914) 666-3850



These plans are the property of the Architect. Any use or reproduction in whole or part without the written authorization of the Architect is prohibited. Any person or corporation using these plans without proper authorization will be responsible to compensate the Architect.

These plans are not valid for a building permit unless they are stamped and signed by the Architect for the construction of one structure only by the person whose name appears on the plans.

231 Clinton Avenue  
Dobbs Ferry, NY

Revision

Date

Job No


222-118

Drawing

12 of 12

Do Not Scale Prints



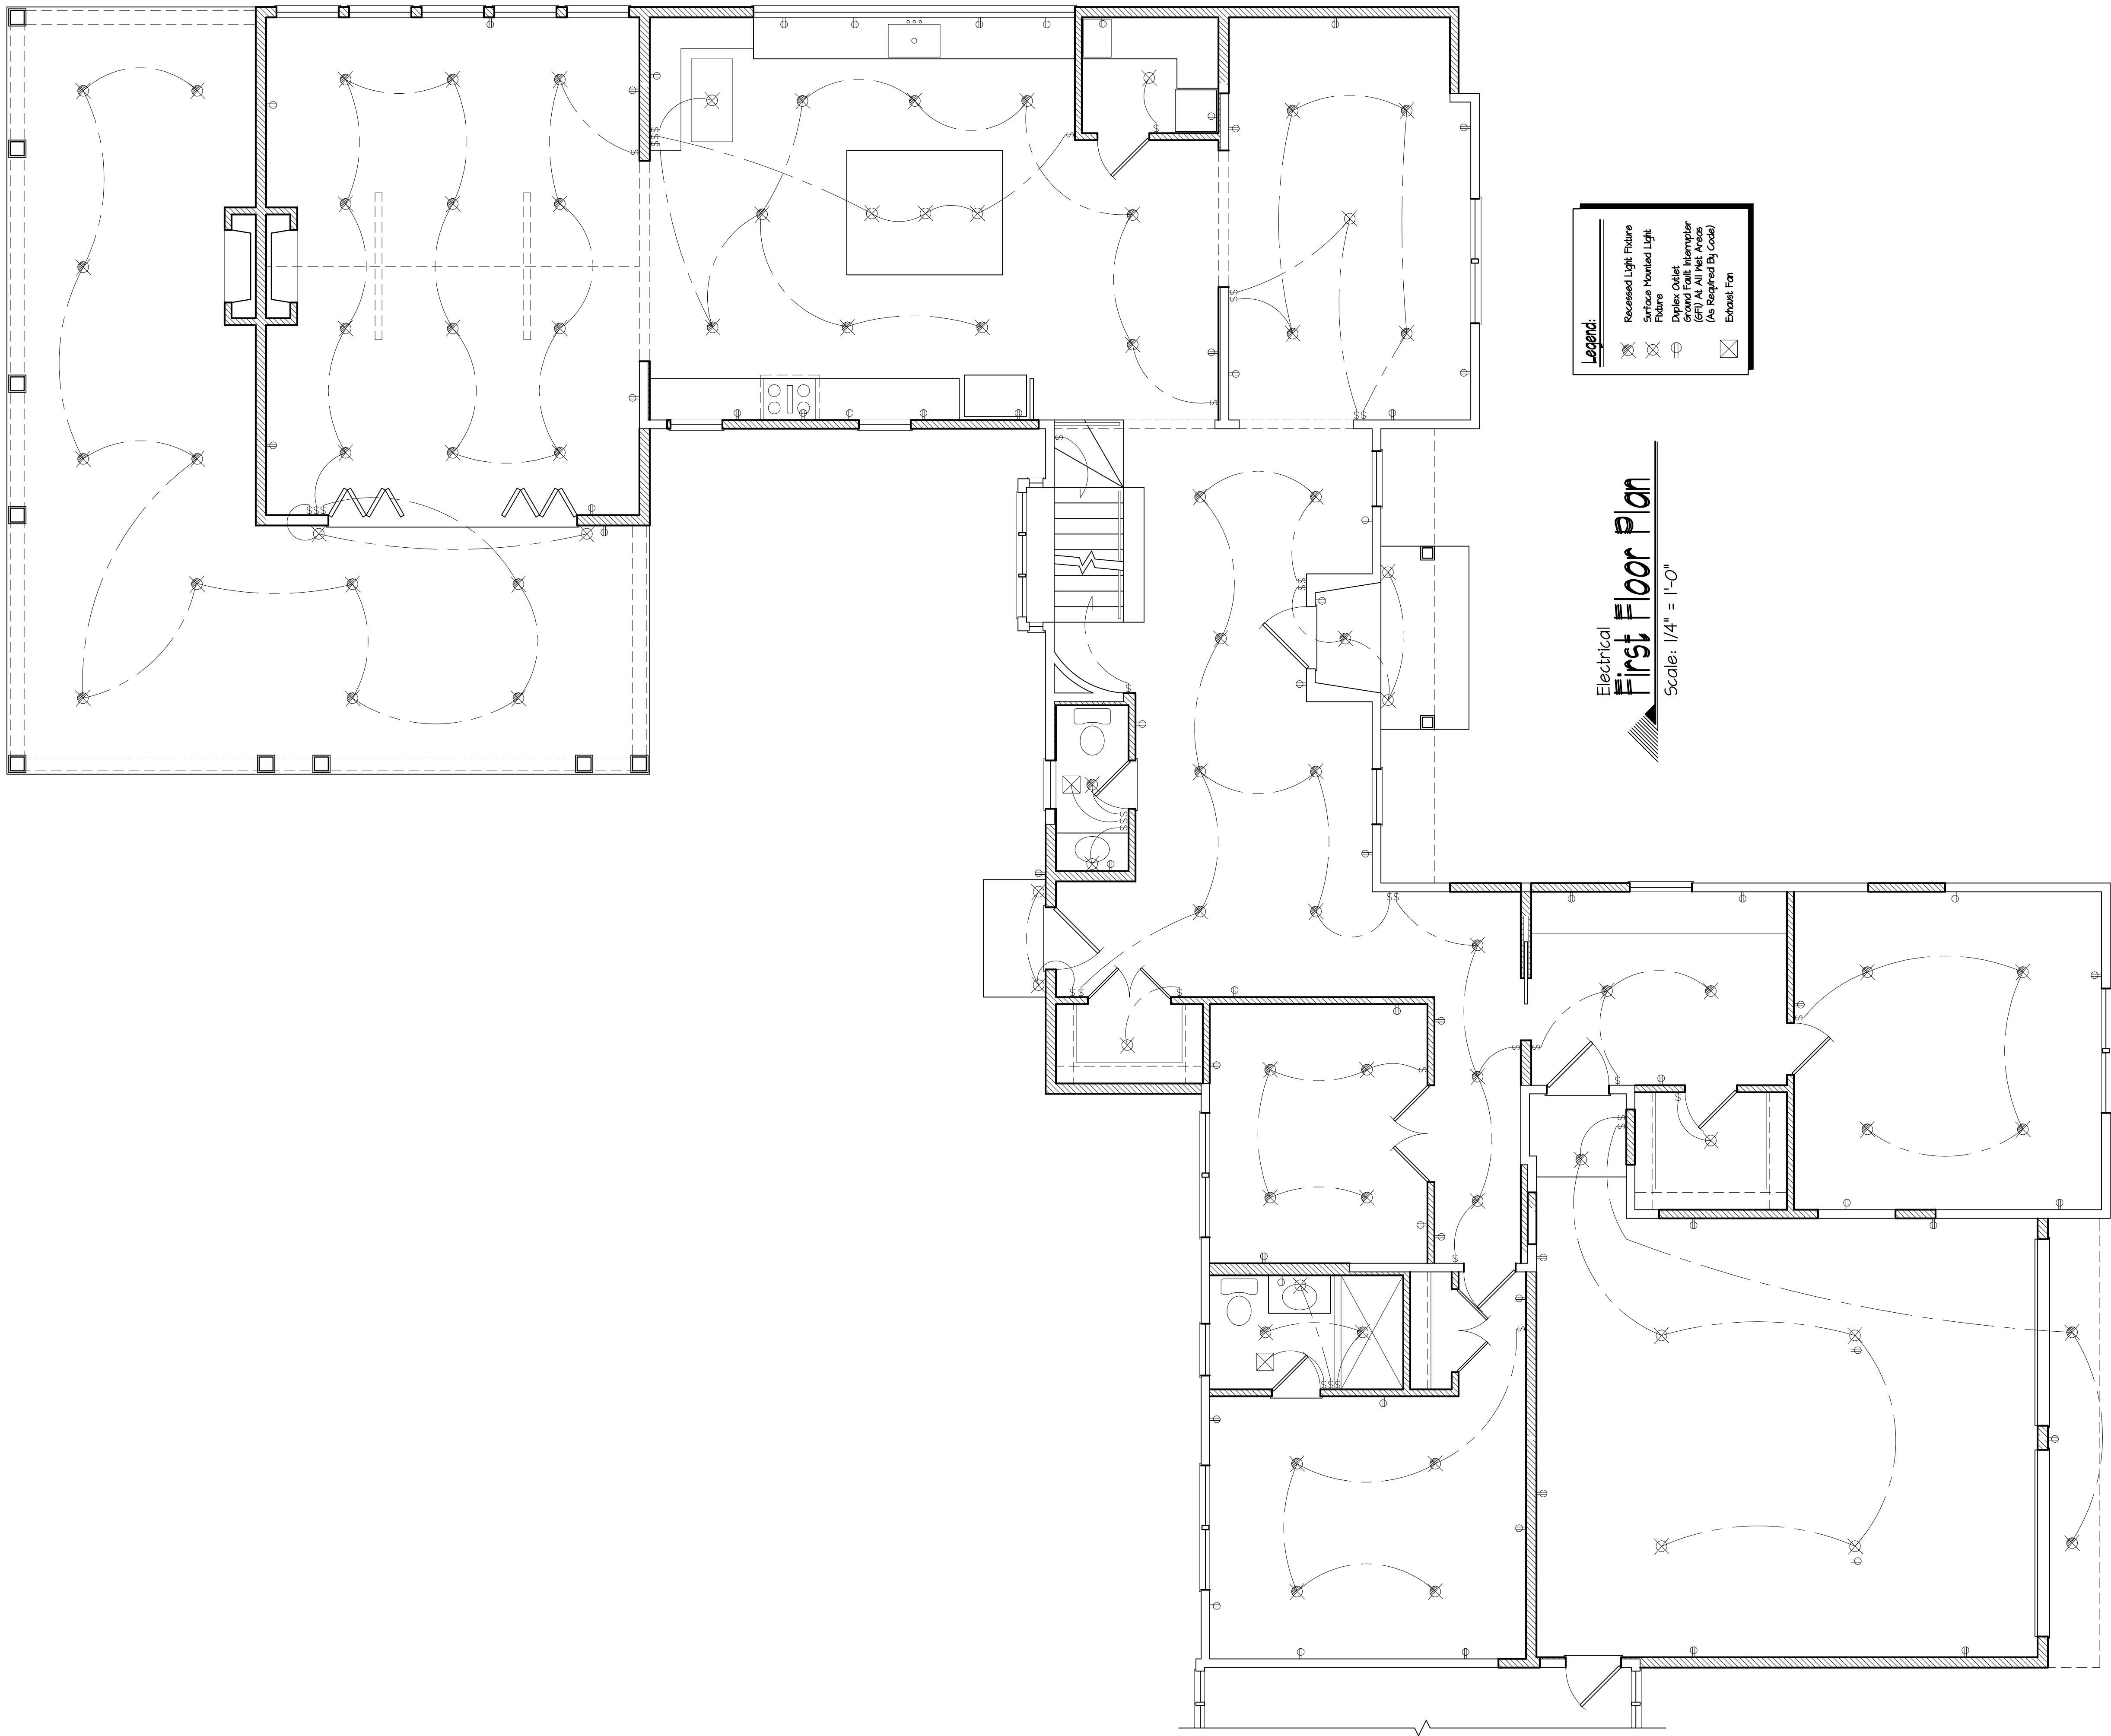



These plans are the property of the Architect. Any use or reproduction in whole or part without the written authorization of the Architect is prohibited. Any person or corporation who reproduces these plans without the written authorization will be responsible to compensate the Architect.


These plans are not valid for a building permit unless countersigned by the Professional Engineer responsible for the construction of one structure only by the person whose name appears on the plans.

Addition For

231 Clinton Avenue  
Dobbs Ferry, NY

Revision	Date
Date	Nov. 24, 2022
Job No	222-118
Electrical Drawing	
 OF 	



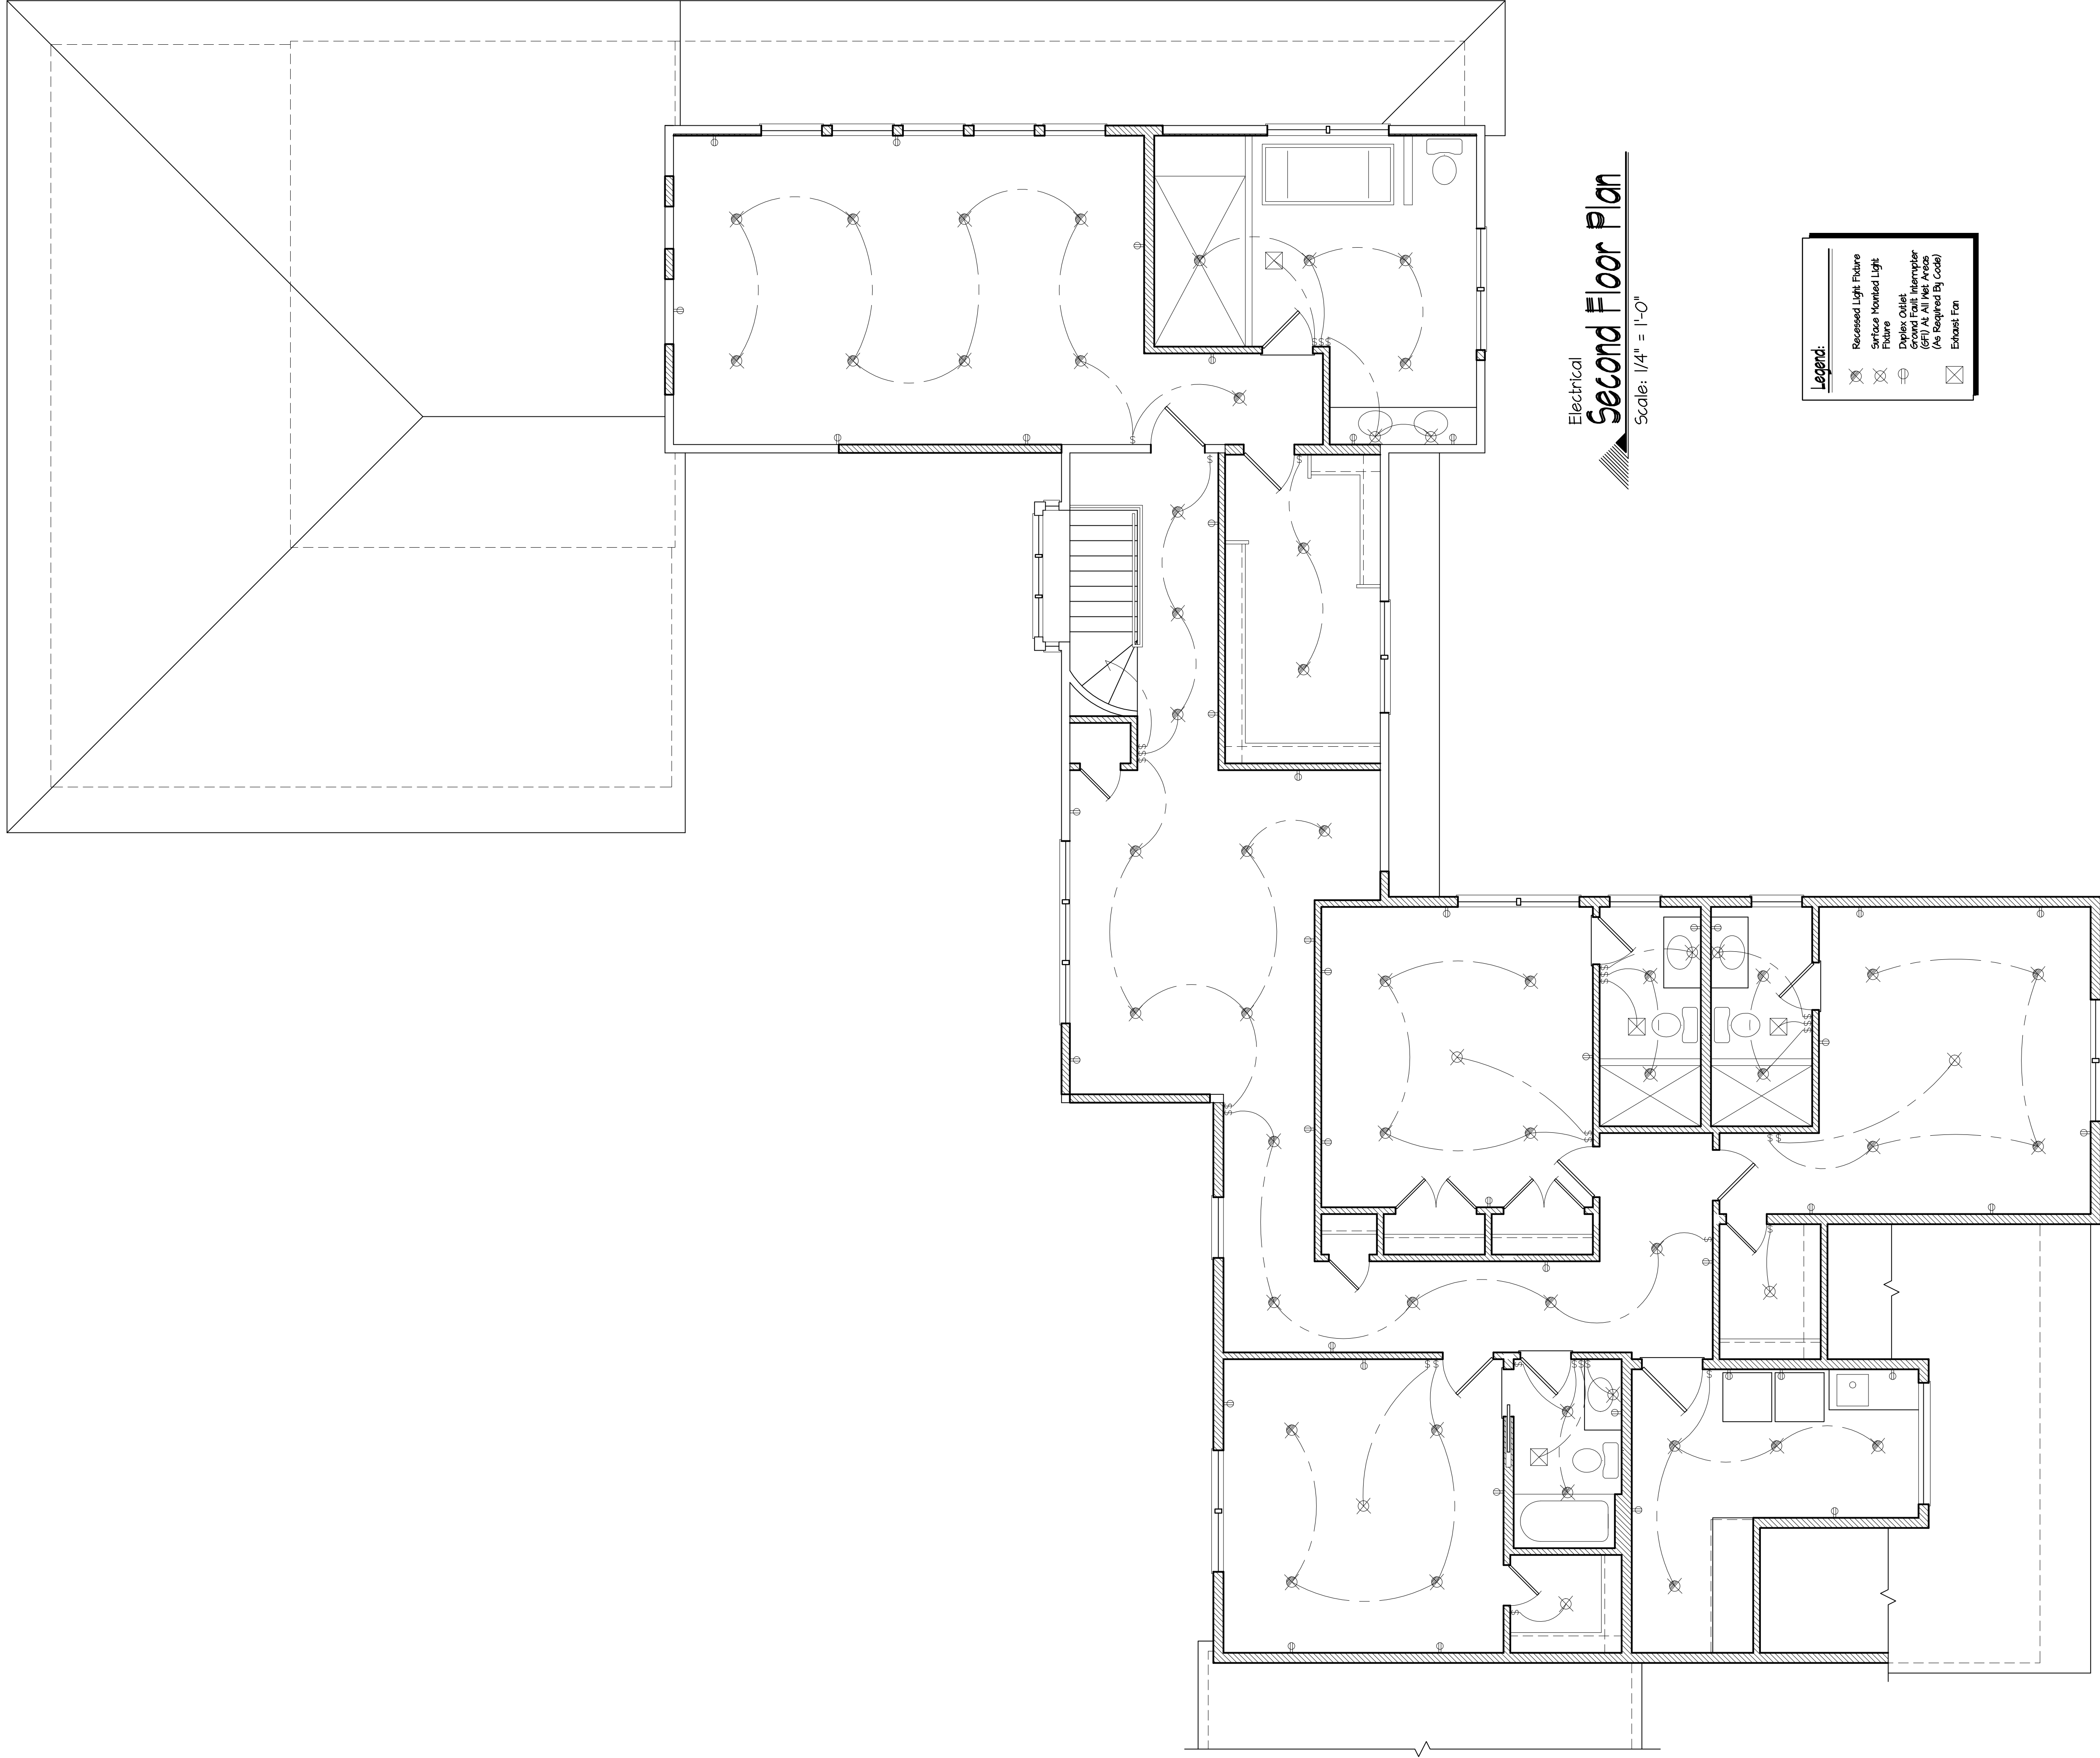

Electrical  
**Second Floor Plan**  
Scale: 1/4" = 1'-0"

**Legend:**

- Recessed Light Fixture
- Surface Mounted Light Fixture
- duplex Outlet
- Ground Fault Interrupter (GFI) At All Wet Areas (As Required By Code)
- Exhaust Fan

These plans are the property of the Architect. Any use or reproduction in whole or part without the written authorization of the Architect is prohibited. Any person or corporation who reproduces these plans without the written authorization of the Architect will be responsible to compensate the Architect.

These plans are not valid for a building permit unless signed and sealed by the Architect. The Architect is not responsible for the construction of new structure only by the person whose name appears on the plans.



**DeMasi Architects P.C.**  
105 SMITH AVENUE, MOUNT KISCO, NEW YORK 10549  
PHONE: (914) 666-3858  
EMAIL: Lou@DemasiArchitects.com

Do Not Scale Prints

**Addition For**  
**231 Clinton Avenue**  
**Dobbs Ferry, NY**

Revision	Date
Date	Nov. 24, 2022
Job No	222-118

Electrical Drawing