

GENERAL NOTES:

- 1. THE ENGINEER SHALL NOT BE RESPONSIBLE FOR THE SUPERVISION OF THE CONSTRUCTION. 2. NO CHANGES SHALL BE MADE TO THESE PLANS EXCEPT AS PER NYS LAW CHAPTER 987.
- 3. ALL WORK AND MATERIALS SHALL COMPLY WITH ALL APPLICABLE CODES, INCLUDING BUT NOT LIMITED TO ACI, AISC, ZONING, AND THE NEW YORK STATE BUILDING CODE.
- 4. ALL CONDITIONS, LOCATIONS AND DIMENSIONS SHALL BE FIELD VERIFIED AND THE ENGINEER SHALL BE IMMEDIATELY NOTIFIED OF ANY DISCREPANCIES.
 5. ALL CHANGES MADE TO THE PLANS SHALL BE APPROVED BY THE ENGINEER AND ANY SUCH
- CHANGES SHALL BE FILED AS AMENDMENTS TO THE ORIGINAL BUILDING PERMIT.

 6. THE CONTRACTOR SHALL SUPERVISE AND DIRECT THE WORK USING HIS BEST SKILL AND ATTENTION. HE SHALL BE SOLELY RESPONSIBLE FOR ALL CONSTRUCTION MEANS, METHODS, TECHNOLOGY, SEQUENCES AND PROCEDURES AND FOR COORDINATING ALL PORTIONS OF THE
- WORK UNDER THE CONTRACT.
- 7. THE CONTRACTOR SHALL BE RESPONSIBLE TO THE OWNER FOR THE ACTS AND OMISSIONS OF HIS EMPLOYEES, SUBCONTRACTORS AND THEIR AGENTS AND EMPLOYEES, AND OTHER PERSONS PERFORMING ANY OF THE WORK UNDER A CONTACT WITH THE CONTRACTOR.

 8. SAFETY DURING CONSTRUCTION SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AND SHALL CONFORM TO ALL LOCAL, STATE AND FEDERAL AGENCIES IN EFFECT DURING THE
- PERIOD OF CONSTRUCTION. 9. THE CONTRACTOR AND HIS SUBCONTRACTORS SHALL MAKE APPLICATION TO RECEIVE ALL NECESSARY PERMITS TO PERFORM THE WORK UNDER CONTRACT. THE CONTRACTOR AND HIS SUBCONTRACTORS SHALL BE LICENSED TO DO ALL WORK AS REQUIRED BY THE LOCAL,

COUNTY, AND STATE AGENCIES WHICH MAY HAVE JURISDICTION OVER THOSE TRADES, AND


- SHALL PRESENT THE OWNER WITH COPIES OF ALL LICENSES AND INSURANCE CERTIFICATES. 10. FINAL GRADING AROUND THE BUILDING AREA SHALL SLOPE AWAY FROM THE STRUCTURE.

 11. ALL WRITTEN DIMENSIONS ON THE DRAWINGS SHALL TAKE PRECEDENCE OVER ANY SCALED
- DIMENSIONS. 12. ADJOINING PUBLIC AND PRIVATE PROPERTY SHALL BE PROTECTED FROM DAMAGE DURING CONSTRUCTION, REMODELING AND DEMOLITION WORK. PROTECTION MUST BE PROVIDED FOR FOOTINGS, FOUNDATIONS, PARTY WALLS, CHIMNEYS, SKYLIGHTS AND ROOFS. PROVISIONS SHALL BE MADE TO CONTROL WATER RUNOFF AND EROSION DURING CONSTRUCTION OR DEMOLITION ACTIVITIES. THE PERSON MAKING OR CAUSING AN EXCAVATION TO BE MADE SHALL PROVIDE WRITTEN NOTICE TO THE OWNERS OF ADJOINING BUILDINGS ADVISING THEM THAT THE EXCAVATION IS TO BE MADE AND THAT THE ADJOINING BUILDING SHOULD BE PROTECTED. SAID NOTIFICATION SHALL BE DELIVERED NOT LESS THAN 10 DAYS PRIOR TO
- THE SCHEDULED STARTING DATE OF THE EXCAVATION.

 13. OWNER SHALL INSURE THAT THE INSURANCE PROVIDED BY THE CONTRACTOR HIRED TO PERFORM THE WORK SHALL BE ENDORSED TO NAME HUDSON ENGINEERING & CONSULTING, P.C., AND ANY DIRECTORS, OFFICERS, EMPLOYEES, SUBSIDIARIES, AND AFFILIATES, AS ADDITIONAL INSURED ON ALL POLICIES AND HOLD HARMLESS DOCUMENTS, AND SHALL STIPULATE THAT THIS INSURANCE IS PRIMARY, AND THAT ANY OTHER INSURANCE OR SELF—INSURANCE MAINTAINED BY HUDSON ENGINEERING & CONSULTING, P.C., SHALL BE EXCESS ONLY AND SHALL NOT BE CALLED UPON TO CONTRIBUTE WITH THIS INSURANCE. ISO ADDITIONAL INSURED ENDORSEMENT FORM NUMBER CG2010 1185 UNDER GL. COPIES OF THE INSURANCE POLICIES SHALL BE SUBMITTED TO HUDSON ENGINEERING & CONSULTING, P.C.,
- FOR APPROVAL PRIOR TO THE SIGNING OF THE CONTRACT.

 14. INDUSTRIAL CODE RULE 753: THE CONTRACTOR SHALL NOTIFY ALL UTILITY COMPANIES 72 HOURS PRIOR TO THE START OF HIS OPERATIONS AND SHALL COMPLY WITH ALL THE LATEST INDUSTRIAL CODE RULE 753 REGULATIONS.

| S | SLOPE ANALYSIS (LIMIT OF DISTURBANCE) | | | | |
|-----|---------------------------------------|------------|------|-------|--|
| NO. | MIN. SLOPE | MAX. SLOPE | AREA | COLOR | |
| 1 | 0% | 15% | 2887 | | |
| 2 | 15% | 25% | 9051 | | |
| 3 | 25% | 35% | 4030 | | |
| 4 | 35% | Vertical | 2302 | | |



PROPOSED SINGLE-FAMILY DWELLING O N. MOUNTAIN DRIVE VILLAGE OF DOBBS FERRY WESTCHESTER COUNTY - NEW YORK



STEEP SLOPES PLAN



HUDSON ENGINEERING

T: 914-909-0420 F: 914-560-2086

Designed By: N.S. Checked By: M.S. CONSULTING, P.C.
F5 Knollwood Road — Suite 201
Elmsford, New York 10523


ANY ALTERATIONS OR REVISIONS OF THESE PLANS, UNLESS DONE BY OR UNDER THE DIRECTION OF THE NYS LICENSED AND REGISTERED ENGINEER THAT PREPARED THEM, IS A VIOLATION OF THE NYS EDUCATION LAW.


MASONRY WALL


PROPOSED LIMIT


OF DISTURBANCE



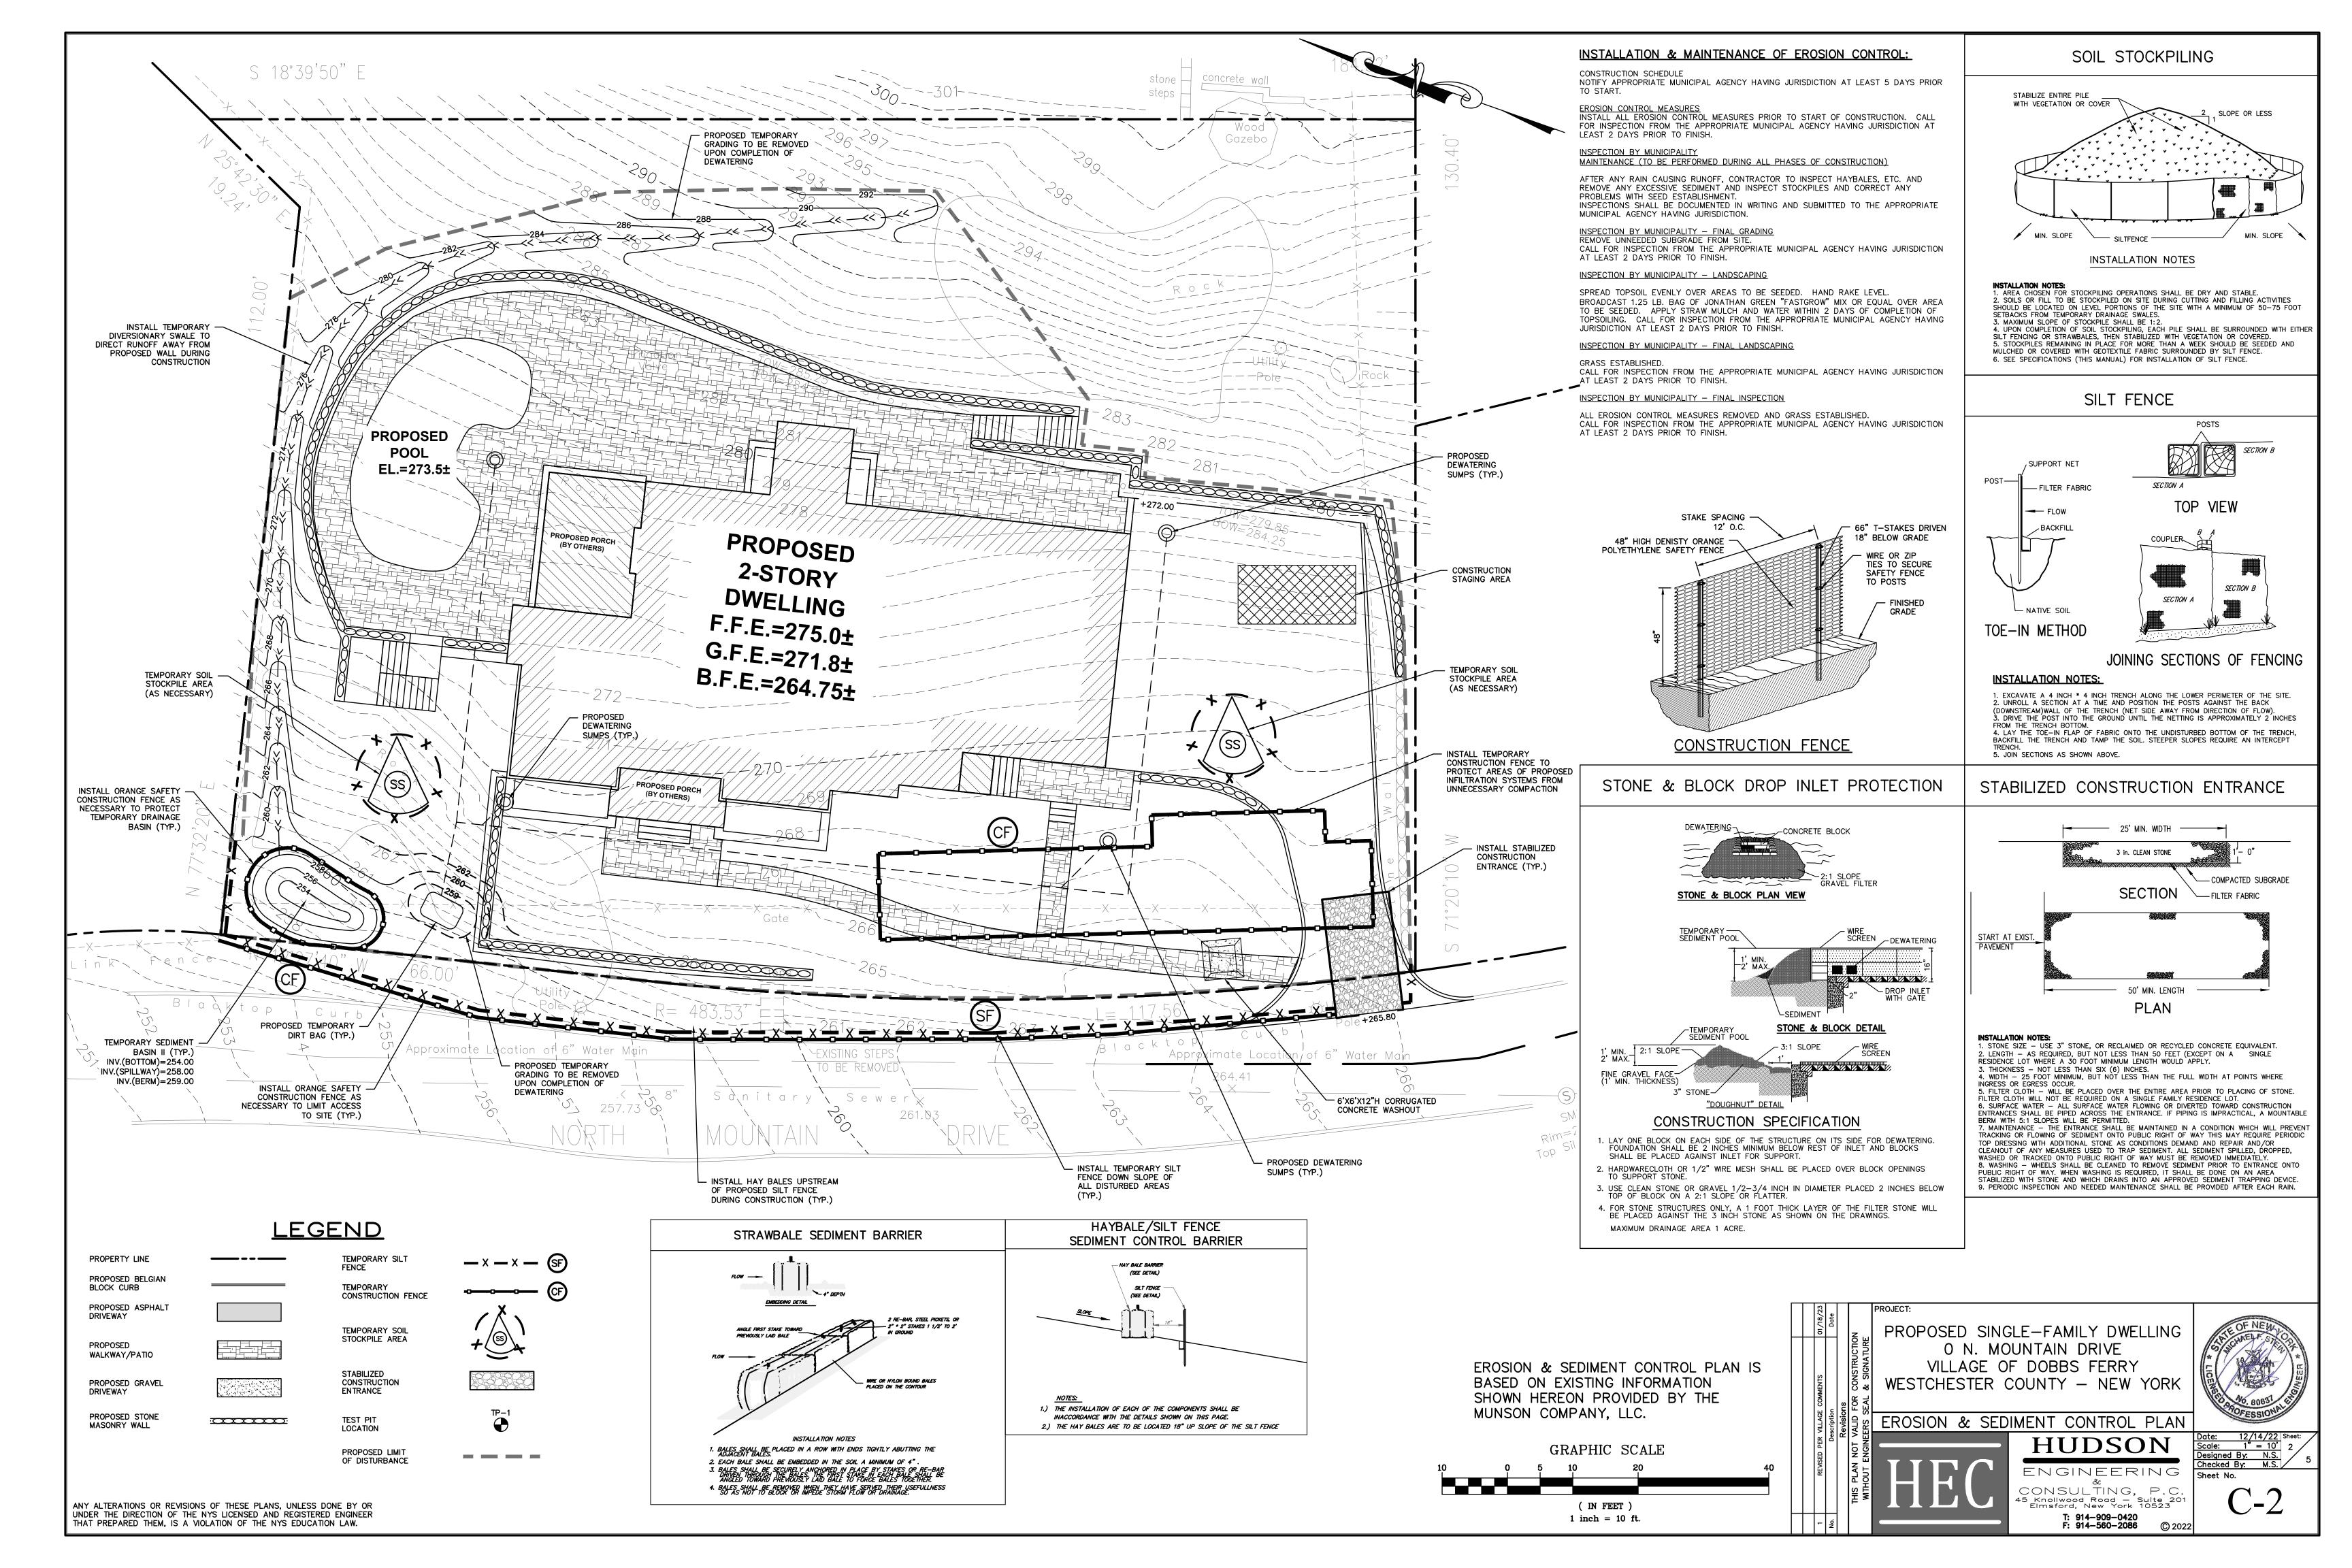

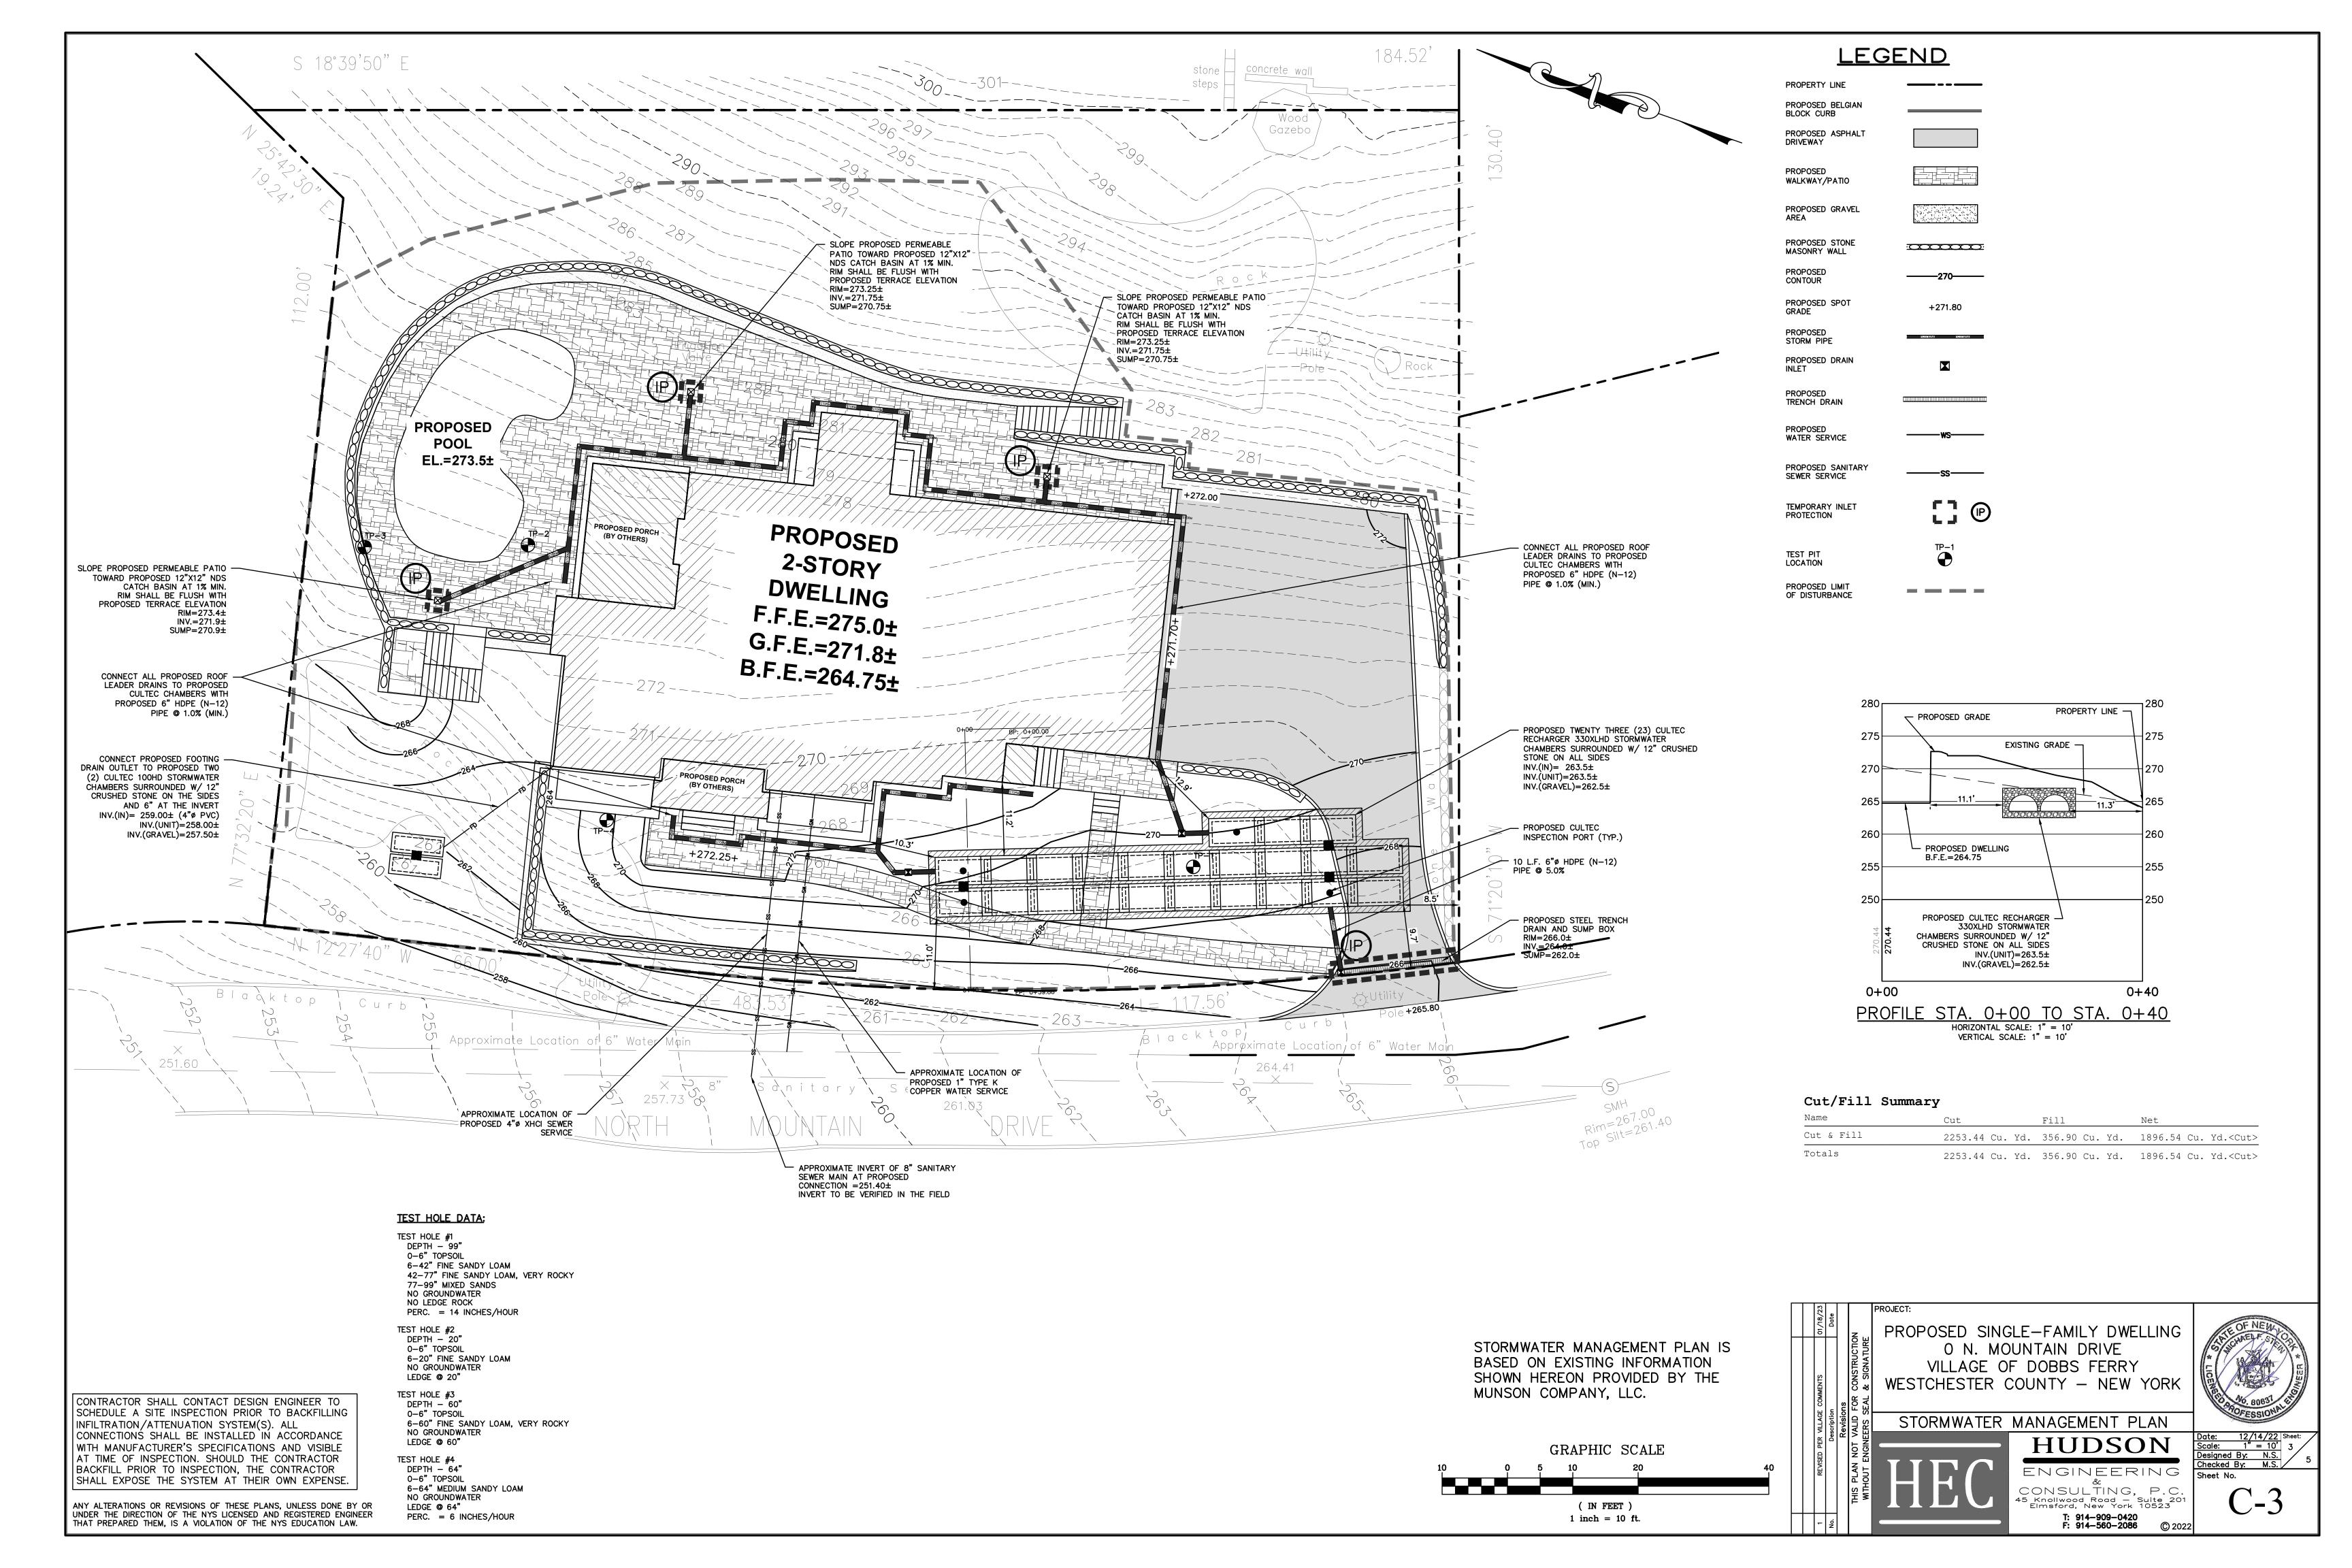

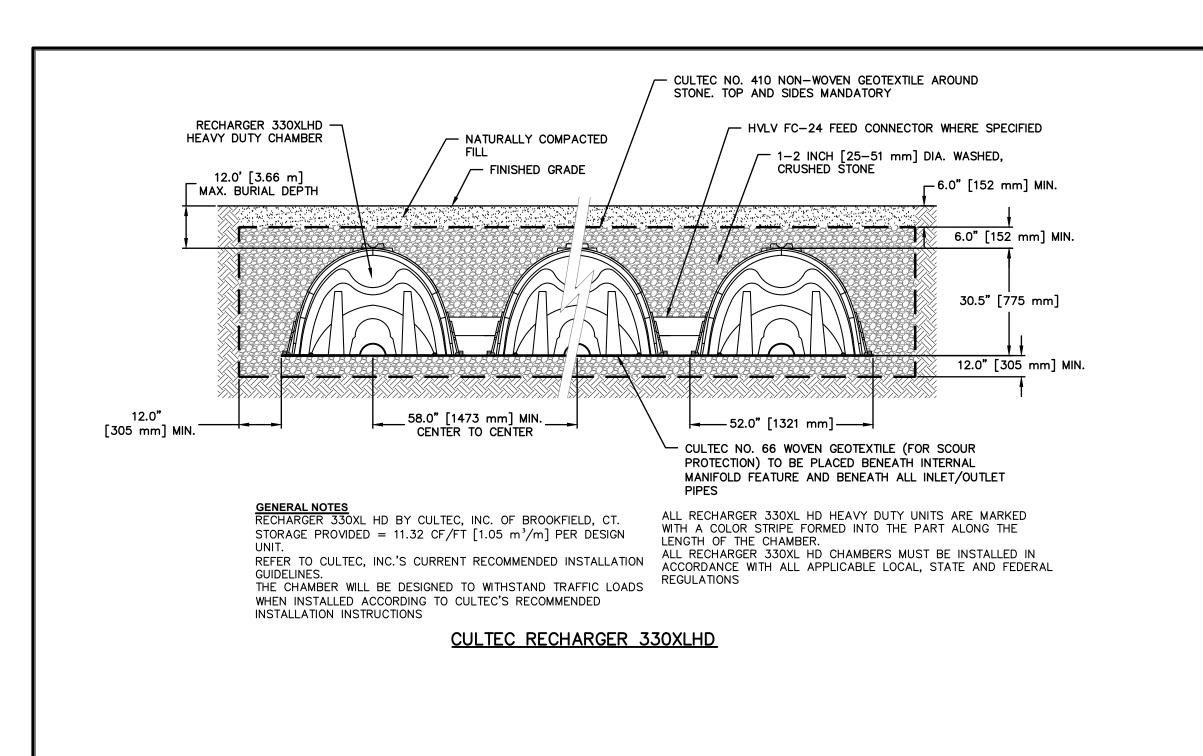

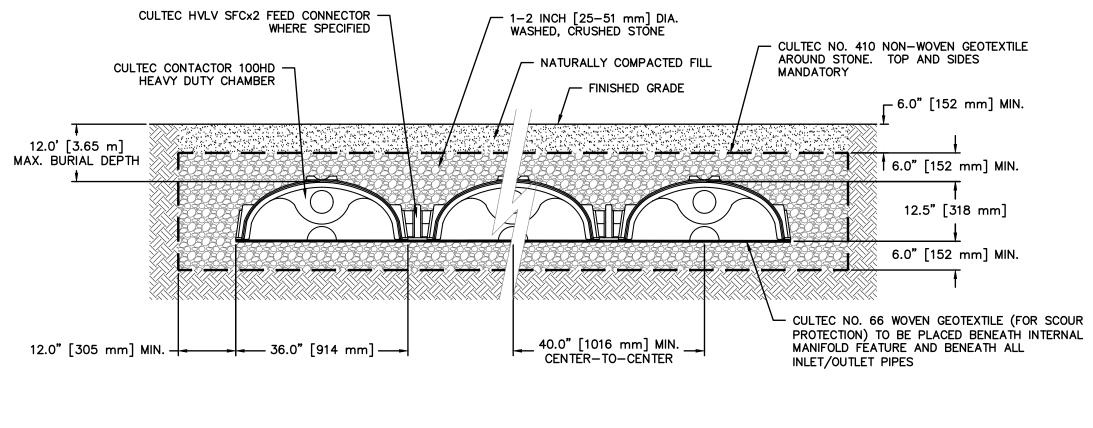



GENERAL NOTES
CONTACTOR 100HD BY CULTEC, INC. OF BROOKFIELD, CT. STORAGE PROVIDED = $3.84 \text{ CF/FT} [0.82 \text{ M}^3/3] \text{ PER DESIGN UNIT.}$ REFER TO CULTEC, INC.'S CURRENT RECOMMENDED INSTALLATION MAXIMUM ALLOWED COVER ON TOP OF UNIT SHALL BE 12.0' [3.66 m]

THE CHAMBER WILL BE DESIGNED TO WITHSTAND TRAFFIC LOADS

WHEN INSTALLED ACCORDING TO CULTEC'S RECOMMENDED INSTALLATION INSTRUCTIONS.ALL CONTACTOR 100HD HEAVY DUTY UNITS ARE MARKED WITH A COLOR STRIPE FORMED INTO THE PART ALONG THE LENGTH OF THE CHAMBER. ALL CONTACTOR 100 CHAMBERS MUST BE INSTALLED IN ACCORDANCE WITH ALL APPLICABLE LOCAL, STATE AND FEDERAL REGULATIONS.

CULTEC CONTACTOR 100HD

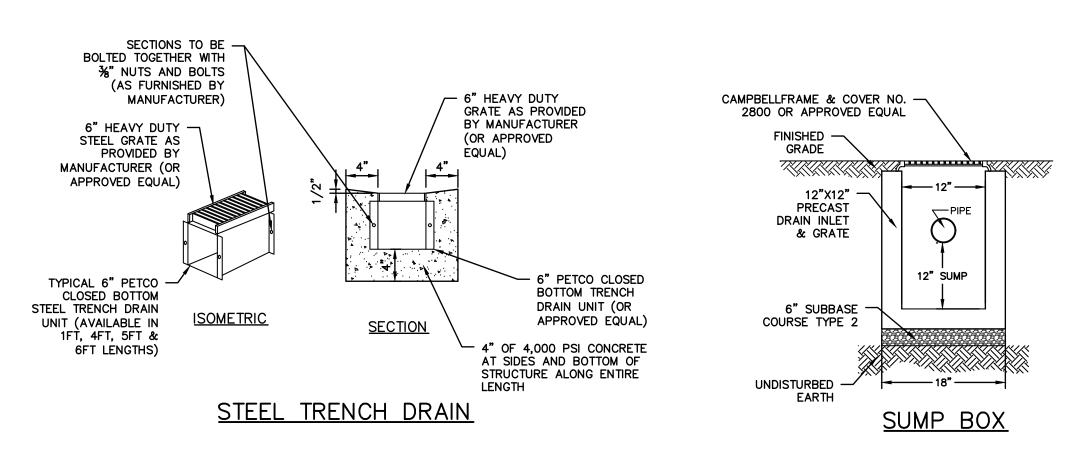

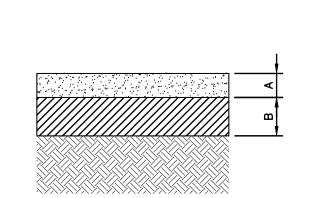

A- 2" TOP COURSE- N.Y.S.D.O.T. ITEM, 403.178202, TYPE 6 F2 B- 4" SUBBASE COURSE- N.Y.S.D.O.T. ITEM, 304.12, TYPE 2 DRIVEWAY PAVEMENT SECTION

CAMPBELL FRAME & GRATE #4152

4" SDR-35 PVC -

THE DIRECTION OF THE FLOW OF THE DRAINAGE LINE (P3005.2.8).

GENERAL, ALL STORM SEWER SERVICES TO BE 6"0 SCH. 40 @ 1.0% MINIMUM.

CLEANOUTS SHALL BE PLACED BEFORE SIGNIFICANT PIPE BEND LOCATIONS (I.E.,

ALL SANITARY SEWER SERVICES TO BE 4"0 SCH. 40 @ 1.0% MINIMUM. IN ACCORDANCE WITH THE NYS RESIDENTIAL BUILDING CODE, THE FOLLOWING

A. CLEANOUTS SHALL BE INSTALLED NOT MORE THAN 100 FEET APART IN HORIZONTAL

DRAINAGE LINES (P3005.2.2).
B. CLEANOUTS SHALL BE INSTALLED AT EACH CHANGE OF DIRECTION OF THE DRAINAGE

REFER TO PLAN FOR SPECIFIC PIPE SIZING AND SLOPE SPECIFICATIONS; HOWEVER, IN

JUNCTIONS, 90-DEGREE BENDS, ETC.) UNLESS A ROOF LEADER DOWNSPOUT CONNECTION IS

SEWER CLEANOUT DETAIL (GRAVITY)

(STORM OR SANITARY)


C. CLEANOUTS SHALL BE INSTALLED SO THAT THE CLEANOUT OPENS TO ALLOW CLEANING IN

NOTES (SANITARY SEWER SERVICES):


NOTES (STORM SEWER):

SYSTEM GREATER THAN 45 DEGREES.


45° BEND

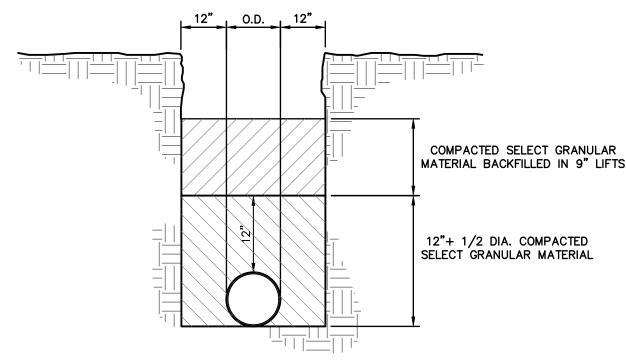



TRENCH BEDDING

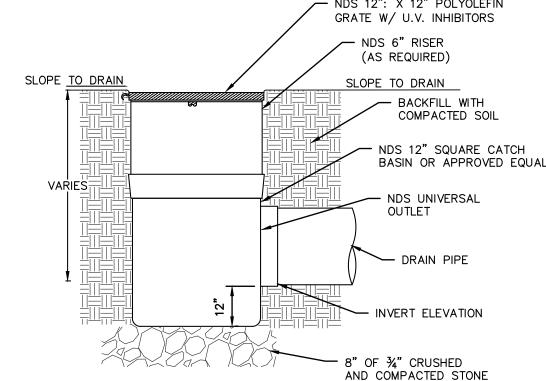

NDS SQUARE CATCH BASIN

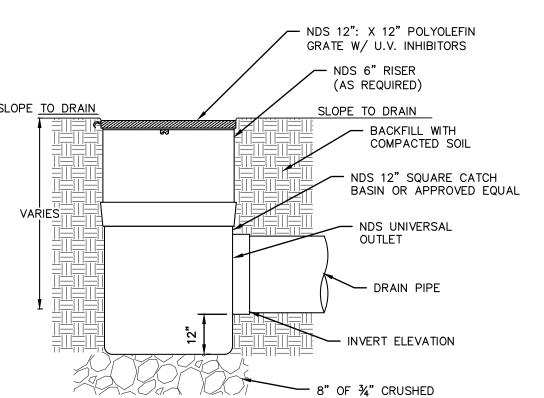

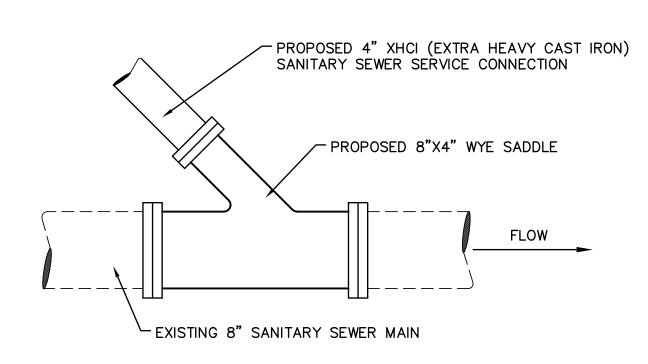


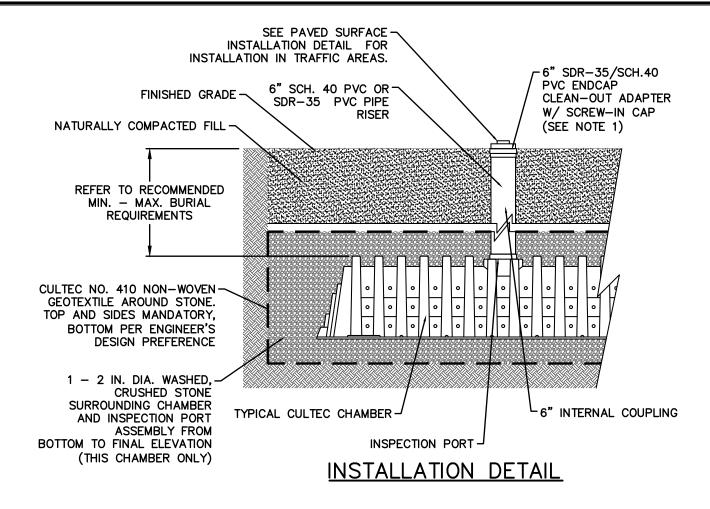

CULTEC INSPECTION PORT

NOTES:

- 1. WHEN ACCESS PORT IS UTILIZED AS SYSTEM OVERFLOW, INSTALL NDS MODEL 50 GRATE. GRATE TO BE SET 1/2" ABOVE ADJACENT GRADE. ADJACENT GRADE TO PITCH AWAY FROM ACCESS PORT IN ALL
- 2. INSPECTION PORT NOT TO SERVE AS OVERFLOW WHEN INSTALLED IN PAVED/TRAFFIC AREAS.

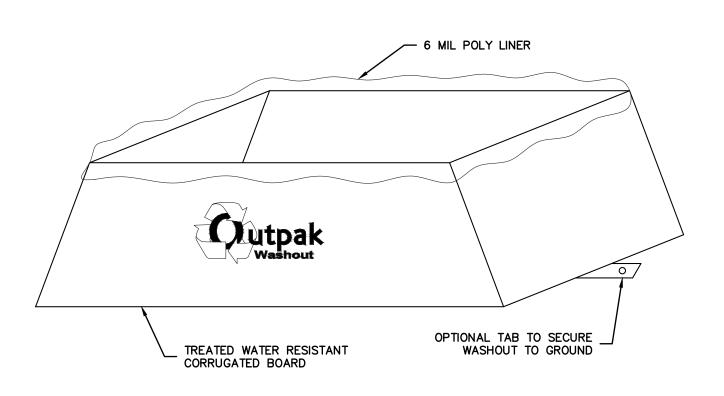


NOTES:

- 1. THE WASHOUT SHALL BE INSTALLED PRIOR TO USING MATERIALS THAT REQUIRE WASHOUT ON THIS PROJECT.
- 2. AS NECESSARY, SIGNS SHALL BE PLACED THROUGHOUT THE SITE TO INDICATE THE LOCATION OF THE WASHOUT.
- 3. THE WASHOUT AREA WILL BE REPLACED AS NECESSARY TO MAINTAIN CAPACITY FOR LIQUID WASTE.
- 4. WASHOUT RESIDUE SHALL BE REMOVED FROM THE SITE AND DISPOSED OF AT AN APPROVED WASTE FACILITY.
- 5. DO NOT WASHOUT INTO STORM DRAINS, OPEN DITCHES, STREETS, OR
- 6. AVOID DUMPING EXCESS CONCRETE IN NON-DESIGNATED DUMPING AREAS.
- 7. LOCATE WASHOUT AT LEAST 50' (15 METERS) FROM STORM DRAIN, OPEN DITCHES, OR WATER BODIES.
- 8. THE WASHOUT SHALL BE USED ONLY FOR NON-HAZARDOUS WASTES.

CORRUGATED CONCRETE WASHOUT

O N. MOUNTAIN DRIVE

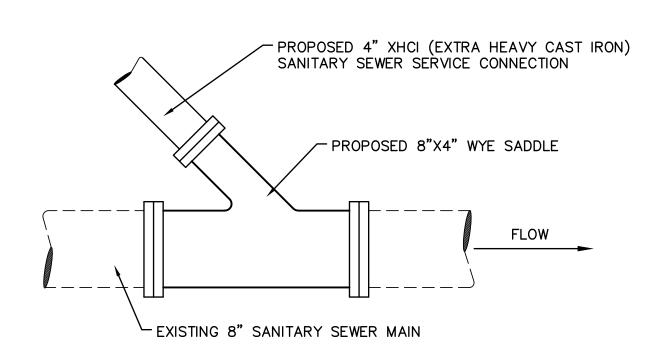

SEWER "WYE" DETAIL

ROADWAY CAST IRON CURB BOX TO BE LOCATED WITHIN COUPLING (TYP.) EASEMENT / RIGHT OF WAY COPPER SERVICE FOR APPLICABLE 3/4" OR 1" SERVICE CONNECTION ROD CORPORATION STOP PIN SERVICE TAP TO BE ANGLED AT 2 OR 10 O'CLOCK CURB STOP SERVICE SADDLE FOR THE COUNTY OF WESTCHESTER TO METER -& PUTNAM WATER MAIN COUPLING (TYP.) COPPER SERVICE FOR APPLICABLÉ 3/4" OR 1" SERVICE CONNECTION DOMESTIC SERVICE CONNECTION SPECIFICATION DETAILS 3/4" & 1" SERVICE CONNECTION

INSTALLATION OF WATER SYSTEMS APPURTENANCES

SIDEWALK / PROPOSED GRADE

PRIVATE PROPERY

DRAFTED BY: AR

SCALE: NTS

APPROVED BY: SWNY DIV. NB

FIGURE 3.01

DATE: 1/01/2021

RIGHT OF WAY

ANY ALTERATIONS OR REVISIONS OF THESE PLANS, UNLESS DONE BY OR UNDER THE DIRECTION OF THE NYS LICENSED AND REGISTERED ENGINEER THAT PREPARED THEM, IS A VIOLATION OF THE NYS EDUCATION LAW.

162 OLD MILL ROAD.

(845) 620-6215

WEST NYACK, NY 10994

1. SEE STANDARD SPECIFICATION FOR MATERIAL TYPES

3. IN THE COUNTY OF ROCKLAND ORANGE, AND TIOGA


USE DIRECT TAP FOR 3/4" & 1" SERVICES

OF WESTCHESTER AND PUTNAM IS 1"

ANGLED AT 9 OR 3 O'CLOCK

WHERE MAIN DEPTH IS LESS THAN 4 FEET, TAP TO BE

4. THE SMALLEST SERVICE SIZE ALLOWED IN THE COUNTY

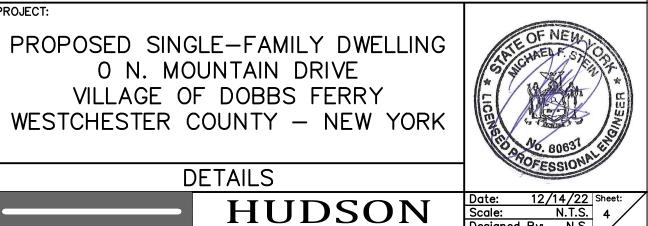


DETAILS **HUDSON** ENGINEERING CONSULTING, P.C Knollwood Road — Suite 20 Elmsford, New York 10523

T: 914-909-0420 F: 914-560-2086

Designed By: N.S. Checked By: M.S.

TRAP NUMBER TYPE OF IRAP AREA (ACRES) C.F.) I ST-V 1.90 6,840* 8,509 199.0 201.0 203.0 204.0 *REQUIRED STORAGE VOLUME BASED UPON THE NYSDEC REQUIREMENT OF

3,600 CUBIC-FEET OF STORAGE PER ACRE OF TRIBUTARY DRAINAGE AREA

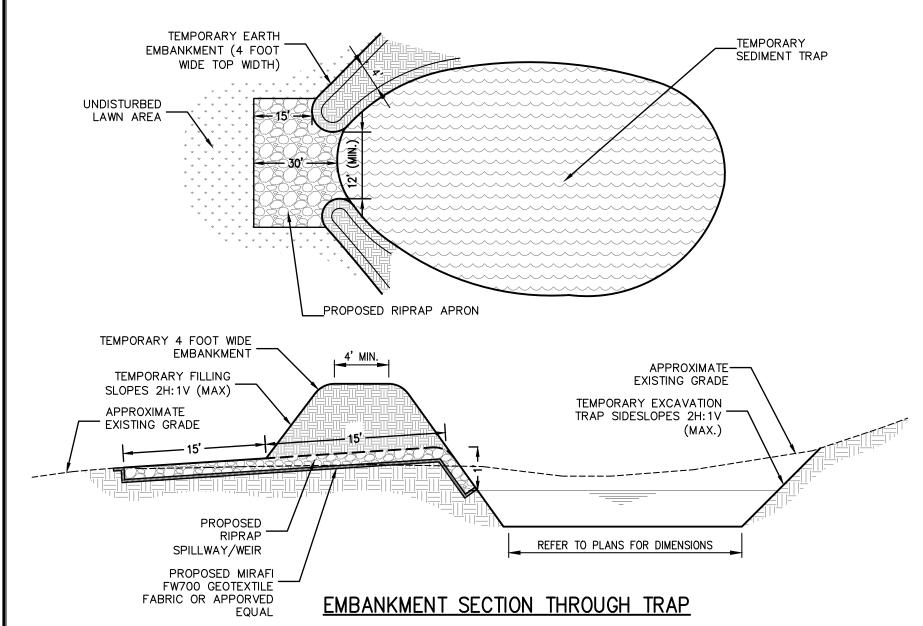

CONSTRUCTION SPECIFICATIONS

- 1. THE AREA UNDER EMBANKMENT SHALL BE CLEARED, GRUBBED AND STRIPPED OF ANY VEGETATION AND ROOT MAT. THE POOL AREA SHALL BE CLEARED.
- 2. THE FILL MATERIAL FOR THE EMBANKMENT SHALL BE FREE OF ROOTS OR OTHER WOODY VEGETATION AS WELL AS OVER-SIZED STONES, ROCKS, ORGANIC MATERIAL OR OTHER OBJECTIONABLE MATERIAL. THE EMBANKMENT SHALL BE COMPACTED BY TRAVERSING WITH EQUIPMENT WHILE IT IS BEING CONSTRUCTED. MAXIMUM HEIGHT OF EMBANKMENT SHALL BE FIVE (5) FEET, MEASURED AT THE CENTERLINE OF
- EMBANKMENT.

 3. ALL FILL SLOPES SHALL BE 2:1 OR FLATTER, CUT SLOPES 1:1 OR FLATTER.
- 4. ELEVATION OF THE TOP OF ANY DIKE DIRECTING WATER INTO TRAP MUST EQUAL OR EXCEED THE HEIGHT OF EMBANKMENT.
 5. STORAGE AREA PROVIDED SHALL BE FIGURED BY COMPUTING THE VOLUME AVAILABLE
- BEHIND THE OUTLET CHANNEL UP TO AN ELEVATION OF ONE (1) FOOT BELOW THE LEVEL WEIR CREST.

 6. FILTER CLOTH SHALL BE PLACED OVER THE BOTTOM AND SIDES OF THE OUTLET CHANNEL PRIOR TO PLACEMENT OF STONE. SECTIONS OF FABRIC MUST OVERLAP AT

LEAST (1) FOOT WITH SECTION NEAREST THE ENTRANCE PLACED ON TOP. FABRIC

- SHALL BE EMBEDDED AT LEAST (6) INCHES INTO EXISTING GROUND AT ENTRANCE OUTLET CHANNEL.

 7. STONE USED IN THE OUTLET CHANNEL SHALL BE FOUR (4) TO EIGHT (8) INCH RIPRAP. TO PROVIDE A FILTERING EFFECT, A LAYER OF FILTER CLOTH SHALL BE EMBEDDED ONE (1) FOOT WITH SECTION NEAREST THE ENTRANCE PLACED ON TOP. FABRIC SHALL BE EMBEDDED AT LEAST SIX (6) INCHES INTO EXISTING GROUND AT
- ENTRANCE OF OUTLET CHANNEL.

 8. SEDIMENT SHALL BE REMOVED AND TRAP RESTORED TO ITS ORIGINAL DIMENSIONS WHEN SEDIMENT HAS ACCUMULATED TO ½ THE DESIGN DEPTH OF THE TRAP. REMOVED SEDIMENT SHALL BE DEPOSITED IN A SUITABLE AREA AND IN SUCH A MANNER THAT
- THE STRUCTURE SHALL BE INSPECTED AFTER EACH RAIN AND REPAIRED AS NEEDED.
 CONSTRUCTION OPERATIONS SHALL BE CARRIED OUT IN SUCH A MANNER THAT
- EROSION AND WATER POLLUTION ARE MINIMIZED.

 11. THE STRUCTURE SHALL BE REMOVED AND THE AREA STABILIZED WHEN DRAINAGE
- AREA HAS BEEN PROPERLY STABILIZED.

 12. DRAINAGE AREA FOR THIS PRACTICE IS LIMITED TO 15 ACRES OR LESS.
- SEDIMENT TRAP I

 ELEVATION
 AREA
 VOLUME*
 VOL.SUM*

 (ft.)
 (sq. ft)
 (cu. ft.)
 (cu. ft.)

 252
 0
 0
 0

 254
 26
 17
 17

 256
 85
 105
 123


 258
 174
 254
 376

*Volumue Formula (Conical Frustum): ⅓h(A1 + A2 (√(A1)(A2))

Where: h=height

A1=area of base elevation
A2=area of top elevation


RIPRAP OUTLET SEDIMENT TRAP (NYSDEC ST-V)

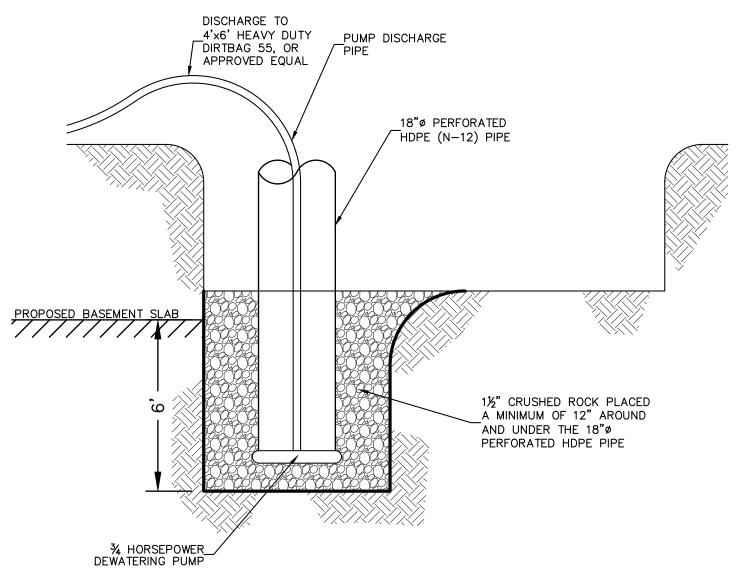


TYPICAL DEWATERING SUMP

SCHEDULE OF TEMPORARY EROSION CONTROL MEASURES:


| MEASURE | DATES FOR USE | TIMING, ACTIVITY, AND LOCATION |
|---|--|--|
| SOIL/STOCKPILE AREAS | ALL | ALL SOIL AND SHOT ROCK STRIPPED FROM THE CONSTRUCTION AREA DURING GRUBBING AND MASS GRADING SHALL BE STOCKPILED IN LOCATIONS SHOWN ON THE PLANS, BUT IN NO CASE SHALL THEY BE PLACED WITHIN 100' OF A WETLAND OR WATERCOURSE. THE STOCKPILED SOILS SHALL BE RE-USED DURING FINISH-GRADING TO PROVIDE A SUITABLE GROWING MEDIUM FOR PLANT ESTABLISHMENT. SOIL STOCKPILES SHALL BE PROTECTED FROM EROSION BY VEGETATING THE STOCKPILE WITH RAPIDLY -GERMINATING GRASS SEED (DURING THE MAY 1ST - OCTOBER 30TH) PLANTING SEASON OR COVERING THE STOCKPILE WITH TARPAULIN THE REMAINDER OF THE YEAR. INSTALL SILT FENCE AROUND TOE OF SLOPE. |
| SILT FENCE | ALL | SILT FENCE (GEO-TEXTILE FILTER CLOTH) SHALL BE PLACED IN LOCATIONS DEPICTED ON THE APPROVED PLANS. THE PURPOSE OF THE SILT FENCE IS TO REDUCE THE VELOCITY OF SEDIMENT LADEN STORMWATER FROM SMALL DRAINAGE AREAS AND TO INTERCEPT THE TRANSPORTED SEDIMENT LOAD. IN GENERAL, SILT FENCE SHALL BE USED AT THE TOE OF SLOPES OR INTERMEDIATELY WITHIN SLOPES WHERE OBVIOUS CHANNEL CONCENTRATION OF STORMWATER IS NOT PRESENT. |
| | | SILT FENCING SHALL BE INSPECTED AT A MINIMUM OF ONCE PER WEEK AND PRIOR TO AND WITHIN 24 HOURS FOLLOWING A RAIN EVENT ½" OR GREATER. INSPECTIONS SHALL INCLUDE ENSURING THAT THE FENCE MATERIAL IS TIGHTLY SECURED TO THE WOVEN WIRE AND THE WIRE IS SECURED TO THE WOOD POSTS. IN ADDITION, OVERLAPPING FILTER FABRIC SHALL BE SECURED AND THE FABRIC SHALL BE MAINTAINED A MINIMUM OF SIX (6) INCHES BELOW GRADE. IN THE EVENT THAT ANY "BULGES" DEVELOP IN THE FENCE, THAT SECTION OF FENCE SHALL BE REPLACED WITHIN 24 HOURS WITH NEW FENCE SECTION. ANY SEDIMENT BUILD—UP AGAINST THE FENCE SHALL BE REMOVED WITHIN 24 HOURS AND DEPOSITED ON—SITE A MINIMUM OF 100 FEET OUTSIDE OF ANY WETLAND OR WATERCOURSE. |
| INLET PROTECTION (STONE & BLOCK DROP INLET PROTECTION) | ALL | IN ORDER TO PROTECT THE RECEIVING WATERS FROM SEDIMENTATION, THE CONTRACTOR SHALL INSTALL STONE AND BLOCK INLET PROTECTION FOR ALL EXISTING AND PROPOSEI INLETS AS SHOWN ON THE PLANS. ONCE INSTALLED, ¾ INCH STONE AGGREGATE SHALL BE INSTALLED AROUND THE PERIMETER OF ALL CATCH BASINS AND SURFACE INLETS AS ILLUSTRATED ON THE APPROVED PLANS. THIS BARRIER WILL ALLOW STORMWATER TO BE FILTERED PRIOR TO REACHING THE BASIN INLET GRATE. |
| | | THE STONE AGGREGATE SHALL BE INSPECTED WEEKLY PRIOR TO AND WITHIN 24 HOURS FOLLOWING A RAIN EVENT ½" OR GREATER. CARE SHALL BE TAKEN TO ENSURE THAT ALL STONE AGGREGATE IS PROPERLY LOCATED AND SECURE AND DO NOT BECOME DISPLACED THE STONE AGGREGATE SHALL BE INSPECTED FOR ACCUMULATED SEDIMENTS AND AN ACCUMULATED SEDIMENT SHALL BE REMOVED FROM THE DEVICE AND DEPOSITED NOT LESS THAN 100 FEET FROM WETLAND OR WATERCOURSE |
| INLET PROTECTION (SILTSACK) | ALL | IN ORDER TO PROVIDE ADDITIONAL PROTECTION FOR THE RECEIVING WATERS FROM SEDIMENTATION AND TURBIDITY, THE CONTRACTOR SHALL INSTALL A SILTSACK SEDIMENT CAPTURE DEVICE ON ALL EXISTING AND PROPOSED INLETS AS SHOWN ON THE PLANS. THIS DEVICE SHOULD BE INSTALLED IN ADDITION TO THE STONE & BLOCK DROP INLET PROTECTION. THIS BARRIER WILL PROVIDE ADDITIONAL FILTERING OF THE STORMWATER RUNOFF PRIOR TO BEING DISCHARGED FROM THE CATCH BASIN. |
| | | WHEN THE RESTRAINT CORD IS NO LONGER VISIBLE, THE SILTSACK IS FULL AND SHOULD BE EMPTIED. TO REMOVE SILTSACK, TAKE TWO PIECES OF 1" DIAMETER REBAR AND PLACE THROUGH THE LIFTING LOOPS ON EACH SIDE OF THE SACK TO FACILITATE THE LIFTING OF SILTSACK. TO EMPTY SILTSACK, PLACE UNIT WHERE THE CONTENTS WILL BE COLLECTED PLACE THE REBAR THROUGH THE LIFT STRAPS (CONNECTED TO THE BOTTOM OF THE SACK AND LIFT. THIS WILL LIFT SILTSACK FROM THE BOTTOM AND EMPTY THE CONTENTS. CLEAN OUT AND RINSE. RETURN SILTSACK TO ITS ORIGINAL SHAPE AND PLACE BACK IN THE BASIN ONCE THE CONSTRUCTION CYCLE IS COMPLETE, REMOVE SILTSACK FROM THE BASIN AND CLEAN. SILTSACK SHOULD BE STORED OUT OF SUNLIGHT UNTIL NEXT USE. AN ACCUMULATED SEDIMENT SHALL BE REMOVED FROM THE DEVICE AND DEPOSITED NOT LESS THAN 100 FEET FROM WETLAND OR WATERCOURSE. |
| DUST CONTROL | ALL | DURING DRY WEATHER, FOR AREAS OF EXPOSED SOIL WHERE IT IS NOT FEASIBLE TO ESTABLISH TEMPORARY GROUND COVER DUE TO CONSTRUCTION OPERATIONS, THE CONTRACTOR SHALL WET AREAS WITH WATER AT LEAST TWICE A DAY IN ORDER TO CONTRO DUST. THE MOISTENING OF SUCH AREAS MAY BE INCREASED TO FOUR TIMES A DAY DURING PERIODS OF LITTLE RAIN AS DETERMINED BY THE ENGINEER AND/OR THE CONTRACTOR. |
| TEMPORARY SEEDING | ALL | IN AREAS WHERE SOIL DISTURBANCE ACTIVITY HAS TEMPORARILY OR PERMANENTLY CEASED, THE APPLICATION OF SOIL STABILIZATION MEASURES MUST BE INITIATED BY THE END OF THI NEXT BUSINESS DAY AND COMPLETED WITHIN FOURTEEN (14) DAYS FROM THE DATE THE CURRENT SOIL DISTURBANCE ACTIVITY CEASED. FOR CONSTRUCTION SITES THAT DIRECTLY DISCHARGE TO ONE OF THE 303(D) SEGMENTS LISTED IN APPENDIX E OF GP-015-002, OR IS LOCATED IN ONE OF THE WATERSHEDS LISTED IN APPENDIX C OF GP-015-002, THE APPLICATION OF SOIL STABILIZATION MEASURES MUST BE INITIATED BY THE END OF THE NEXT BUSINESS DAY AND COMPLETED WITHIN SEVEN (7) DAYS FROM THE DATE THE CURRENT SOIL DISTURBANCE ACTIVITY CEASED. WHEN ACTIVITIES TEMPORARILY CEASE DURING CONSTRUCTION, SOIL STOCKPILES AND EXPOSED SOIL SHOULD BE STABILIZED BY SEED, MULCH OR OTHER APPROPRIATE MEASURES. |
| | SPRING/SUMMER/ EARLY FALL | SEED THE AREA WITH RYEGRASS (ANNUAL OR PERENNIAL) AT 30 LBS. PER ACRE (APPROXIMATELY 0.7 LB./1000 SQ. FT. OR USE 1 LB./1000 SQ. FT.) |
| | LATE FALL/ EARLY WINTER | SEED THE AREA WITH CERTIFIED 'AROOSTOOK' WINTER RYE (CEREAL RYE) AT 100 LBS. PER ACRE (2.5 LBS./1000 SQ. FT.) |
| MULCH | APRIL 1 - NOVEMBER 30 | ON ALL AREAS OF EXPOSED SOIL WHICH WILL NOT BE DISTURBED AGAIN WITHIN 7 DAYS, APPLY AT A RATE OF 1.5 TO 2.0 TONS PER ACRE. |
| WINTER MULCH | DECEMBER 1 - MARCH 31 | ON ALL AREAS OF EXPOSED SOIL WHICH WILL NOT BE DISTURBED AGAIN WITHIN 7 DAYS, APPLY AT A RATE OF 3.0 TO 4.0 TONS PER ACRE EROSION CONTROL BLANKET MAY BE USED AS A SUBSTITUTE FOR WINTER MULCH. |
| INSPECTIONS | UNTIL SITE IS PERMANENTLY STABILIZED | ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL BE INSPECTED BY THE CONTRACTOR IMMEDIATELY AFTER EACH RAINFALL EVENT AND AT LEAST DAILY DURING PROLONGED RAINFALL. ANY REQUIRED REPAIRS SHALL BE MADE BY THE CONTRACTOR. SEDIMENT DEPOSITS SHALL BE REMOVED BY THE CONTRACTOR WHEN THEY REACH APPROXIMATELY ONE—THIRD THE HEIGHT OF THE SILT FENCE. SEDIMENTS SHALL BE DISPOSED OF IN A MANNER THAT DOES NOT RESULT IN ADDITIONAL EROSION OR POLLUTION. |

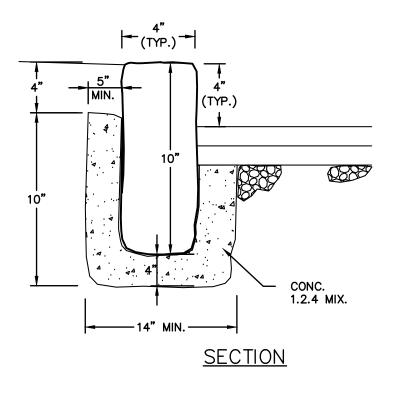

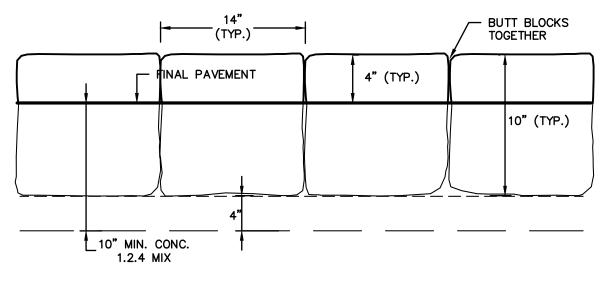

<u>ELEVATION</u>

BELGIUM BLOCK CURB DETAIL

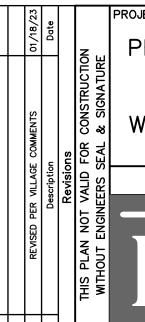

PROPOSED SINGLE-FAMILY DWELLING
O N. MOUNTAIN DRIVE
VILLAGE OF DOBBS FERRY
WESTCHESTER COUNTY - NEW YORK



DETAILS

HUDSON

ENGINEERING & CONSULTING, P.C. **S Knollwood Road — Suite 201 Elmsford, New York 10523 T: 914-909-0420 F: 914-560-2086 © 202

Scale: N.T.S.

Designed By: N.S.
Checked By: M.S.
Sheet No.